

NFPA® 13D

Standard for the Installation of Sprinkler Systems in One- and Two-Family Dwellings and Manufactured Homes

2013 Edition



NFPA, 1 Batterymarch Park, Quincy, MA 02169-7471
An International Codes and Standards Organization



Become a
Member

Subscribe
to the



Register for
Seminars, Webinars,
and Online Courses

Visit the
NFPA Catalog

IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® DOCUMENTS
NOTICE AND DISCLAIMER OF LIABILITY CONCERNING THE USE OF NFPA DOCUMENTS

NFPA® codes, standards, recommended practices, and guides (“NFPA Documents”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Documents.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Documents. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Documents available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Documents. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA DOCUMENTS

ADDITIONAL NOTICES AND DISCLAIMERS

Updating of NFPA Documents

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Documents”) should be aware that these documents may be superseded at any time by the issuance of new editions or may be amended from time to time through the issuance of Tentative Interim Amendments. An official NFPA Document at any point in time consists of the current edition of the document together with any Tentative Interim Amendments and any Errata then in effect. In order to determine whether a given document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments or corrected through the issuance of Errata, consult appropriate NFPA publications such as the National Fire Codes® Subscription Service, visit the NFPA website at www.nfpa.org, or contact the NFPA at the address listed below.

Interpretations of NFPA Documents

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Document. The users of NFPA Documents bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Documents.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

NOTICE: The user’s attention is called to the possibility that compliance with an NFPA Document may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Documents should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Documents are copyrighted by the NFPA. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Documents for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Documents, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Documents and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA documents during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02169-7471; email: stds_admin@nfpa.org

For more information about NFPA, visit the NFPA website at www.nfpa.org.

Copyright © 2012 National Fire Protection Association®. All Rights Reserved.

NFPA® 13D

Standard for the

**Installation of Sprinkler Systems in One- and Two-Family Dwellings
and Manufactured Homes**

2013 Edition

This edition of NFPA 13D, *Standard for the Installation of Sprinkler Systems in One- and Two-Family Dwellings and Manufactured Homes*, was prepared by the Technical Committee on Residential Sprinkler Systems and released by the Technical Correlating Committee on Automatic Sprinkler Systems. It was issued by the Standards Council on May 29, 2012, with an effective date of June 18, 2012, and supersedes all previous editions.

Tentative interim amendments (TIAs) to Paragraph 6.5.3 and Section 9.2 and its Annex A material were issued on August 9, 2012. For further information on tentative interim amendments, see Section 5 of the NFPA Regulations Governing Committee Projects available at: <http://www.nfpa.org/assets/files/PDF/CodesStandards/TIAErrataFI/TIARegs.pdf>

This edition of NFPA 13D was approved as an American National Standard on June 18, 2012.

Origin and Development of NFPA 13D

Recognizing the need to reduce the annual life loss from fire in residential occupancies (about 50 percent of total loss of life by fire), the Committee on Automatic Sprinklers appointed a subcommittee in May 1973 to prepare the *Standard on the Installation of Sprinkler Systems in One- and Two-Family Dwellings and Mobile Homes*. The subcommittee was composed of members of the Committee on Automatic Sprinklers and other technically competent experts. The standard was submitted and adopted at the NFPA Annual Meeting in Chicago, Illinois, on May 12–16, 1975.

The 1980 edition was a complete rewrite of the 1975 edition, including SI units where appropriate. The 1980 edition incorporated the results of the residential sprinkler test program administered by the National Fire Protection Association and funded by a research grant from the United States Fire Administration. Factory Mutual Research Corporation and the Los Angeles City Fire Department conducted the dwelling tests. Factory Mutual Research Corporation, McNeary Insurance Consulting Services, and the Charlotte, North Carolina, Fire Department conducted the mobile home tests.

After gaining practical experience using the 1980 edition, modifications to the standard, including removal of design parameters for dry pipe systems, were made in the 1984 edition.

The 1989 and 1991 editions established criteria for the use of antifreeze systems as well as some of the installation criteria associated with specially listed piping materials.

The 1994 edition provided expanded information on nonmetallic pipe and introduced a new design option that reduced water storage requirements for limited area dwellings.

The 1996 edition of the standard included expanded information on the use and placement of residential sprinklers near heat sources. For the first time since 1941, the use of $\frac{1}{2}$ in. (12.7 mm) piping material was permitted again for sprinkler systems under specific conditions. A number of appendix figures were also added to address methods for protecting pipe from freezing in unheated attics.

The 1999 edition revised criteria for certain types of multipurpose piping systems and added requirements to mitigate the effect of water softeners and filters on system performance. Information on the application of solvent cement for nonmetallic piping systems was provided, and the exception for omitting sprinkler coverage in attics and crawl spaces was modified.

The 2002 edition incorporated revisions to update the standard to comply with the 2000 edition of the *Manual of Style for NFPA Technical Committee Documents*. These revisions included editorially rewording any exceptions as requirements. The 2002 edition also included

changes that established a minimum design discharge density. The requirements for multipurpose systems were changed to require a bypass valve for installations with water softeners or water filtration equipment installed and to update the requirements for network systems. The chapter specifically addressing limited area dwelling systems was no longer included in the standard.

The 2007 edition included new spacing and obstruction rules addressing sloped ceilings, ceiling pockets, ceiling fans, and kitchen cabinets. Also new to this edition were installation, design, and acceptance requirements for pumps. The acceptability of insulation as a method of freeze protection and the acceptability of wells as a water source were clarified for this edition. New requirements for listed dry pipe/preaction residential sprinkler systems, as well as clarified requirements for multipurpose combined and networked sprinkler systems, were incorporated. Finally, specific obstruction rules were added for residential sprinklers.

In the 2010 edition new requirements were added for a prescriptive pipe sizing method as an alternative to the hydraulic calculation method. The standard added the term *townhouses* to the definition of *dwelling* in order to clarify that townhouses that meet the definition of *dwelling* can be protected by an NFPA 13D system. Finally, annex material was added to provide clear guidance for the owner on how to properly inspect, test, and maintain the system.

The 2013 edition of NFPA 13D includes a restructuring to make the document easier to use. Four new chapters have been added, breaking out freeze protection, acceptance testing, maintenance, and discharge criteria into their own chapters. This edition has also seen modification to the definitions of *multipurpose* and *stand-alone systems*, along with a new definition for *passive purge systems*. New language addressing the number of heads to be calculated for certain sloped and beamed ceiling configurations was added based on a Fire Protection Research Foundation Report. The antifreeze requirements have been updated through a series of TIAs that were developed based on FPRF testing.

Technical Correlating Committee on Automatic Sprinkler Systems

Edward Budnick, Chair
Hughes Associates, Inc., MD [SE]

Jose R. Baz, JRB Associates Group Inc., FL [M]
(Rep. NFPA Latin American Section)
Kerry M. Bell, Underwriters Laboratories Inc., IL [RT]
Russell P. Fleming, National Fire Sprinkler Association, Inc., NY [M]
Scott T. Franson, The Viking Corporation, MI [M]
Michael J. Friedman, Friedman Consulting, Inc., MD [SE]
Raymond A. Grill, Arup Fire, DC [SE]
Luke Hilton, Liberty Mutual Property, NC [I]
Alex Hoffman, Viking Fire Protection Inc., Canada [IM]
(Rep. Canadian Automatic Sprinkler Association)
Roland J. Huggins, American Fire Sprinkler Association, Inc., TX [IM]
Sultan M. Javeri, SC Engineering, France [IM]
Charles W. Ketner, National Automatic Sprinkler Fitters LU 669, MD [L]
(Rep. United Association of Journeymen and Apprentices of the Plumbing and Pipe Fitting Industry

Andrew Kim, National Research Council of Canada, Canada [RT]
Russell B. Leavitt, Telgian Corporation, AZ [U]
(Rep. Trinity Health)
John G. O'Neill, The Protection Engineering Group, PC, VA [SE]
Garner A. Palenske, Aon/Schirmer Engineering Corporation, CA [I]
J. William Sheppard, Sheppard & Associates, LLC, MI [SE]
Robert D. Spaulding, FM Global, MA [I]
Douglas Paul Stultz, U.S. Department of the Navy, VA [E]
Lynn K. Underwood, Axis U.S. Property, IL [I]

Alternates

Donald D. Becker, RJC & Associates, Inc., MO [IM]
(Alt. to R. J. Huggins)
Thomas C. Brown, The RJA Group, Inc., MD [SE]
(Alt. to R. A. Grill)
David B. Fuller, FM Global, MA [I]
(Alt. to R. D. Spaulding)
Kenneth E. Isman, National Fire Sprinkler Association, Inc., NY [M]
(Alt. to R. P. Fleming)
George E. Laverick, Underwriters Laboratories Inc., IL [RT]
(Alt. to K. M. Bell)

Scott T. Martorano, The Viking Corporation, MI [M]
(Alt. to S. T. Franson)
Donato A. Pirro, Electro Sistemas De Panama, S.A., Panama [M]
(Alt. to J. R. Baz)
J. Michael Thompson, The Protection Engineering Group, PC, VA [SE]
(Alt. to J. G. O'Neill)

Nonvoting

James B. Biggins, Global Risk Consultants Corporation, IL [SE]
(Rep. TC on Hanging and Bracing of Water-Based Systems)
Robert M. Gagnon, Gagnon Engineering, MD [SE]
(Rep. TC on Foam-Water Sprinklers)
William E. Koffel, Koffel Associates, Inc., MD [SE]
(Rep. Safety to Life Correlating Committee)
Kenneth W. Linder, Swiss Re, CT [I]
(Rep. TC on Sprinkler System Discharge Criteria)
Joe W. Noble, Noble Consulting Services, LLC, NV [E]
(Rep. TC on Sprinkler System Installation Criteria)
Maurice M. Pilette, Mechanical Designs Ltd., MA [SE]
(Rep. TC on Residential Sprinkler Systems)

Chester W. Schirmer, Aon/Schirmer Engineering Corporation, NC [I]
(Member Emeritus)
Kenneth W. Wagoner, Parsley Consulting Engineers, CA [SE]
(Rep. TC on Private Water Supply Piping Systems)
John J. Walsh, UA Joint Apprenticeship Committee, MD [SE]
(Rep. United Association of Journeymen and Apprentices of the Plumbing and Pipe Fitting Industry
(Member Emeritus))

Matthew J. Klaus, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have overall responsibility for documents that pertain to the criteria for the design and installation of automatic, open and foam-water sprinkler systems including the character and adequacy of water supplies, and the selection of sprinklers, piping, valves, and all materials and accessories. This Committee does not cover the installation of tanks and towers, nor the installation, maintenance, and use of central station, proprietary, auxiliary, and local signaling systems for watchmen, fire alarm, supervisory service, nor the design of fire department hose connections.

Technical Committee on Residential Sprinkler Systems

Maurice M. Pilette, Chair
Mechanical Designs Ltd., MA [SE]

Kerry M. Bell, Underwriters Laboratories Inc., IL [RT]
Fred Benn, Advanced Automatic Sprinkler, Inc., CA [IM]
Jonathan C. Bittenbender, REHAU Incorporated, VA [M]
Frederick C. Bradley, FCB Engineering, GA [SE]
Phillip A. Brown, American Fire Sprinkler Association, Inc., TX [IM]
Thomas G. Deegan, The Viking Group, Inc., MI [M]
 Rep. National Fire Sprinkler Association
Jeffrey Feid, State Farm Insurance Company, IL [I]
Dawn M. Flancher, American Water Works Association, CO [U]
Jeffrey S. Grove, The RJA Group, Inc., NV [SE]
Dana R. Haagensen, Massachusetts Department of Fire Services, MA [E]
Tonya L. Hoover, CAL Fire, Office of the State Fire Marshal, CA [E]
Mark Hopkins, Hughes Associates, Inc., MD [SE]
Kenneth E. Isman, National Fire Sprinkler Association, Inc., NY [M]
Gary L. Johnson, Lubrizol, FL [M]
 Rep. Committee for Firesafe Dwellings
Charles W. Ketner, National Automatic Sprinkler Fitters LU 669, MD [L]
 Rep. United Association of Journeymen and Apprentices of the Plumbing and Pipe Fitting Industry

Ronald G. Nickson, National Multi Housing Council, DC [U]
Michael O'Brian, Brighton Area Fire Authority, MI [E]
 Rep. International Association of Fire Chiefs
Steven Orlowski, National Association of Home Builders, DC [U]
Milosh T. Puchovsky, Worcester Polytechnic Institute, MA [SE]
Scott C. Pugsley, Classic Fire Protection Inc., Canada [IM]
 Rep. Canadian Automatic Sprinkler Association
Steven R. Rians, Standard Automatic Fire Enterprises, Inc., TX [IM]
 Rep. American Fire Sprinkler Association
Chester W. Schirmer, Aon/Schirmer Engineering Corporation, NC [I]
Peter T. Schwab, Wayne Automatic Fire Sprinklers, Inc., FL [IM]
Harry Shaw, Fail Safe Safety Systems Inc., MD [M]
Matt Sigler, International Association of Plumbing & Mechanical Officials, CA [E]
Eric J. Skare, Uponor, Inc., MN [M]
George W. Stanley, Wigington Fire Systems, FL [IM]
 Rep. National Fire Sprinkler Association
Ed Van Walraven, Aspen Fire Protection District, CO [E]
Terry L. Victor, Tyco/SimplexGrinnell, MD [M]
Hong-Zeng Yu, FM Global, MA [I]

Alternates

David W. Ash, Lubrizol Advanced Materials, Inc., OH [M]
 (Alt. to G. L. Johnson)
Robert S. Blach, Menlo Park Fire Protection District, CA [E]
 (Alt. to M. O'Brian)
Lawrence Brown, National Association of Home Builders, DC [U]
 (Alt. to S. Orlowski)
Edward K. Budnick, Hughes Associates, Inc., MD [SE]
 (Alt. to M. Hopkins)
Bradford T. Cronin, Newport Fire Department, RI [E]
 (Alt. to D. R. Haagensen)
Mark E. Fessenden, Tyco Fire Suppression & Building Products, RI [M]
 (Alt. to T. L. Victor)
David B. Fuller, FM Global, MA [I]
 (Alt. to H. Yu)
Jerry R. Hunter, Aon Fire Protection Engineering Corporation, TX [I]
 (Alt. to C. W. Schirmer)
Thomas L. Jacquelin, Thomas L. Jacquelin Automatic Fire Sprinkler Consulting Services, MA [IM]
 (Alt. to P. A. Brown)

Marshall A. Klein, Marshall A. Klein & Associates, Inc., MD [U]
 (Alt. to R. G. Nickson)
George E. Laverick, Underwriters Laboratories Inc., IL [RT]
 (Alt. to K. M. Bell)
Stephen M. Leyton, Protection Design and Consulting, CA [IM]
 (Alt. to S. R. Rians)
Paul McCulloch, Uponor, Inc., MN [M]
 (Alt. to E. J. Skare)
Thomas L. Multer, Reliable Automatic Sprinkler Company, Inc., SC [M]
 (Alt. to T. G. Deegan)
David A. Nickelson, REHAU Incorporated, VA [M]
 (Alt. to J. C. Bittenbender)
Matthew Osburn, Canadian Automatic Sprinkler Association, Canada [IM]
 (Alt. to S. C. Pugsley)
Richard M. Ray, Cybor Fire Protection Company, IL [M]
 (Alt. to K. E. Isman)
Ronald N. Webb, S.A. Comunale Company, Inc., OH [IM]
 (Alt. to G. W. Stanley)

Nonvoting

Robit Khanna, U.S. Consumer Product Safety Commission, MD [C]
M. Larry Maruskin, U.S. Department of Homeland Security, MD [C]

Lawrence A. McKenna, Jr., U.S. Department of Homeland Security, MD [C]

Matthew J. Klaus, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on the design and installation of automatic sprinkler systems in dwellings and residential occupancies up to and including four stories in height, including the character and adequacy of water supplies, and the selection of sprinklers, piping, valves, and all materials and accessories.



Contents

Chapter 1 Administration	13D- 6	Chapter 7 Installation	13D-12
1.1 Scope	13D- 6	7.1 Valves	13D-12
1.2 Purpose	13D- 6	7.2 Drains and Test Connections	13D-12
1.3 Retroactivity	13D- 6	7.3 Pressure Gauges	13D-12
1.4 Equivalency	13D- 6	7.4 Piping Support	13D-12
1.5 Units	13D- 6	7.5 Sprinklers	13D-13
1.6 New Technology	13D- 7	7.6 Alarms	13D-13
Chapter 2 Referenced Publications	13D- 7	7.7 Attics	13D-13
2.1 General	13D- 7	Chapter 8 Sprinkler Position and Location	13D-14
2.2 NFPA Publications	13D- 7	8.1 Design Criteria	13D-14
2.3 Other Publications	13D- 7	8.2 Position of Sprinklers	13D-14
2.4 References for Extracts in Mandatory Sections	13D- 7	8.3 Location of Sprinklers	13D-17
Chapter 3 Definitions	13D- 7	Chapter 9 Protection from Freezing	13D-17
3.1 General	13D- 7	9.1 System Types	13D-17
3.2 NFPA Official Definitions	13D- 7	9.2 Antifreeze Systems	13D-17
3.3 General Definitions	13D- 8	9.3 Dry Pipe and Preaction Systems	13D-18
Chapter 4 General Requirements	13D- 9	Chapter 10 Discharge and Hydraulic Calculations	13D-19
4.1 Sprinkler Temperature Ratings	13D- 9	10.1 Design Discharge	13D-19
4.2 Tube	13D- 9	10.2 Number of Design Sprinklers	13D-19
4.3 Listed or Labeled	13D- 9	10.3 Piping Configurations	13D-19
4.4 Smoke Alarms	13D- 9	10.4 Pipe Sizing	13D-19
4.5 Documentation	13D- 9	Chapter 11 System Acceptance	13D-30
4.6 Qualifications	13D- 9	11.1 General	13D-30
Chapter 5 System Components	13D- 9	11.2 Acceptance Tests	13D-30
5.1 General	13D- 9	Chapter 12 Inspection, Testing, and Maintenance	13D-30
5.2 Aboveground Pipe and Equipment	13D- 9	12.1 General	13D-30
5.3 Underground Pipe	13D-11	12.2 Inspections and Tests	13D-30
5.4 Pre-Engineered Systems	13D-11	12.3 Maintenance	13D-30
Chapter 6 Water Supply	13D-11	Annex A Explanatory Material	13D-31
6.1 General Provisions	13D-11	Annex B Informational References	13D-52
6.2 Water Supply Sources	13D-11	Index	13D-53
6.3 Multipurpose Piping System	13D-12		
6.4 Manufactured Home Water Supply	13D-12		
6.5 Common Supply Pipes	13D-12		

NFPA 13D
Standard for the
Installation of Sprinkler Systems in
One- and Two-Family Dwellings and
Manufactured Homes
2013 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading “Important Notices and Disclaimers Concerning NFPA Documents.” They can also be obtained on request from NFPA or viewed at www.nfpa.org/disclaimers.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

Changes other than editorial are indicated by a vertical rule beside the paragraph, table, or figure in which the change occurred. These rules are included as an aid to the user in identifying changes from the previous edition. Where one or more complete paragraphs have been deleted, the deletion is indicated by a bullet (•) between the paragraphs that remain.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. As an aid to the user, the complete title and edition of the source documents for extracts in mandatory sections of the document are given in Chapter 2 and those for extracts in informational sections are given in Annex B. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced publications can be found in Chapter 2 and Annex B.

Chapter 1 Administration

1.1* Scope.

1.1.1 This standard shall cover the design, installation, and maintenance of automatic sprinkler systems for protection against the fire hazards in one- and two-family dwellings and manufactured homes.

1.1.2 This standard shall not provide requirements for the design or installation of water mist fire protection systems, which are not considered fire sprinkler systems and are addressed by NFPA 750.

1.1.3 This standard shall be based on the concept that the sprinkler system is designed to protect against a fire originating from a single ignition location.

1.2* Purpose.

1.2.1 The purpose of this standard shall be to provide a sprinkler system that aids in the detection and control of residential fires and thus provides improved protection against injury and life loss.

1.2.2 A sprinkler system shall be designed and installed in accordance with this standard to prevent flashover (total involvement) in the room of fire origin, where sprinklered, and to improve the chance for occupants to escape or be evacuated.

1.3 Retroactivity. The provisions of this standard reflect a consensus of what is necessary to provide an acceptable degree of protection from the hazards addressed in this standard at the time the standard was issued.

1.3.1 Unless otherwise specified, the provisions of this standard shall not apply to facilities, equipment, structures, or installations that existed or were approved for construction or installation prior to the effective date of the standard. Where specified, the provisions of this standard shall be retroactive.

1.3.2 In those cases where the authority having jurisdiction determines that the existing situation presents an unacceptable degree of risk, the authority having jurisdiction shall be permitted to apply retroactively any portions of this standard deemed appropriate.

1.3.3 The retroactive requirements of this standard shall be permitted to be modified if their application clearly would be impractical in the judgment of the authority having jurisdiction, and only where it is clearly evident that a reasonable degree of safety is provided.

1.4 Equivalency. Nothing in this standard is intended to prevent the use of systems, methods, or devices of equivalent or superior quality, strength, fire resistance, effectiveness, durability, and safety over those prescribed by this standard.

1.4.1 Technical documentation shall be submitted to the authority having jurisdiction to demonstrate equivalency.

1.4.2 The system, method, or device shall be approved for the intended purpose by the authority having jurisdiction.

1.5 Units.

1.5.1* Metric units of measurement in this standard shall be in accordance with the modernized metric system known as the International System of Units (SI).

1.5.2 The liter and bar units shall be permitted to be used in this standard.

1.5.3 The conversion factors for liter, pascal, and bar shall be in accordance with Table 1.5.3.

Table 1.5.3 Metric Conversions

Name of Unit	Unit Symbol	Conversion Factor
liter	L	1 gal = 3.785 L
pascal	Pa	1 psi = 6894.757 Pa
bar	bar	1 psi = 0.0689 bar
bar	bar	1 bar = 10^5 Pa

1.5.4* Where a value for measurement as specified in this standard is followed by an equivalent value in other units, the first stated value shall be regarded as the requirement.

1.5.5 The equivalent value for a measurement in SI shall be converted by multiplying the value by the conversion factor and then rounding the result to the appropriate number of significant digits.

1.6 New Technology.

1.6.1 Nothing in this standard shall be intended to restrict new technologies or alternate arrangements, provided the level of safety prescribed by this standard is not lowered.

1.6.2 Materials or devices not specifically designated by this standard shall be utilized in complete accord with all conditions, requirements, and limitations of their listings.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

2.2 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 2013 edition.

NFPA 72®, *National Fire Alarm and Signaling Code*, 2013 edition.

NFPA 220, *Standard on Types of Building Construction*, 2012 edition.

NFPA 750, *Standard on Water Mist Fire Protection Systems*, 2010 edition.

2.3 Other Publications.

2.3.1 ANSI Publications. American National Standards Institute, Inc., 25 West 43rd Street, 4th Floor, New York, NY 10036.

ANSI B36.10M, *Welded and Seamless Wrought Steel Pipe*, 2004.

2.3.2 ASME Publications. American Society of Mechanical Engineers, Three Park Avenue, New York, NY 10016-5990.

ASME B16.1, *Gray Iron Pipe Flanges and Flanged Fittings, Classes 25, 125, and 250*, 2010.

ASME B16.3, *Malleable Iron Threaded Fittings, Classes 150 and 300*, 2006.

ASME B16.4, *Gray Iron Threaded Fittings, Classes 125 and 250*, 2006.

ASME B16.5, *Pipe Flanges and Flanged Fittings, NPS 1/2 through NPS 24 Metric/Inch Standard*, 2009.

ASME B16.9, *Factory-Made Wrought Butt welding Fittings*, 2007.

ASME B16.11, *Forged Fittings, Socket-Welding and Threaded*, 2009.

ANSI/ASME B16.15, *Cast Bronze Threaded Fittings*, 2006.

ASME B16.18, *Cast Copper Alloy Solder Joint Pressure Fittings*, 2001.

ASME B16.22, *Wrought Copper and Copper Alloy Solder Joint Pressure Fittings*, 2001.

ASME B16.25, *Buttwelding Ends*, 2007.

2.3.3 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM A 53, *Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless*, 2010.

ASTM A 135, *Standard Specification for Electric-Resistance-Welded Steel Pipe*, 2009.

ASTM A 234, *Standard Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High Temperature Service*, 2010.

ASTM A 795, *Standard Specification for Black and Hot-Dipped Zinc-Coated (Galvanized) Welded and Seamless Steel Pipe for Fire Protection Use*, 2008.

ASTM B 32, *Standard Specification for Solder Metal*, 2008.

ASTM B 43, *Standard Specification for Seamless Red Brass Pipe*, 2009.

ASTM B 75, *Standard Specification for Seamless Copper Tube*, 2002.

ASTM B 88, *Standard Specification for Seamless Copper Water Tube*, 2009.

ASTM B 251, *Standard Specification for General Requirements for Wrought Seamless Copper and Copper-Alloy Tube*, 2010.

ASTM B 813, *Standard Specification for Liquid and Paste Fluxes for Soldering Applications of Copper and Copper-Alloy Tube*, 2010.

ASTM B 828, *Standard Practice for Making Capillary Joints by Soldering of Copper and Copper Alloy Tube and Fittings*, 2002.

ASTM F 437, *Standard Specification for Threaded Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80*, 2009.

ASTM F 438, *Standard Specification for Socket-Type Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 40*, 2009.

ASTM F 439, *Standard Specification for Socket-Type Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80*, 2009.

ASTM F 442, *Standard Specification for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe (SDR-PR)*, 2009.

ASTM F 876, *Standard Specification for Crosslinked Polyethylene (PEX) Tubing*, 2011.

2.3.4 AWS Publications. American Welding Society, 550 NW LeJeune Road, Miami, FL 33126.

AWS A5.8, *Specification for Filler Metals for Brazing and Braze Welding*, 2004.

2.3.5 Other Publications.

Merriam-Webster's Collegiate Dictionary, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

2.4 References for Extracts in Mandatory Sections.

NFPA 5000®, *Building Construction and Safety Code*®, 2012 edition.

Chapter 3 Definitions

3.1 General. The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. Merriam-Webster's Collegiate Dictionary, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1* Approved. Acceptable to the authority having jurisdiction.

3.2.2* Authority Having Jurisdiction (AHJ). An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

3.2.3 Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

3.2.4* Listed. Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

3.2.5 Shall. Indicates a mandatory requirement.

3.2.6 Should. Indicates a recommendation or that which is advised but not required.

3.2.7 Standard. A document, the main text of which contains only mandatory provisions using the word "shall" to indicate requirements and which is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the *Manual of Style for NFPA Technical Committee Documents*.

3.3 General Definitions.

3.3.1 Compartment. A space completely enclosed by walls and a ceiling. Each wall in the compartment is permitted to have openings to an adjoining space if the openings have a minimum lintel depth of 8 in. (203 mm) from the ceiling and the total width of the openings in a single wall does not exceed 8 ft (2.44 m) in width. A single opening of 36 in. (914 mm) or less in width without a lintel is permitted when there are no other openings to adjoining spaces.

3.3.2 Design Discharge. The rate of water discharged by an automatic sprinkler expressed in gpm (mm/min).

3.3.3 Dwelling. Any detached building, or any part of a townhouse structure that is separated from the remainder of the townhouse structure with fire resistance rated assemblies in accordance with local building code, that contains no more than two dwelling units intended to be used, rented, leased, let, or hired out to be occupied or that are occupied for habitation purposes.

3.3.4 Dwelling Unit. One or more rooms, arranged for the use of one or more individuals living together, as in a single house-keeping unit, that normally have cooking, living, sanitary, and sleeping facilities.

3.3.5* Manufactured Home. A structure, transportable in one or more sections, which, in the traveling mode, is 8 body-ft (2.4 m) or more in width or 40 body-ft (12.2 m) or more in length or, when erected on site, is 320 ft² (29.7 m²) or more and which is built on a permanent chassis and designed to be used as a dwelling, with or without a permanent foundation,

when connected to the required utilities, and includes plumbing, heating, air-conditioning, and electrical systems contained therein; except that such terms include any structure that meets all the requirements of this paragraph except the size requirements and with respect to which the manufacturer voluntarily files a certification required by the regulatory agency. Calculations used to determine the number of square feet in a structure are based on the structure's exterior dimensions, measured at the largest horizontal projections when erected on site. These dimensions include all expandable rooms, cabinets, and other projections containing interior space, but do not include bay windows.

3.3.6* Premixed Antifreeze Solution. A mixture of an antifreeze material with water that is prepared and factory-mixed by the manufacturer with a quality control procedure in place that ensures that the antifreeze solution remains homogeneous and that the concentration is as specified.

3.3.7 Pressure.

3.3.7.1 Supply Pressure. The pressure within the supply (e.g., city or private supply water source).

3.3.7.2 System Pressure. The pressure within the system (e.g., above the control valve).

3.3.7.3 System Working Pressure. The maximum anticipated static (nonflowing) or flowing pressure applied to sprinkler system components exclusive of surge pressures.

3.3.8 Pump. A mechanical device that transfers or raises, or transfers and raises, the pressure of a fluid (water).

3.3.9* Shadow Area. The dry floor area within the protection area of a sprinkler created by the portion of sprinkler discharge that is blocked by a wall or partition.

3.3.10 Sprinkler.

3.3.10.1 Automatic Sprinkler. A fire suppression or control device that operates automatically when its heat-actuated element is heated to its thermal rating or above, allowing water to discharge over a specific area.

3.3.10.2 Residential Sprinkler. A type of fast-response sprinkler having a thermal element with an RTI of 50 (meters-seconds)^{1/2} or less, that has been specifically investigated for its ability to enhance survivability in the room of fire origin, and that is listed for use in the protection of dwelling units.

3.3.11 Sprinkler Systems.

3.3.11.1 Antifreeze Sprinkler System. A wet pipe system using automatic sprinklers that contains a liquid solution to prevent freezing of the system, intended to discharge the solution upon sprinkler operation, followed immediately by water from a water supply.

3.3.11.2 Dry Pipe Sprinkler System. A sprinkler system employing automatic sprinklers that are attached to a piping system containing air or nitrogen under pressure, the release of which (as from the opening of a sprinkler) permits the water pressure to open a valve known as a dry pipe valve, and the water then flows into the piping system and out the opened sprinkler.

3.3.11.3* Multipurpose Piping Sprinkler System. A piping system intended to serve both domestic needs in excess of a single fixture and fire protection needs from one common piping system throughout the dwelling unit(s).

3.3.11.4* Network Sprinkler System. A type of multipurpose system utilizing a common piping system supplying domestic fixtures and fire sprinklers where each sprinkler is supplied by a minimum of three separate paths.

3.3.11.5* Passive Purge Sprinkler System. A type of sprinkler system that serves a single toilet in addition to the fire sprinklers.

3.3.11.6 Preaction Sprinkler System. A sprinkler system employing automatic sprinklers that are attached to a piping system that contains air that might or might not be under pressure, with a supplemental detection system installed in the same areas as the sprinklers.

3.3.11.7 Pre-Engineered Sprinkler System. A packaged sprinkler system including all components connected to the water supply and designed to be installed according to pre-tested limitations.

3.3.11.8 Sprinkler System. For fire protection purposes, an integrated system of underground and overhead piping designed in accordance with fire protection engineering standards. The installation includes one or more automatic water supplies. The portion of the sprinkler system aboveground is a network of specially sized or hydraulically designed piping installed in a building, structure, or area, generally overhead, and to which sprinklers are attached in a systematic pattern. The system is usually activated by heat from a fire and discharges water over the fire area.

3.3.11.9* Stand-Alone Sprinkler System. A sprinkler system where the aboveground piping serves only fire sprinklers.

3.3.11.10 Wet Pipe Sprinkler System. A sprinkler system employing automatic sprinklers attached to a piping system containing water and connected to a water supply so that water discharges immediately from sprinklers opened by heat from a fire.

3.3.12 Townhouse. A one-family dwelling constructed in attached groups of three or more units in which each unit extends from the foundation to the roof and has open space on at least two sides. [5000, 2012]

3.3.13 Valve.

3.3.13.1 Check Valve. A valve that allows flow in one direction only.

3.3.13.2* Control Valve. An indicating valve employed to control (shut) a supply of water to a sprinkler system.

3.3.14 Waterflow Alarm. A sounding device activated by a waterflow detector or alarm check valve.

3.3.15 Waterflow Detector. An electric signaling indicator or alarm check valve actuated by water flow in one direction only.

Chapter 4 General Requirements

4.1 Sprinkler Temperature Ratings.

4.1.1 Sprinklers having a temperature rating of 135°F to 170°F (57°C to 77°C) shall be classified as ordinary temperature-rated sprinklers.

4.1.2 Sprinklers having a temperature rating of 175°F to 225°F (79°C to 107°C) shall be classified as intermediate temperature-rated sprinklers.

4.2 Tube. Wherever the word *pipe* is used in this standard, it shall also mean *tube*.

4.3 Listed or Labeled. Listed or labeled devices and materials shall be installed and used in accordance with the listing limitations and the manufacturers' instructions unless permitted by other sections of this document.

4.4 Smoke Alarms. Smoke alarms shall be provided in accordance with NFPA 72.

4.5* Documentation. Documentation shall be available upon request to ensure adequate water supply, listed devices, and adequate sprinkler coverage have been addressed.

4.6 Qualifications. The layout, calculation, and installation of sprinkler systems installed in accordance with this standard shall only be performed by people knowledgeable and trained in such systems.

Chapter 5 System Components

5.1 General.

5.1.1* Only new sprinklers shall be installed in sprinkler systems.

5.1.1.1 Spare sprinklers shall not be required to be provided.

5.1.2 Devices and materials used in sprinkler systems shall be listed unless permitted not to be listed by 5.1.3.

5.1.3 Tanks, expansion tanks, pumps, hangers, waterflow detection devices, and waterflow valves shall not be required to be listed.

5.2 Aboveground Pipe and Equipment.

5.2.1 Listed residential sprinklers installed in systems complying with 5.2.2.3, 5.2.2.4, 5.2.5.3, or 5.2.5.4 shall be permitted to have a minimum pressure rating of 130 psi (8.9 bar).

5.2.2* Pipe or tube used in sprinkler systems shall be of the materials specified in Table 5.2.2 or shall be in accordance with 5.2.3.

5.2.2.1 The chemical properties, physical properties, and dimensions of pipe materials shall be at least equivalent to the standards cited in Table 5.2.2.

5.2.2.2* Pipe used in sprinkler systems other than those addressed in 5.2.2.3 or 5.2.2.4 shall be designed to withstand a working pressure of not less than 175 psi (12.1 bar).

5.2.2.3 Nonmetallic pipe used in multipurpose piping systems and passive purge systems not equipped with a fire department connection shall be designed to withstand a working pressure of not less than 130 psi (8.9 bar) at 120°F (49°C).

5.2.2.4 Nonmetallic pipe used in wet pipe sprinkler systems not equipped with a fire department connection and provided with a pressure-reducing valve set no higher than 80 psi (5.5 bar) shall be designed to withstand a working pressure of not less than 130 psi (8.9 bar) at 120°F (49°C) and 100 psi (6.9 bar) at 180°F (82.2°C).

5.2.2.4.1 If the maximum static pressure from the water supply is less than or equal to 80 psi (5.5 bar), pipe designed to withstand a working pressure of not less than 130 psi (8.9 bar) at 120°F (49°C) and 100 psi (6.9 bar) at 180°F (82.2°C) shall be permitted to be used without a pressure-reducing valve.

Table 5.2.2 Pipe or Tube Materials and Dimensions

Materials and Dimensions	Standard
Standard Specification for Black and Hot-Dipped Zinc-Coated (Galvanized) Welded and Seamless Steel Pipe for Fire Protection Use	ASTM A 795
Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless	ASTM A 53
Welded and Seamless Wrought Steel Pipe	ANSI B36.10M
Standard Specification for Electric-Resistance-Welded Steel Pipe	ASTM A 135
Standard Specification for Seamless Copper Tube [Copper Tube (Drawn, Seamless)]	ASTM B 75
Standard Specification for Seamless Copper Water Tube	ASTM B 88
Standard Specification for General Requirements for Wrought Seamless Copper and Copper-Alloy Tube	ASTM B 251
Standard Specification for Liquid and Paste Fluxes for Soldering Applications of Copper and Copper-Alloy Tube	ASTM B 813
Specification for Filler Metals for Brazing and Braze Welding (BCuP, copper-phosphorus, or copper-phosphorus-silver brazing filler metal)	AWS A5.8
Standard Specification for Solder Metal [alloy grades containing less than 0.2 percent lead as identified in ASTM B 32, Table 5, Section 1, and having a solidus temperature that exceeds 400°F (204°C)]	ASTM B 32
Standard Specification for Seamless Red Brass Pipe	ASTM B 43

5.2.2.4.2 If a pressure-reducing valve is used to comply with 5.2.2.4, an automatic means of pressure relief shall be installed on the sprinkler system side of the pressure-reducing valve.

5.2.3 Types of pipe other than those specified in Table 5.2.2 shall be permitted to be used where listed for sprinkler system use.

5.2.3.1 Pipe differing from those specified in Table 5.2.2 shall be installed in accordance with their listings and the manufacturers' installation instructions.

5.2.3.2* Chlorinated polyvinyl chloride (CPVC) pipe and crosslinked polyethylene (PEX) pipe shall comply with the portions of the American Society for Testing and Materials (ASTM) standards specified in Table 5.2.3.2 that apply to fire protection service.

5.2.4 Schedule 10 steel pipe shall be permitted to be joined with mechanical groove couplings approved for service.

5.2.4.1 Where mechanical groove couplings are used to join pipe, grooves shall be rolled on the pipe by an approved groove-rolling machine.

Table 5.2.3.2 Specifically Listed Pipe or Tube Materials and Dimensions

Materials and Dimensions	Standard
<i>Nonmetallic Piping:</i>	
Standard Specification for Chlorinated Poly (Vinyl Chloride) (CPVC) Pipe	ASTM F 442
Standard Specification for Crosslinked Polyethylene (PEX) Tubing	ASTM F 876

5.2.5 Fittings used in sprinkler systems shall be of the materials listed in Table 5.2.5 or shall be in accordance with 5.2.9.

Table 5.2.5 Fitting Materials and Dimensions

Materials and Dimensions	Standard
<i>Cast Iron:</i>	
Gray Iron Threaded Fittings	ASME B16.4
Gray Iron Pipe Flanges and Flanged Fittings	ASME B16.1
<i>Malleable Iron:</i>	
Malleable Iron Threaded Fittings	ASME B16.3
<i>Steel:</i>	
Factory-Made Wrought Butt welding Fittings	ASME B16.9
Buttwelding Ends	ASME B16.25
Standard Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High Temperature Service	ASTM A 234
Pipe Flanges and Flanged Fittings	ASME B16.5
Forged Fittings, Socket-Welding and Threaded	ASME B16.11
<i>Copper:</i>	
Wrought Copper and Copper Alloy Solder Joint Pressure Fittings	ASME B16.22
Cast Copper Alloy Solder Joint Pressure Fittings	ASME B16.18
Cast Bronze Threaded Fittings	ANSI/ASME B16.15

5.2.5.1 The chemical properties, physical properties, and dimensions of fitting materials shall be at least equivalent to the standards cited in Table 5.2.5.

5.2.5.2 Fittings used in sprinkler systems other than those addressed in 5.2.5.3 or 5.2.5.4 shall be designed to withstand a working pressure of not less than 175 psi (12.1 bar).

5.2.5.3 Nonmetallic fittings used in multipurpose piping systems and passive purge systems not equipped with a fire department connection shall be designed to withstand a working pressure of not less than 130 psi (8.9 bar) at 120°F (49°C).

5.2.5.4 Nonmetallic fittings used in wet pipe sprinkler systems not equipped with a fire department connection and provided with a pressure-reducing valve set no higher than 80 psi (5.5 bar) shall be designed to withstand a working pressure of not less than 130 psi (8.9 bar) at 120°F (49°C) and 100 psi (6.9 bar) at 180°F (82.2°C).

5.2.5.4.1 If the maximum static pressure from the water supply is less than or equal to 80 psi (5.5 bar), fittings designed to withstand a working pressure of not less than 130 psi (8.9 bar) at 120°F (49°C) and 100 psi (6.9 bar) at 180°F (82.2°C) shall be permitted to be used without a pressure-reducing valve.

5.2.5.4.2 If a pressure-reducing valve is used to comply with 5.2.5.4, an automatic means of pressure relief shall be installed on the sprinkler system side of the pressure-reducing valve.

5.2.6 Joints for the connection of copper tube shall be brazed on dry pipe and preaction systems.

5.2.7 Joints for the connection of copper tube for wet pipe systems and antifreeze systems shall be solder joints or be brazed.

5.2.8 Solder joints, where permitted, shall be fabricated in accordance with the methods and procedures listed in ASTM B 828, *Standard Practice for Making Capillary Joints by Soldering of Copper and Copper Alloy Tube and Fittings*.

5.2.9 Types of fittings other than those specified in Table 5.2.5 shall be permitted to be used where listed for sprinkler system use.

5.2.9.1 Fittings differing from those specified in Table 5.2.5 shall be installed in accordance with their listings and the manufacturers' installation instructions.

5.2.9.2* CPVC fittings shall comply with the portions of the ASTM standards specified in Table 5.2.9.2 that apply to fire protection service.

Table 5.2.9.2 Specifically Listed Fittings Materials and Dimensions

Materials and Dimensions	Standard
Standard Specification for Threaded Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80	ASTM F 437
Standard Specification for Socket-Type Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 40	ASTM F 438
Standard Specification for Socket-Type Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80	ASTM F 439

5.2.10 Other joining methods investigated for suitability in automatic sprinkler installations and listed for this service shall be permitted.

5.3* Underground Pipe. Any type of pipe or tube acceptable under the applicable plumbing code for underground supply pipe shall be acceptable as an underground supply for a fire sprinkler system when installed between the point of connection and the system riser.

5.4 Pre-Engineered Systems. Where listed pre-engineered systems are installed, they shall be installed within the limitations that have been established by the testing laboratories.

Chapter 6 Water Supply

6.1 General Provisions.

6.1.1 Every automatic sprinkler system shall have at least one automatic water supply.

6.1.2 Where stored water is used as the sole source of supply, the minimum quantity shall equal the water demand rate times 10 minutes unless permitted otherwise by 6.1.3.

6.1.3 Where stored water is used as the sole source of supply, the minimum quantity shall be permitted to equal the two sprinkler water demand rate times 7 minutes where dwelling units meet the following criteria:

- (1) One story in height
- (2) Less than 2000 ft² (186 m²) in area

6.1.4 The stored water requirement of 6.1.2 or 6.1.3 shall be permitted to be a combination of the water in the well, including the refill rate, plus the water in the holding tank if such tank can supply the sprinkler system.

6.2* Water Supply Sources. The following water supply sources shall be considered to be acceptable by this standard:

- (1) A connection to a reliable waterworks system with or without an automatically operated pump
- (2) An elevated tank
- (3) A pressure tank designed to American Society of Mechanical Engineers (ASME) standards for a pressure vessel with a reliable pressure source
- (4) A stored water source with an automatically operated pump
- (5) A well with a pump of sufficient capacity and pressure to meet the sprinkler system demand

6.2.1 Where a pump is the source of pressure for the water supply for a fire sprinkler system but is not a portion of the domestic water system, the following shall be met:

- (1) A test connection shall be provided downstream of the pump that creates a flow of water equal to the smallest sprinkler on the system.
- (2) Pump motors using ac power shall be connected to a 240 V normal circuit.
- (3) Any disconnecting means for the pump shall be approved.
- (4) The pump shall not be permitted to sit directly on the floor.

6.2.2 Where a pump and tank is the source of supply for a fire sprinkler system but is not a portion of the domestic water system, the requirements of 6.2.1 and the following shall be met:

- (1) The test connection shall return water to the tank.
- (2) A method for refilling the tank shall be piped to the tank.
- (3) A method of determining the water level in the tank shall be provided without having to open the tank.

6.2.3* Where more than one dwelling unit is served by the same water supply pipe, each dwelling unit shall have an individual control valve that serves the fire sprinkler system in that dwelling unit and the owner shall have access to the valve that controls the sprinkler system in their unit.

6.2.3.1 The control valve shall be permitted to serve the domestic water supply.

6.2.3.2 In the situation addressed by 6.2.3, no valve controlling the sprinkler system in a unit shall be located in another unit.

6.3* Multipurpose Piping System.

6.3.1 A multipurpose piping system shall be installed in accordance with 6.3.2 through 6.5.3.

6.3.2 Multipurpose piping systems shall be approved by the local plumbing or health authority.

6.3.3 All piping in the system supplying sprinklers shall be listed and conform to the piping specifications of this standard.

6.3.3.1 Piping connected to the system that supplies only plumbing fixtures shall comply with local plumbing and health authority requirements but is not required to be listed.

Paragraph 6.5.3 was moved to 6.3.4 by a tentative interim amendment (TIA). See page 1.

6.3.4 A warning sign, with minimum $\frac{1}{4}$ in. (6 mm) letters, shall be affixed adjacent to the main shutoff valve and shall state the following:

WARNING: The water system for this home supplies fire sprinklers that require certain flows and pressures to fight a fire. Devices that restrict the flow or decrease the pressure or automatically shut off the water to the fire sprinkler system, such as water softeners, filtration systems, and automatic shutoff valves, shall not be added to this system without a review of the fire sprinkler system by a fire protection specialist. Do not remove this sign.

6.4 Manufactured Home Water Supply. For sprinklered buildings manufactured off-site, the minimum pressure needed to satisfy the system design criteria on the system side of the meter shall be specified on a data plate by the manufacturer.

6.5 Common Supply Pipes.

6.5.1 Where common supply pipes serve both fire sprinkler and domestic use, they shall comply with 6.5.2 and 6.5.3.

6.5.2 In common water supply connections serving more than one dwelling unit, 5 gpm (19 L/min) shall be added to the sprinkler system demand to determine the size of common piping and the size of the total water supply requirements where no provision is made to prevent flow into the domestic water system upon operation of a sprinkler.

6.5.3 Where water treatment and filtration are installed, one of the following conditions shall be met:

- (1) The flow restriction and pressure loss through the water treatment equipment shall be taken into account in the hydraulic calculations.
- (2) An automatic bypass shall be installed around the water treatment equipment that directs all water directly to the system.

Chapter 7 Installation

7.1 Valves.

7.1.1 A single control valve arranged to shut off both the domestic system and the sprinkler system shall be installed unless a separate shutoff valve for the sprinkler system is installed in accordance with 7.1.2.

7.1.2 The sprinkler system piping shall not have a separate control valve installed unless supervised by one of the following methods:

- (1) Central station, proprietary, or remote station alarm service
- (2) Local alarm service that causes the sounding of an audible signal at a constantly attended location
- (3) Valves that are locked open

7.1.3 A separate shutoff valve shall be installed for the domestic water supply in installations other than those complying with Section 6.3.

7.1.4 If provided, a backflow prevention assembly that includes a shutoff valve shall be considered a control valve, and an additional control valve shall not be required.

7.2 Drains and Test Connections.

7.2.1 Each sprinkler system shall have a minimum $\frac{1}{2}$ in. (13 mm) drain on the system side of the control valve.

7.2.2 A valve shall be installed in the drain piping.

7.2.3 A drain shall be installed for each trapped portion of a dry system that is subject to freezing temperatures.

7.2.4* Where waterflow alarms are provided, test connections shall be installed at locations that allow flow testing of water supplies, connections, and alarm mechanisms.

7.2.5 The test connections, where provided, shall contain an orifice equal to or smaller than the smallest sprinkler installed in the system.

7.2.6* Where a pressure-reducing or pressure-regulating valve is installed on a stand alone system, a pressure gauge and a test connection with an orifice at least as large as the smallest orifice sprinkler on the system shall be installed downstream of the device.

7.3 Pressure Gauges.

7.3.1 Where a dry system is installed, a pressure gauge shall be installed to indicate system air pressure.

7.3.2 Where a pressure tank is used for the water supply, a pressure gauge shall be installed to indicate tank pressure.

7.4 Piping Support.

7.4.1 Listed pipe shall be supported in accordance with any listing limitations.

7.4.2 Pipe that is not listed, and listed pipe with listing limitations that do not include piping support requirements, shall be supported from structural members using support methods comparable to those required by applicable local plumbing codes.

7.4.3 Piping laid on open joists or rafters shall be supported in a manner that prevents lateral movement.

7.4.4* Sprinkler piping shall be supported in a manner that prevents the movement of piping upon sprinkler operation.

7.5 Sprinklers.

7.5.1* Listed residential sprinklers shall be used unless another type is permitted by 7.5.3, 7.5.4, or 7.5.5.

7.5.2 Residential sprinklers shall not be used on systems other than wet pipe systems unless specifically listed for use on that particular type of system.

7.5.3 Listed residential or quick-response standard spray dry pendent or dry sidewall sprinklers shall be permitted to be extended into unheated areas not intended for living purposes.

7.5.4 Quick-response sprinklers shall be permitted to be used in mechanical closets.

7.5.5* Quick-response spray sprinklers shall be permitted to be used in saunas and steam rooms in accordance with 7.5.6.3(4).

7.5.6 Temperature Ratings.

7.5.6.1 Sprinklers installed where maximum ambient ceiling temperatures do not exceed 100°F (38°C) shall be ordinary temperature-rated or intermediate-temperature rated sprinklers throughout unless modified by the requirements of 7.5.6.3.

7.5.6.2 Sprinklers installed where maximum ambient ceiling temperatures are between 101°F and 150°F (39°C and 66°C) shall be intermediate temperature-rated sprinklers unless modified by 7.5.6.3.

7.5.6.3* The following practices shall be observed when installing residential sprinklers unless higher expected ambient temperatures require a higher temperature rating:

- (1) Sprinklers under glass or plastic skylights exposed to direct rays of the sun shall be of intermediate temperature classification.
- (2) Sprinklers in an unventilated concealed space under an uninsulated roof or in an unventilated attic shall be of intermediate temperature classification.
- (3) Sprinklers installed near specific heat sources that are identified in Table 7.5.6.3 shall be of the temperature rating indicated in Table 7.5.6.3 unless sprinklers are listed for positioning closer to the heat source.
- (4) Sprinklers installed in saunas and steam rooms where the maximum ambient ceiling temperatures are between 151°F and 225°F (67°C to 107°C) shall be high temperature-rated spray sprinklers.

7.5.7* Painting and Ornamental Finishes. Sprinklers shall not be painted or enameled unless applied by the manufacturer and the sprinkler has been listed with such finishes.

7.5.8 Escutcheon Plates. Where nonmetallic sprinkler ceiling plates (escutcheons) or recessed escutcheons (metallic or nonmetallic) are used, they shall be listed based on testing of the assembly as a residential sprinkler.

7.5.9 Solvent Cement. Where solvent cement is used as the pipe and fittings bonding agent, sprinklers shall not be installed in the fittings prior to the fittings being cemented in place.

7.6* Alarms. Local waterflow alarms shall be provided on all sprinkler systems in homes not equipped with smoke alarms or smoke detectors in accordance with NFPA 72, *National Fire Alarm and Signaling Code*.

7.7 Attics. When nonmetallic piping is installed in attics, adequate insulation shall be provided on the attic side of the piping to avoid exposure of the piping to temperatures in excess of the pipe's rated temperature.

Table 7.5.6.3 Minimum Distances for Ordinary and Intermediate Temperature Residential Sprinklers

Heat Source	From Edge of Source to Ordinary Temperature Sprinkler		From Edge of Source to Intermediate Temperature Sprinkler	
	in.	mm	in.	mm
Side of open or recessed fireplace	36	914	12	305
Front of recessed fireplace	60	1524	36	914
Coal- or wood-burning stove	42	1067	12	305
Kitchen range	18	457	9	229
Wall oven	18	457	9	229
Hot air flues	18	457	9	229
Uninsulated heat ducts	18	457	9	229
Uninsulated hot water pipes	12	305	6	152
Side of ceiling- or wall-mounted hot air diffusers	24	610	12	305
Front of wall-mounted hot air diffusers	36	914	18	457
Hot water heater or furnace	6	152	3	76
Light fixture				
0 W–250 W	6	152	3	76
250 W–499 W	12	305	6	152

Chapter 8 Sprinkler Position and Location

8.1 Design Criteria.

8.1.1 Sloped Ceilings.

8.1.1.1 Where the ceiling is sloped, the maximum *S* dimension shall be measured along the slope of the ceiling to the next sprinkler, as shown in Figure 8.1.1.1.

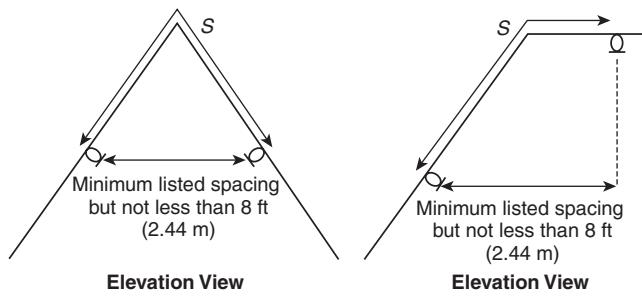


FIGURE 8.1.1.1 Measuring *S* Dimension.

8.1.1.2 The sprinklers shall maintain the minimum listed spacing, but no less than 8 ft (2.44 m), measured in the plan view from one sprinkler to another, as shown in Figure 8.1.1.1.

8.1.2 Nonresidential Sprinklers. Sprinklers other than residential sprinklers shall be installed in accordance with the coverage criteria specified by NFPA 13.

8.1.3 Sprinkler Coverage.

8.1.3.1 Residential Sprinklers.

8.1.3.1.1 Sprinklers shall be installed in accordance with their listing where the type of ceiling configuration is referenced in the listing.

8.1.3.1.2* Where construction features or other special conditions exist that are outside the scope of sprinkler listings, listed sprinklers shall be permitted to be installed beyond their listing limitations.

8.1.4 Operating Pressure. The minimum operating pressure of any sprinkler shall be the higher of the minimum operating pressure specified by the listing or 7 psi (0.5 bar).

8.2 Position of Sprinklers.

8.2.1 Residential Pendant and Upright Sprinklers.

8.2.1.1 Pendant and upright sprinklers that have not been listed with specific positioning criteria shall be positioned so that the deflectors are within 1 in. to 4 in. (25.4 mm to 102 mm) from the ceiling unless otherwise permitted by 8.2.1.3.

8.2.1.2 Pendant and upright sprinklers that have been listed with specific positioning criteria shall be positioned in accordance with their listing unless permitted otherwise by 8.2.1.3.

8.2.1.3 Pendant and upright sprinklers in closets shall be permitted to be installed within 12 in. (305 mm) of the ceiling in order to avoid obstructions near the ceiling.

8.2.2 Residential Sidewall Sprinklers.

8.2.2.1 Sidewall sprinklers that have not been listed with specific positioning criteria shall be positioned so that the deflectors are within 4 in. to 6 in. (102 mm to 152 mm) from the ceiling.

8.2.2.2 Sidewall sprinklers that have been listed with specific positioning criteria shall be installed in accordance with their listing.

8.2.2.3 Residential horizontal sidewall sprinkler deflectors shall be located no more than 6 in. (152 mm) from the face of the wall or soffit on which they are mounted.

8.2.3 Nonresidential Sprinklers. Sprinklers other than residential sprinklers shall be positioned in accordance with the positioning criteria specified by NFPA 13, *Standard for the Installation of Sprinkler Systems*.

8.2.4 Basements Without Ceilings. In basements where ceilings are not required for the protection of piping or where metallic pipe is installed, residential sprinklers shall be permitted to be positioned in a manner that anticipates future installation of a finished ceiling.

8.2.5* Obstructions to Residential Sprinklers.

8.2.5.1 Closets. In all closets and compartments, including those housing mechanical equipment, that are not larger than 400 ft³ (11.3 m³) in size, a single sprinkler at the highest ceiling space shall be sufficient without regard to obstructions or minimum distances to wall.

8.2.5.2 Pendent Sprinklers.

8.2.5.2.1 Pendent sprinklers shall be located at least 3 ft (914 mm) away from obstructions such as ceiling fans and light fixtures unless the requirements of 8.2.5.4 are met.

8.2.5.2.2 The distance shall be measured from the center of the sprinkler to the center of the obstruction.

8.2.5.2.3 Where the sprinkler cannot be located 3 ft (914 mm) away from the obstruction (as measured from the center of the obstruction), an additional sprinkler shall be located on the other side of the obstruction.

8.2.5.2.4 Where the area of the fan blades encompass more than 50 percent of the area of the plan view, the sprinkler shall be installed in accordance with 8.2.5.4.

8.2.5.3 Sidewall Sprinklers.

8.2.5.3.1 Sidewall sprinklers shall be located at least 5 ft (1.52 m) away from obstructions such as ceiling fans and light fixtures unless the requirements of 8.2.5.5 are met.

8.2.5.3.2 The distance shall be measured from the center of the sprinkler to the center of the obstruction.

8.2.5.3.3 Where the sprinkler cannot be located 5 ft (1.52 m) away from the obstruction (as measured to the center of the obstruction), an additional sprinkler shall be installed on the other side of the obstruction.

8.2.5.3.4 Where the area of the fan blades encompasses more than 50 percent of the area of the plan view, the sprinkler shall be installed in accordance with 8.2.5.5.

8.2.5.4 Continuous Obstructions to Pendent Sprinklers.

8.2.5.4.1 Sprinklers shall be positioned with respect to continuous obstructions in accordance with 8.2.5.4.2, 8.2.5.4.3, or 8.2.5.4.4.

8.2.5.4.2 Sprinklers shall be positioned with respect to continuous obstructions in accordance with Table 8.2.5.4.2 and Figure 8.2.5.4.2.

Table 8.2.5.4.2 Positioning of Sprinklers to Avoid Obstructions to Discharge (Residential Upright and Pendent Spray Sprinklers)

Distance from Sprinklers to Side of Obstruction (A)	Maximum Allowable Distance of Deflector Above Bottom of Obstruction (in.) (B)
Less than 1 ft	0
1 ft to less than 1 ft 6 in.	0
1 ft 6 in. to less than 2 ft	1
2 ft to less than 2 ft 6 in.	1
2 ft 6 in. to less than 3 ft	1
3 ft to less than 3 ft 6 in.	3
3 ft 6 in. to less than 4 ft	3
4 ft to less than 4 ft 6 in.	5
4 ft 6 in. to less than 5 ft	7
5 ft to less than 5 ft 6 in.	7
5 ft 6 in. to less than 6 ft	7
6 ft to less than 6 ft 6 in.	9
6 ft 6 in. to less than 7 ft	11
7 ft and greater	14

For SI units, 1 in. = 25.4 mm; 1 ft = 0.3048 m.

Note: For A and B, refer to Figure 8.2.5.4.2.

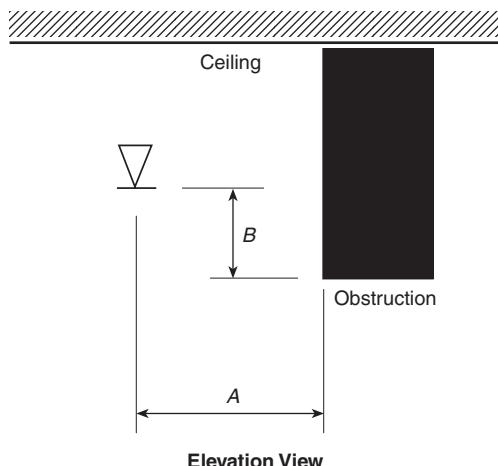


FIGURE 8.2.5.4.2 Positioning of Sprinkler to Avoid Obstruction to Discharge (Residential Upright and Pendent Spray Sprinklers).

8.2.5.4.3 Sprinklers shall be positioned with respect to an obstruction against a wall in accordance with Figure 8.2.5.4.3.

8.2.5.4.4 A sprinkler shall be installed on the other side of the obstruction.

8.2.5.5 Continuous Obstructions to Sidewall Sprinklers.

8.2.5.5.1 Sprinklers shall be positioned with respect to continuous obstructions in accordance with 8.2.5.5.2 or 8.2.5.5.3.

8.2.5.5.2 Sprinklers shall be positioned with respect to continuous obstructions in accordance with Table 8.2.5.5.2(a), Figure 8.2.5.5.2(a), Table 8.2.5.5.2(b), and Figure 8.2.5.5.2(b).

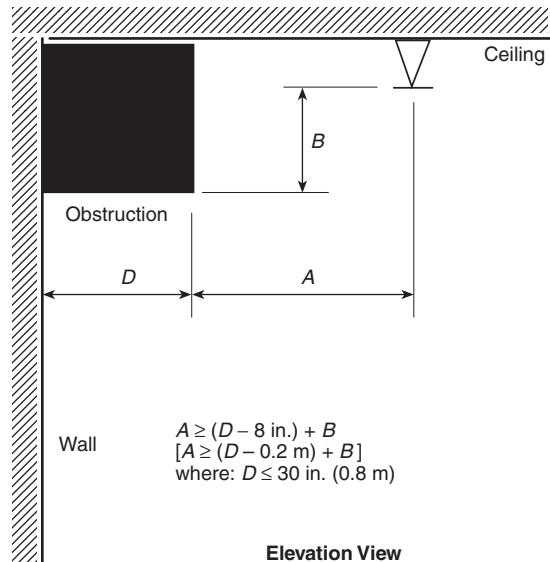


FIGURE 8.2.5.4.3 Positioning of Sprinkler to Avoid Obstruction Against Walls (Residential Upright and Pendent Spray Sprinklers).

Table 8.2.5.5.2(a) Positioning of Sprinklers to Avoid Obstructions (Residential Sidewall Sprinklers)

Distance from Sidewall Sprinkler to Side of Obstruction (A)	Maximum Allowable Distance of Deflector Above Bottom of Obstruction (in.) (B)
Less than 8 ft	Not allowed
8 ft to less than 10 ft	1
10 ft to less than 11 ft	2
11 ft to less than 12 ft	3
12 ft to less than 13 ft	4
13 ft to less than 14 ft	6
14 ft to less than 15 ft	7
15 ft to less than 16 ft	9
16 ft to less than 17 ft	11
17 ft or greater	14

For SI units, 1 in. = 25.4 mm; 1 ft = 0.3048 m.

Note: For A and B, refer to Figure 8.2.5.5.2(a).

8.2.5.5.3 A sprinkler shall be installed on the other side of the obstruction.

8.2.5.6 Soffits and Cabinets. Where soffits are used for the installation of sidewall sprinklers, the sprinklers and soffits shall be installed in accordance with 8.2.5.6.1, 8.2.5.6.2, or 8.2.5.6.3.

8.2.5.6.1 Where soffits exceed more than 8 in. (203 mm) in width or projection from the wall, sprinklers shall be installed under the soffit.

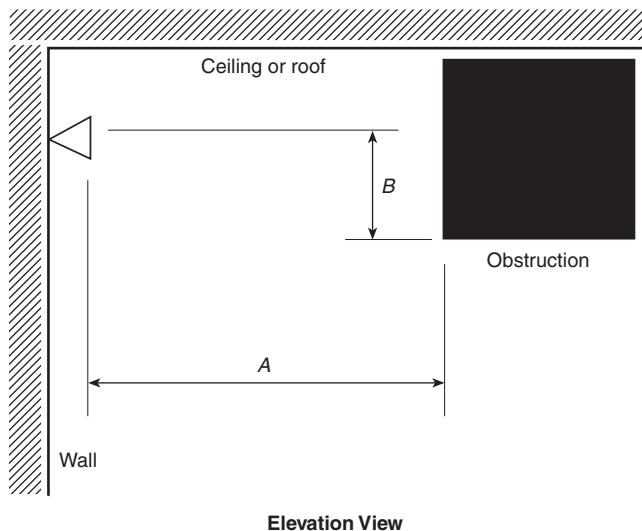
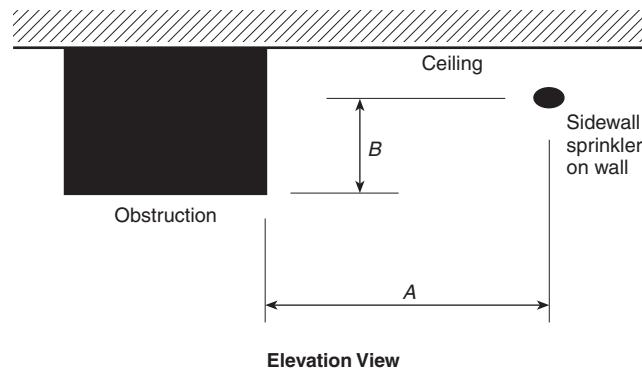
8.2.5.6.2 Sidewall sprinklers shall be permitted to be installed in the face of a soffit located directly over cabinets, without requiring additional sprinklers below the soffit or cabinets, where the soffit does not project horizontally more than 12 in. (305 mm) from the wall.

Table 8.2.5.5.2(b) Positioning of Sprinklers to Avoid Obstructions Along Wall (Residential Sidewall Sprinklers)

Distance from Sidewall Sprinkler to Side of Obstruction (A)	Maximum Allowable Distance of Deflector Above Bottom of Obstruction (in.) (B)
Less than 1 ft 6 in.	0
1 ft 6 in. to less than 3 ft	1
3 ft to less than 4 ft	3
4 ft to less than 4 ft 6 in.	5
4 ft 6 in. to less than 6 ft	7
6 ft to less than 6 ft 6 in.	9
6 ft 6 in. to less than 7 ft	11
7 ft to less than 7 ft 6 in.	14

For SI units, 1 in. = 25.4 mm; 1 ft = 0.3048 m.

Note: For A and B, refer to Figure 8.2.5.5.2(b).

**FIGURE 8.2.5.5.2(a) Positioning of Sprinkler to Avoid Obstruction (Residential Sidewall Sprinklers).****FIGURE 8.2.5.5.2(b) Positioning of Sprinkler to Avoid Obstruction Along Wall (Residential Sidewall Sprinklers).**

8.2.5.6.3 Where sidewall sprinklers are more than 3 ft (0.91 m) above the top of cabinets, the sprinkler shall be permitted to be installed on the wall above the cabinets where the cabinets are no greater than 12 in. (305 mm) from the wall.

8.2.5.7* Shadow Areas. Shadow areas shall be permitted in the protection area of a sprinkler as long as the cumulative dry areas do not exceed 15 ft² (1.4 m²) per sprinkler.

8.2.6* Exposed Barrel Lengths for Dry Sprinklers.

8.2.6.1 Where dry sprinklers are connected to wet pipe sprinkler systems protecting areas subject to freezing temperatures, the minimum exposed length of the barrel of the dry sprinkler shall be in accordance with Table 8.2.6.1(a) or Table 8.2.6.1(b).

Table 8.2.6.1(a) Exposed Barrel Lengths for Dry Sprinklers (U.S. Customary Units)

Ambient Temperature Exposed to Discharge End of Sprinkler (°F)	Minimum Exposed Barrel Length when Exposed to 40°F (in.)	Minimum Exposed Barrel Length when Exposed to 50°F (in.)	Minimum Exposed Barrel Length when Exposed to 60°F (in.)
40	0	0	0
30	0	0	0
20	4	0	0
10	8	1	0
0	12	3	0
-10	14	4	1
-20	14	6	3
-30	16	8	4
-40	18	8	4
-50	20	10	6
-60	20	10	6

Table 8.2.6.1(b) Exposed Barrel Lengths for Dry Sprinklers (Metric Units)

Ambient Temperature Exposed to Discharge End of Sprinkler (°C)	Minimum Exposed Barrel Length when Exposed to 4.4°C (mm)	Minimum Exposed Barrel Length when Exposed to 10°C (mm)	Minimum Exposed Barrel Length when Exposed to 15.6°C (mm)
4.4	0	0	0
-1	0	0	0
-6.7	102	0	0
-12.2	203	25	0
-17.8	305	76	0
-23.3	356	102	25
-28.9	356	152	76
-34.4	406	203	102
-40	457	203	102
-45.6	508	254	152
-51.1	508	254	152

8.2.6.2 The minimum barrel length shall be measured from the face of the fitting to which the dry sprinkler is installed to the inside surface of the insulation, wall, or ceiling leading to the cold space, whichever is closer to the fitting.

8.3 Location of Sprinklers.

8.3.1 Sprinklers shall be installed in all areas except where omission is permitted by 8.3.2 through 8.3.8.

8.3.2 Sprinklers shall not be required in bathrooms of 55 ft² (5.1 m²) and less.

8.3.3 Sprinklers shall not be required in clothes closets, linen closets, and pantries that meet all of the following conditions:

- (1) The area of the space does not exceed 24 ft² (2.2 m²).
- (2) The shortest dimension does not exceed 3 ft (0.9 m).
- (3) The walls and ceilings are surfaced with noncombustible or limited-combustible materials as defined in NFPA 220.

8.3.4* Sprinklers shall not be required in garages, open attached porches, carports, and similar structures.

8.3.5 Sprinklers shall not be required in attics with or without storage, penthouse equipment rooms, elevator machine rooms, concealed spaces dedicated exclusively to and containing only dwelling unit ventilation equipment, floor/ceiling spaces, elevator shafts, crawl spaces, and other concealed spaces that are not used or intended for living purposes.

8.3.5.1 Such spaces that contain fuel-fired equipment shall also comply with 8.3.5.1.1 or 8.3.5.1.2.

8.3.5.1.1 Where the fuel-fired equipment is above all of the occupied areas of the dwelling unit, no sprinkler protection shall be required in the concealed space.

8.3.5.1.2 Where fuel-fired equipment is below or on the same level as occupied areas of the dwelling unit, at least one quick-response intermediate temperature sprinkler shall be installed above the equipment or at the wall separating the space with the fuel-fired equipment from the occupied space.

8.3.6 Sprinklers shall not be required in covered, unheated projections of the building at entrances/exits as long as the dwelling unit has another means of egress.

8.3.7 Sprinklers shall not be required for ceiling pockets that meet the following conditions:

- (1) The total volume of all unprotected ceiling pockets in a compartment does not exceed 100 ft³ (2.83 m³).
- (2) The entire floor under the unprotected ceiling pocket is protected by the sprinklers at the lower ceiling elevation.
- (3)*The interior finish of the unprotected ceiling pocket excluding decorative treatments is noncombustible or limited-combustible material.
- (4) Skylights not exceeding 32 ft² (2.97 m²) shall be permitted to have a plastic cover.

8.3.8 Sprinklers shall not be required in closets in garages and exterior closets (regardless of size) located on exterior balconies, exterior breezeways/corridors, or accessed from outdoors where the closet does not have doors or unprotected penetrations directly into the dwelling unit.

8.3.9 Sprinklers shall be installed in any closet used for heating and/or air-conditioning equipment, washers and/or dryers, or water heaters except as allowed by 8.3.8.

Chapter 9 Protection from Freezing

9.1 System Types. Systems shall be permitted to be wet pipe, dry pipe, or preaction.

9.1.1* Wet Pipe Systems in Areas Above 40°F (4°C). A wet pipe system shall be permitted to be used where all piping is installed in areas maintained above 40°F (4°C), including areas properly insulated to maintain 40°F (4°C).

9.1.2 Systems in Areas Below 40°F (4°C) Where system piping is located in areas not maintained above 40°F (4°C), the pipe shall be protected against freezing by use of one of the following methods:

- (1) Dry pipe system and preaction systems in accordance with Section 9.3
- (2) Antifreeze system in accordance with Section 9.2
- (3) Listed standard dry pendent or dry sidewall sprinklers extended from pipe in heated areas into unheated areas not intended for living purposes
- (4)*Listed heat tracing provided that it is installed and insulated in accordance with manufacturer's instructions, specifically heat tracing used on branch lines is listed for branch lines of fire sprinkler systems
- (5) Listed residential dry pendent or dry sidewall sprinklers extended from pipe in heated areas into unheated areas

Section 9.2 was revised by a tentative interim amendment (TIA). See page 1.

9.2* Antifreeze Systems.

9.2.1* Conformity with Health Regulations. The use of antifreeze solutions shall be in conformity with any state or local health regulations.

9.2.2* Antifreeze Solutions.

9.2.2.1 Except as permitted in 9.2.2.3, antifreeze solutions shall be listed for use in new sprinkler systems.

9.2.2.1.1 For existing systems, antifreeze solutions shall be limited to premixed antifreeze solutions of glycerine (chemically pure or United States Pharmacopoeia 96.5 percent) at a maximum concentration of 50 percent by volume, propylene glycol at a maximum concentration of 40 percent by volume, or other solutions listed specifically for use in fire protection systems.

9.2.2.2* Premixed solutions of glycerine (chemically pure or United States Pharmacopoeia 96.5 percent at a maximum concentration of 48 percent by volume or propylene glycol at a maximum concentration of 38 percent by volume shall be permitted to protect piping that is supplying sprinklers in a specific area of the dwelling unit, where acceptable to the authority having authority.

9.2.2.2.1* Documentation shall be presented to the AHJ to substantiate the use of the antifreeze solution.


9.2.2.3 The concentration of antifreeze solutions shall be limited to the minimum necessary for the anticipated minimum temperature.

9.2.2.4* The specific gravity of the antifreeze solution shall be checked by a hydrometer with a scale having 0.002 subdivisions.

9.2.3* Arrangement of Supply Piping and Valves.

9.2.3.1 Connections Between Antifreeze System and Wet Pipe System with No Backflow Prevention Device.

9.2.3.1.1 A 5 ft (1.5 m) drop pipe, or U-loop, shall be installed in the connection between the antifreeze system and the wet pipe system as illustrated in Figure 9.2.3.1.1.

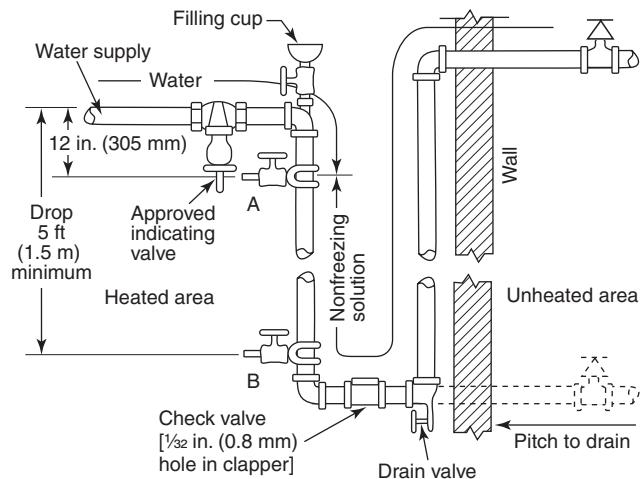

Notes:

1. Check valve shall be permitted to be omitted where sprinklers are below the level of valve A.
2. The $\frac{1}{32}$ in. (0.8 mm) hole in the check valve clapper is needed to allow for expansion of the solution during a temperature rise, thus preventing damage to sprinklers.

FIGURE 9.2.3.1.1 Arrangement of Supply Piping and Valves.

9.2.3.1.2 If sprinklers are above the level of the water supply to the antifreeze system, a check valve with a $\frac{1}{32}$ in. (0.8 mm) hole in the clapper shall be provided in the U-loop.

9.2.3.1.3 Valves shall be provided as illustrated in Figure 9.2.3.1.1.

9.2.3.1.4 Arrangement of supply piping when the water supply comes from a storage tank or the water supply feeds through a check valve that does not have a $\frac{1}{32}$ in. (0.8 mm) hole drilled in the clapper shall meet the requirements of 9.2.3.2.2.

9.2.3.2* Connections Between Antifreeze System and Wet Pipe System with Backflow Prevention Device Installed.

9.2.3.2.1 Valves shall be provided as illustrated in Figure 9.2.3.2.1.

9.2.3.2.2 An expansion chamber shall be provided as illustrated in Figure 9.2.3.2.1.

9.2.3.2.3 The expansion chamber shall be sized based on the minimum and maximum volume of the antifreeze solution over the life of the system.

9.2.4 Hydrostatic Test. Where pendent sprinklers are utilized, and where a hydrostatic test shall be performed, the hydrostatic test shall be performed with water and then the water shall be completely drained before antifreeze solution is placed in the system, or the hydrostatic test shall be performed with antifreeze solution at the proper concentration for the system.

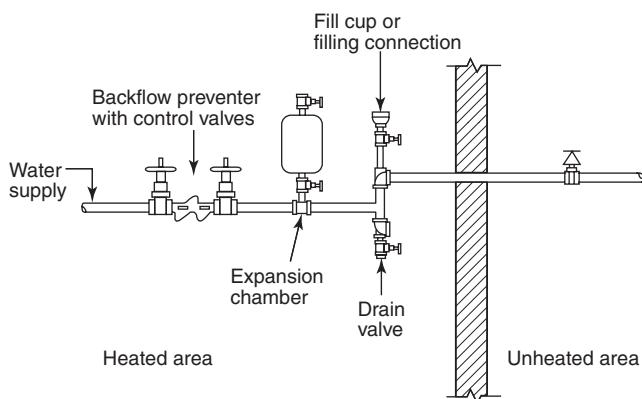


FIGURE 9.2.3.2.1 Arrangement of Supply Piping with Backflow Device.

9.2.5 Placard Information. A placard shall be placed on the antifreeze system main valve that indicates the manufacturer type and brand of antifreeze solution, the concentration of antifreeze solution used, and the volume of the antifreeze solution used in the system.

9.3 Dry Pipe and Preation Systems.

9.3.1 Sprinklers.

9.3.1.1 Sprinklers shall be specifically listed for use on dry pipe and double interlock preaction systems.

9.3.1.2 The following types of sprinklers and arrangements shall be permitted for dry pipe and preaction systems:

- (1) Residential upright sprinklers
- (2) Residential dry sprinklers
- (3) Residential pendent and sidewall sprinklers installed on return bends, where the sprinklers, return bends, and branch line piping are in an area maintained at or above 40°F (4°C)
- (4) Residential horizontal sidewall sprinklers, installed so that water is not trapped

9.3.1.3 Return bends required per 9.3.1.2(3) shall be permitted to be omitted when using potable water supplies combined with corrosion-resistant pipe.

9.3.1.4 Sprinklers with nominal K-factors greater than 4.0 and less than 5.6 shall be permitted to be installed on dry pipe systems where piping is corrosion resistant or internally galvanized.

9.3.1.5 Sprinklers with nominal K-factors of 5.6 or greater shall be permitted to be installed on pipe complying with the requirements of Section 5.2.

9.3.2 Preation Systems. Preation systems shall be one of the following types:

- (1) A single interlock system, which admits water to sprinkler piping upon operation of detection devices
- (2) A noninterlock system, which admits water to sprinkler piping upon operation of detection devices or automatic sprinklers
- (3) A double interlock system, which admits water to sprinkler piping upon operation of both detection devices and automatic sprinklers

9.3.3 Dry Pipe and Double Interlock Preaction System Water Delivery.

9.3.3.1 Water delivery shall be based on the hazard shown in Table 9.3.3.1.

Table 9.3.3.1 Water Delivery Time for Dry Pipe and Double Interlock Preaction Systems

Hazard	Number of Most Remote Sprinklers Initially Open	Maximum Time of Water Delivery (seconds)
Residential	1	15

9.3.3.2 Water delivery shall be based on one of the following:

- (1) Calculation program and method that shall be listed by a nationally recognized laboratory
- (2) An inspector's test connection providing a flow equivalent to the smallest orifice sprinkler utilized, wherein the test orifice is located on the end of the most distant sprinkler pipe

9.3.4 Location and Protection of Dry Pipe and Preaction Valves. The dry pipe valve, preaction valve, and supply pipe shall be protected against freezing and mechanical injury.

9.3.5* Detection Devices.

9.3.5.1 The detection system shall be designed to operate sooner than the first sprinkler.

9.3.5.2 Detectors shall be installed in all areas and compartments where sprinklers are installed.

9.3.6 System Configuration. Dry pipe systems and preaction systems of the type described in 9.3.2(3) shall not be gridded.

9.3.7 Drainage. Piping shall be pitched a minimum of $\frac{1}{4}$ in. per 10 ft (6.4 mm per 3.05 m) to facilitate draining.

9.3.8 Auxiliary Drains.

9.3.8.1 Auxiliary drains shall be provided where a change in piping direction prevents drainage of system piping through the drain valve on the system side of the control valve.

9.3.8.2 At a minimum, auxiliary drains shall be a nipple and cap or plug not less than $\frac{1}{2}$ in. (12.7 mm).

9.3.9 Air Supply. The system air pressure shall be maintained by approved equipment.

Chapter 10 Discharge and Hydraulic Calculations

10.1 Design Discharge.

10.1.1* Sprinklers That Are Listed with Specific Discharge Criteria.

10.1.1.1* The system shall provide at least the flow required to produce a minimum discharge density of 0.05 gpm/ft² (2.04 mm/min) or the sprinkler listing, whichever is greater, to the design sprinklers.

10.2* Number of Design Sprinklers.

10.2.1 For each of the following situations, the number of sprinklers in the design area shall be all of the sprinklers

within a compartment, up to a maximum of two sprinklers, that require the greatest hydraulic demand:

- (1) A flat, smooth, horizontal ceiling with no beams up to a maximum of 24 ft (7.3 m) above the floor.
- (2) A flat, horizontal beamed ceiling, with a maximum ceiling height of 24 ft (7.3 m), with beams up to 14 in. (355 mm) deep with pendent sprinklers under the beams. The compartment containing the beamed ceiling shall be a maximum of 600 ft² (55 m²) in area. The highest sprinkler in the compartment shall be above all openings from the compartment into any communicating spaces.
- (3) A smooth, flat, sloped ceiling with no beams up to a maximum slope of 8 in 12. The highest portion of the ceiling shall not be more than 24 ft (7.3 m) above the floor. The highest sprinkler in the sloped portion of the ceiling shall be above all openings from the compartment containing the sloped ceiling into any communicating spaces.
- (4) A sloped ceiling with beams up to 14 in. (355 mm) deep with pendent sprinklers under the beams. The compartment containing the sloped, beamed ceiling shall be a maximum of 600 ft² (55 m²) in area. The slope of the ceiling shall be between 2 in 12 and 8 in 12. The highest portion of the ceiling shall not be more than 24 ft (7.3 m) above the floor. The highest sprinkler in the sloped portion of the ceiling shall be above all openings from the compartment containing the sloped ceiling into any communicating spaces.
- (5) A sloped ceiling with beams of any depth with sidewall or pendent sprinklers in each pocket formed by the beams. The compartment containing the sloped, beamed ceiling shall be a maximum of 600 ft² (55 m²) in area. The slope of the ceiling shall be between 2 in 12 and 8 in 12. The highest portion of the ceiling shall not be more than 24 ft (7.3 m) above the floor.

10.2.2 Listed flows associated with testing under a smooth, flat, horizontal 8 ft (2.44 m) high ceiling shall be permitted to be used for the ceiling configurations referenced in 10.2.1.

10.2.3 For situations not meeting one of the conditions in 10.2.1, residential sprinklers listed for use in specific ceiling configurations shall be permitted to be used in accordance with their listing.

10.2.4* For situations not meeting one of the conditions in 10.2.1 and 10.2.3, the number of sprinklers in the design area shall be determined in consultation with the authority having jurisdiction as appropriate for the conditions.

10.3 Piping Configurations.

10.3.1 The piping configuration shall be permitted to be looped.

10.3.2 The piping configuration shall be permitted to be gridded except where gridded systems are prohibited by Chapter 9.

10.3.3 The piping configuration shall be permitted to be straight run.

10.3.4 The piping configuration shall be permitted to be a combination of the configurations permitted in 10.3.1 through 10.3.3.

10.4 Pipe Sizing.

10.4.1 For specially listed piping products, friction loss for pipe and fittings shall be permitted to be calculated based on the manufacturer's data.

10.4.2 Minimum Pipe Size.

10.4.2.1 The minimum size of steel pipe shall be 1 in. (25.4 mm).

10.4.2.2 The minimum size of pipe other than steel pipe shall be $\frac{3}{4}$ in. (19 mm) unless smaller sizes are permitted by 10.4.2.3.

10.4.2.3* Along with listed special fittings, $\frac{1}{2}$ in. (12.7 mm) nonmetallic pipe and $\frac{1}{2}$ in. (12.7 mm) copper pipe shall be permitted to be used only in network systems under the following conditions:

- (1)*Each sprinkler shall be supplied through a minimum of three separate paths from the supply manifold.
- (2) Calculations shall clearly indicate the pipes that create the paths to each sprinkler.
- (3) A water distribution pipe that supplies a sprinkler shall not terminate in a dead end.
- (4) Hydraulic calculations shall be prepared for each sprinkler flowing individually within the system and for each pair of sprinklers within the same compartment.
- (5) The location of the most demanding single sprinkler and pair of sprinklers, including their pressure and flow requirements, shall be indicated on the plan review documents.
- (6) The system shall be hydraulically calculated in accordance with the provisions of NFPA 13, except that the friction loss straight through a fitting shall be included.
- (7) The method of joining the pipe to fittings or to other pipe shall be in accordance with the applicable plumbing code.
- (8) A maximum of one insert tee shall be permitted in each pipe section between sprinklers to serve only domestic fixtures.
- (9) When insert fittings are installed, each sprinkler shall have four separate paths from the water supply.
- (10) The piping supplying only plumbing fixtures shall be in accordance with the applicable plumbing code.

10.4.3* Unless the pipe size is in accordance with the prescriptive pipe sizing method of 10.4.9, pipe shall be sized by hydraulic calculations in accordance with the methods described in NFPA 13, in accordance with 10.4.4, or in accordance with the following general method for straight-run systems connected to a city water main of at least 4 in. (102 mm) in diameter:

- (1) The system flow rate shall be established in accordance with Sections 10.1 and 10.2, and it shall be determined that the flow allowed by the water meter meets or exceeds the system demand and that the total demand flow does not exceed the maximum flow allowed by the piping system components.

(2) The water pressure in the street shall be determined.

(3) Pipe sizes shall be selected.

(4)*Pressure loss for a water meter, if any, shall be determined and deducted using one of the following:

(a) Table 10.4.3(a) shall be permitted to be used, even where the sprinkler demand flow exceeds the meter's rated continuous flow.

(b) Higher pressure losses specified by the manufacturer shall be used in place of those specified in Table 10.4.3(a).

(c) Lower pressure losses shall be permitted to be used where supporting data are provided by the meter manufacturer.

(5) Pressure loss for elevation shall be deducted as follows:

(a) Building height above street (ft) \times 0.433 = pressure loss (psi)

(b) Building height above street (m) \times 0.098 = pressure loss (bar)

(6)*Pressure losses from the city main to the inside control valve shall be deducted by multiplying the pressure loss associated with the pipe material by the total length(s) of pipe in feet (meters).

(7) Pressure loss for piping within the building shall be deducted by multiplying the pressure loss associated with the pipe material by the total length(s) of pipe in feet (meters).

(8) Pressure loss for valves and fittings shall be deducted as follows:

(a) The valves and fittings from the control valve to the farthest sprinkler shall be counted.

(b) The equivalent length for each valve and fitting as shown in Table 10.4.3(b), Table 10.4.3(c), or Table 10.4.3(d) or Table 10.4.3(e) shall be determined and the values added to obtain the total equivalent length for each pipe size.

(c) The equivalent length for each size shall be multiplied by the pressure loss associated with the pipe material and the values totaled.

(9) In multilevel buildings, the steps in 10.4.3(1) through 10.4.3(8) shall be repeated to size piping for each floor.

(10) If the remaining pressure is less than the operating pressure established by the testing laboratory for the sprinkler being used, the sprinkler system shall be redesigned.

(11) If the remaining pressure is higher than required, smaller piping shall be permitted to be used where justified by calculations.

(12) The remaining piping shall be sized the same as the piping up to and including the farthest sprinkler unless smaller pipe sizes are justified by calculations.

Table 10.4.3(a) Pressure Losses in psi in Water Meters

Meter Size (in.)	Flow (gpm)					
	18 or less	23	26	31	39	52
$\frac{5}{8}$	9	14	18	26	38	*
$\frac{3}{4}$	7	11	14	22	35	*
1	2	3	3	4	6	10
$1\frac{1}{2}$	1	1	2	2	4	7
2	1	1	1	1	2	3

For SI units, 1 gpm = 3.785 L/min; 1 in. = 25.4 mm; 1 psi = 0.0689 bar.

*Above maximum rated flow of commonly available meters.

Table 10.4.3(b) Equivalent Length in Feet of Fittings and Valves for Schedule 40 Steel Pipe

Diameter (in.)	45	90	Long-	Tee or	Tee or	Globe					
	Degree Elbow	Degree Elbow	Radius Elbow	Cross (flow turned 90 degrees)	Cross (flow straight through)	Gate Valve	Angle Valve	Globe Valve	Pattern Valve	Cock Valve	Check Valve
1	1	2	2	5	2	0	12	28	15	4	5
1½	1	3	2	6	2	0	15	35	18	5	7
2	2	4	2	8	3	0	18	43	22	6	9
2	2	5	3	10	3	1	24	57	28	7	11

For SI units, 1 in. = 25.4 mm; 1 ft = 0.3048 m.

Table 10.4.3(c) Equivalent Length in Feet of Fittings and Valves for Type K Copper Tube

Diameter (in.)	45	90	Long-	Tee or	Tee or	Globe "Y"					
	Degree Elbow	Degree Elbow	Radius Elbow	Cross (flow turned 90 degrees)	Cross (flow straight through)	Gate Valve	Angle Valve	Globe Valve	Pattern Valve	Cock Valve	Check Valve
¾	0	1	0	3	1	0	7	14	7	2	0
1	1	2	2	6	2	0	14	33	18	5	6
1½	1	3	2	5	2	0	14	32	16	5	6
2	2	4	2	8	3	0	18	43	22	6	9
2	2	6	3	12	4	1	28	66	33	8	13

For SI units, 1 in. = 25.4 mm; 1 ft = 0.3048 m.

Table 10.4.3(d) Equivalent Length in Feet of Fittings and Valves for Type L Copper Tube

Diameter (in.)	45 Degree	90	Long-	Tee or	Tee or	Globe					
	Elbow	Degree	Radius	Cross (flow turned 90 degrees)	Cross (flow straight through)	Gate	Angle	Globe	Pattern	Cock	Check
¾	0	2	0	4	1	0	8	18	10	3	0
1	1	3	3	7	2	0	16	38	20	5	7
1½	1	3	2	6	2	0	15	35	18	5	7
2	2	4	2	9	3	0	20	47	24	7	10
2	2	6	4	12	4	1	30	71	35	9	14

For SI units, 1 in. = 25.4 mm; 1 ft = 0.3048 m.

Table 10.4.3(e) Equivalent Length in Feet of Fittings and Valves for Type M Copper Tube

Diameter (in.)	45 Degree	90	Long-	Tee or	Tee or	Globe					
	Elbow	Degree	Radius	Cross (flow turned 90 degrees)	Cross (flow straight through)	Gate	Angle	Globe	Pattern	Cock	Check
¾	0	2	0	4	1	0	10	21	11	3	0
1	2	3	3	8	3	0	19	43	23	6	8
1½	1	3	2	7	2	0	16	38	20	5	8
2	2	5	2	9	3	0	21	50	26	7	11
2	3	7	4	13	5	1	32	75	37	9	14

For SI units, 1 in. = 25.4 mm; 1 ft = 0.3048 m.

10.4.4 Smaller pipe sizes than those determined by 10.4.3 shall be permitted where justified by calculations for systems connected to city water mains of at least 4 in. (102 mm) in diameter.

10.4.5 To size piping for systems with an elevated tank, pump, or pump–tank combination, the pressure at the water supply outlet shall be determined and the steps in 10.4.3(3), (4), (7), (8), (9), (10), and (11) shall be followed.

10.4.6 Hydraulic calculation procedures in accordance with NFPA 13 shall be used for grid-type systems.

10.4.7 Hydraulic calculation procedures in accordance with NFPA 13 shall be used for looped-type systems.

10.4.8 Hydraulic calculation procedures in accordance with NFPA 13 shall be used for systems connected to city water mains of less than 4 in. (100 mm) in diameter.

10.4.9 Prescriptive Pipe Sizing Method. Pipe shall be sized by determining the available pressure to offset friction loss in piping and identifying a piping material, diameter, and length using the equation in 10.4.9.1 and the procedure in 10.4.9.2.

10.4.9.1 Available Pressure Equation. The pressure available to offset friction loss in the interior piping system (P_t) shall be determined in accordance with the following formula:

$$P_t = P_{sup} - PL_{svc} - PL_m - PL_d - PL_e - P_{sp}$$

where:

P_t = pressure used in applying Table 10.4.9.2(a) through Table 10.4.9.2(h)

P_{sup} = pressure available from the water supply source

PL_{svc} = pressure loss in the water service pipe

PL_m = pressure loss in the water meter

PL_d = pressure loss from devices other than the water meter

PL_e = pressure loss associated with changes in elevation

P_{sp} = maximum pressure required by a sprinkler

10.4.9.2 Calculation Procedure. Determination of the required size for water distribution piping shall be in accordance with the following procedure:

- Step 1 — Determine P_{sup} .** Obtain the static supply pressure that will be available from the water main from the water purveyor or from a private source, such as a tank system, a private well system, or a combination of these. For a private source, the available water supply pressure shall be based on the minimum pressure control setting for the pump.
- Step 2 — Determine PL_{svc} .** Use Table 10.4.9.2(a) to determine the pressure loss in the water service pipe based on the selected size of the water service.

(3) **Step 3 — Determine PL_m .** Use Table 10.4.3(a) to determine the pressure loss from the water meter based on the selected water meter size. Where the actual water meter pressure loss is known, PL_m shall be the actual loss.

(4) **Step 4 — Determine PL_d .** Determine the pressure loss from devices, other than the water meter, installed in the piping system supplying sprinklers, such as pressure-reducing valves, backflow preventers, water softeners, or water filters.

(a) Device pressure losses shall be based on the device manufacturer's specifications.

(b) The flow rate used to determine pressure loss shall be the rate from Section 10.1, except that 5 gpm (19 L/min) shall be added where the device is installed in a water service pipe that supplies more than one dwelling.

(c) As an alternative to deducting pressure loss for a device, an automatic bypass valve shall be installed to divert flow around the device when a sprinkler activates.

(5) **Step 5 — Determine PL_e .** Use Table 10.4.9.2(b) to determine the pressure loss associated with changes in elevation. The elevation used in applying the table shall be the difference between the elevation where the water source pressure was measured and the elevation of the highest sprinkler.

(6) **Step 6 — Determine PL_{sp} .** Determine the maximum pressure required by any individual sprinkler based on the following:

- The area of coverage
- The ceiling configuration
- The temperature rating
- Any additional conditions specified by the sprinkler manufacturer

The required pressure is provided in the sprinkler manufacturer's published data for the specific sprinkler model based on the selected flow rate.

(7) **Step 7 — Calculate P_t .** Using the equation in 10.4.9.1, calculate the pressure available to offset friction loss in water distribution piping between the service valve and the sprinklers.

(8) **Step 8 — Determine the maximum allowable pipe length.** Use Table 10.4.9.2(c) through Table 10.4.9.2(h) to select a material and size for water distribution piping. The piping material and size shall be acceptable if the developed length of pipe between the service valve and the most remote sprinkler does not exceed the maximum allowable length specified by the applicable table. Interpolation of P_t between the tabular values shall be permitted.

10.4.9.3 The maximum allowable length of piping in Table 10.4.9.2(c) through Table 10.4.9.2(h) incorporates an adjustment for pipe fittings, and no additional consideration of friction losses associated with pipe fittings shall be required.

Table 10.4.9.2(a) Water Service Pressure Loss (PL_{svc})

Flow Rate* (gpm)	3/4 in. Water Service Pressure Loss (psi)				1 in. Water Service Pressure Loss (psi)				1 1/4 in. Water Service Pressure Loss (psi)			
	40 ft or less	41 ft to 75 ft	76 ft to 100 ft	101 ft to 150 ft	40 ft or less	41 ft to 75 ft	76 ft to 100 ft	101 ft to 150 ft	40 ft or less	41 ft to 75 ft	76 ft to 100 ft	101 ft to 150 ft
8	5.1	8.7	11.8	17.4	1.5	2.5	3.4	5.1	0.6	1.0	1.3	1.9
10	7.7	13.1	17.8	26.3	2.3	3.8	5.2	7.7	0.8	1.4	2.0	2.9
12	10.8	18.4	24.9	NP	3.2	5.4	7.3	10.7	1.2	2.0	2.7	4.0
14	14.4	24.5	NP	NP	4.2	7.1	9.6	14.3	1.6	2.7	3.6	5.4
16	18.4	NP	NP	NP	5.4	9.1	12.4	18.3	2.0	3.4	4.7	6.9
18	22.9	NP	NP	NP	6.7	11.4	15.4	22.7	2.5	4.3	5.8	8.6
20	27.8	NP	NP	NP	8.1	13.8	18.7	27.6	3.1	5.2	7.0	10.4
22	NP	NP	NP	NP	9.7	16.5	22.3	NP	3.7	6.2	8.4	12.4
24	NP	NP	NP	NP	11.4	19.3	26.2	NP	4.3	7.3	9.9	14.6
26	NP	NP	NP	NP	13.2	22.4	NP	NP	5.0	8.5	11.4	16.9
28	NP	NP	NP	NP	15.1	25.7	NP	NP	5.7	9.7	13.1	19.4
30	NP	NP	NP	NP	17.2	NP	NP	NP	6.5	11.0	14.9	22.0
32	NP	NP	NP	NP	19.4	NP	NP	NP	7.3	12.4	16.8	24.8
34	NP	NP	NP	NP	21.7	NP	NP	NP	8.2	13.9	18.8	NP
36	NP	NP	NP	NP	24.1	NP	NP	NP	9.1	15.4	20.9	NP

NP: Not permitted. Pressure loss exceeds reasonable limits.

Notes:

(1) Values are applicable for underground piping materials permitted by the local plumbing code and are based on an SDR of 11 and a Hazen-Williams *C* factor of 150.

(2) Values include the following length allowances for fittings: 25 percent length increase for actual lengths up to 100 ft and 15 percent length increase for actual lengths over 100 ft.

*Flow rate from Sections 10.1 and 10.2. Add 5 gpm to the flow rate required by 10.4.9.2, Step 4, where the water service pipe supplies more than one dwelling.

Table 10.4.9.2(b) Elevation Loss (PL_e)

Elevation (ft)	Pressure Loss (psi)
5	2.2
10	4.4
15	6.5
20	8.7
25	10.9
30	13.0
35	15.2
40	17.4

Table 10.4.9.2(c) Allowable Pipe Length for $\frac{3}{4}$ in. Type M Copper Water Tubing

Sprinkler Flow Rate* (gpm)	Water Distribution Size (in.)	Available Pressure, P_t (psi)									
		15	20	25	30	35	40	45	50	55	60
		Allowable Length of Pipe from Service Valve to Farthest Sprinkler (ft)									
8	$\frac{3}{4}$	217	289	361	434	506	578	650	723	795	867
9	$\frac{3}{4}$	174	232	291	349	407	465	523	581	639	697
10	$\frac{3}{4}$	143	191	239	287	335	383	430	478	526	574
11	$\frac{3}{4}$	120	160	200	241	281	321	361	401	441	481
12	$\frac{3}{4}$	102	137	171	205	239	273	307	341	375	410
13	$\frac{3}{4}$	88	118	147	177	206	235	265	294	324	353
14	$\frac{3}{4}$	77	103	128	154	180	205	231	257	282	308
15	$\frac{3}{4}$	68	90	113	136	158	181	203	226	248	271
16	$\frac{3}{4}$	60	80	100	120	140	160	180	200	220	241
17	$\frac{3}{4}$	54	72	90	108	125	143	161	179	197	215
18	$\frac{3}{4}$	48	64	81	97	113	129	145	161	177	193
19	$\frac{3}{4}$	44	58	73	88	102	117	131	146	160	175
20	$\frac{3}{4}$	40	53	66	80	93	106	119	133	146	159
21	$\frac{3}{4}$	36	48	61	73	85	97	109	121	133	145
22	$\frac{3}{4}$	33	44	56	67	78	89	100	111	122	133
23	$\frac{3}{4}$	31	41	51	61	72	82	92	102	113	123
24	$\frac{3}{4}$	28	38	47	57	66	76	85	95	104	114
25	$\frac{3}{4}$	26	35	44	53	61	70	79	88	97	105
26	$\frac{3}{4}$	24	33	41	49	57	65	73	82	90	98
27	$\frac{3}{4}$	23	30	38	46	53	61	69	76	84	91
28	$\frac{3}{4}$	21	28	36	43	50	57	64	71	78	85
29	$\frac{3}{4}$	20	27	33	40	47	53	60	67	73	80
30	$\frac{3}{4}$	19	25	31	38	44	50	56	63	69	75
31	$\frac{3}{4}$	18	24	29	35	41	47	53	59	65	71
32	$\frac{3}{4}$	17	22	28	33	39	44	50	56	61	67
33	$\frac{3}{4}$	16	21	26	32	37	42	47	53	58	63
34	$\frac{3}{4}$	NP	20	25	30	35	40	45	50	55	60
35	$\frac{3}{4}$	NP	19	24	28	33	38	42	47	52	57
36	$\frac{3}{4}$	NP	18	22	27	31	36	40	45	49	54
37	$\frac{3}{4}$	NP	17	21	26	30	34	38	43	47	51
38	$\frac{3}{4}$	NP	16	20	24	28	32	36	40	45	49
39	$\frac{3}{4}$	NP	15	19	23	27	31	35	39	42	46
40	$\frac{3}{4}$	NP	NP	18	22	26	29	33	37	40	44

NP: Not permitted.

*Flow rate from Sections 10.1 and 10.2.

Table 10.4.9.2(d) Allowable Pipe Length for 1 in. Type M Copper Water Tubing

Sprinkler Flow Rate* (gpm)	Water Distribution Size (in.)	Available Pressure, P_t (psi)									
		15	20	25	30	35	40	45	50	55	60
Allowable Length of Pipe from Service Valve to Farthest Sprinkler (ft)											
8	1	806	1075	1343	1612	1881	2149	2418	2687	2955	3224
9	1	648	864	1080	1296	1512	1728	1945	2161	2377	2593
10	1	533	711	889	1067	1245	1422	1600	1778	1956	2134
11	1	447	596	745	894	1043	1192	1341	1491	1640	1789
12	1	381	508	634	761	888	1015	1142	1269	1396	1523
13	1	328	438	547	657	766	875	985	1094	1204	1313
14	1	286	382	477	572	668	763	859	954	1049	1145
15	1	252	336	420	504	588	672	756	840	924	1008
16	1	224	298	373	447	522	596	671	745	820	894
17	1	200	266	333	400	466	533	600	666	733	799
18	1	180	240	300	360	420	479	539	599	659	719
19	1	163	217	271	325	380	434	488	542	597	651
20	1	148	197	247	296	345	395	444	493	543	592
21	1	135	180	225	270	315	360	406	451	496	541
22	1	124	165	207	248	289	331	372	413	455	496
23	1	114	152	190	228	267	305	343	381	419	457
24	1	106	141	176	211	246	282	317	352	387	422
25	1	98	131	163	196	228	261	294	326	359	392
26	1	91	121	152	182	212	243	273	304	334	364
27	1	85	113	142	170	198	226	255	283	311	340
28	1	79	106	132	159	185	212	238	265	291	318
29	1	74	99	124	149	174	198	223	248	273	298
30	1	70	93	116	140	163	186	210	233	256	280
31	1	66	88	110	132	153	175	197	219	241	263
32	1	62	83	103	124	145	165	186	207	227	248
33	1	59	78	98	117	137	156	176	195	215	234
34	1	55	74	92	111	129	148	166	185	203	222
35	1	53	70	88	105	123	140	158	175	193	210
36	1	50	66	83	100	116	133	150	166	183	199
37	1	47	63	79	95	111	126	142	158	174	190
38	1	45	60	75	90	105	120	135	150	165	181
39	1	43	57	72	86	100	115	129	143	158	172
40	1	41	55	68	82	96	109	123	137	150	164

*Flow rate from Sections 10.1 and 10.2.

Table 10.4.9.2(e) Allowable Pipe Length for $\frac{3}{4}$ in. CPVC Pipe

Sprinkler Flow Rate* (gpm)	Water Distribution Size (in.)	Available Pressure, P_t (psi)									
		15	20	25	30	35	40	45	50	55	60
Allowable Length of Pipe from Service Valve to Farthest Sprinkler (ft)											
8	$\frac{3}{4}$	348	465	581	697	813	929	1045	1161	1278	1394
9	$\frac{3}{4}$	280	374	467	560	654	747	841	934	1027	1121
10	$\frac{3}{4}$	231	307	384	461	538	615	692	769	845	922
11	$\frac{3}{4}$	193	258	322	387	451	515	580	644	709	773
12	$\frac{3}{4}$	165	219	274	329	384	439	494	549	603	658
13	$\frac{3}{4}$	142	189	237	284	331	378	426	473	520	568
14	$\frac{3}{4}$	124	165	206	247	289	330	371	412	454	495
15	$\frac{3}{4}$	109	145	182	218	254	290	327	363	399	436
16	$\frac{3}{4}$	97	129	161	193	226	258	290	322	354	387
17	$\frac{3}{4}$	86	115	144	173	202	230	259	288	317	346
18	$\frac{3}{4}$	78	104	130	155	181	207	233	259	285	311
19	$\frac{3}{4}$	70	94	117	141	164	188	211	234	258	281
20	$\frac{3}{4}$	64	85	107	128	149	171	192	213	235	256
21	$\frac{3}{4}$	58	78	97	117	136	156	175	195	214	234
22	$\frac{3}{4}$	54	71	89	107	125	143	161	179	197	214
23	$\frac{3}{4}$	49	66	82	99	115	132	148	165	181	198
24	$\frac{3}{4}$	46	61	76	91	107	122	137	152	167	183
25	$\frac{3}{4}$	42	56	71	85	99	113	127	141	155	169
26	$\frac{3}{4}$	39	52	66	79	92	105	118	131	144	157
27	$\frac{3}{4}$	37	49	61	73	86	98	110	122	135	147
28	$\frac{3}{4}$	34	46	57	69	80	92	103	114	126	137
29	$\frac{3}{4}$	32	43	54	64	75	86	96	107	118	129
30	$\frac{3}{4}$	30	40	50	60	70	81	91	101	111	121
31	$\frac{3}{4}$	28	38	47	57	66	76	85	95	104	114
32	$\frac{3}{4}$	27	36	45	54	63	71	80	89	98	107
33	$\frac{3}{4}$	25	34	42	51	59	68	76	84	93	101
34	$\frac{3}{4}$	24	32	40	48	56	64	72	80	88	96
35	$\frac{3}{4}$	23	30	38	45	53	61	68	76	83	91
36	$\frac{3}{4}$	22	29	36	43	50	57	65	72	79	86
37	$\frac{3}{4}$	20	27	34	41	48	55	61	68	75	82
38	$\frac{3}{4}$	20	26	33	39	46	52	59	65	72	78
39	$\frac{3}{4}$	19	25	31	37	43	50	56	62	68	74
40	$\frac{3}{4}$	18	24	30	35	41	47	53	59	65	71

*Flow rate from Sections 10.1 and 10.2.

Table 10.4.9.2(f) Allowable Pipe Length for 1 in. CPVC Pipe

Sprinkler Flow Rate* (gpm)	Water Distribution Size (in.)	Available Pressure, P_t (psi)									
		15	20	25	30	35	40	45	50	55	60
Allowable Length of Pipe from Service Valve to Farthest Sprinkler (ft)											
8	1	1049	1398	1748	2098	2447	2797	3146	3496	3845	4195
9	1	843	1125	1406	1687	1968	2249	2530	2811	3093	3374
10	1	694	925	1157	1388	1619	1851	2082	2314	2545	2776
11	1	582	776	970	1164	1358	1552	1746	1940	2133	2327
12	1	495	660	826	991	1156	1321	1486	1651	1816	1981
13	1	427	570	712	854	997	1139	1281	1424	1566	1709
14	1	372	497	621	745	869	993	1117	1241	1366	1490
15	1	328	437	546	656	765	874	983	1093	1202	1311
16	1	291	388	485	582	679	776	873	970	1067	1164
17	1	260	347	433	520	607	693	780	867	954	1040
18	1	234	312	390	468	546	624	702	780	858	936
19	1	212	282	353	423	494	565	635	706	776	847
20	1	193	257	321	385	449	513	578	642	706	770
21	1	176	235	293	352	410	469	528	586	645	704
22	1	161	215	269	323	377	430	484	538	592	646
23	1	149	198	248	297	347	396	446	496	545	595
24	1	137	183	229	275	321	366	412	458	504	550
25	1	127	170	212	255	297	340	382	425	467	510
26	1	118	158	197	237	276	316	355	395	434	474
27	1	111	147	184	221	258	295	332	368	405	442
28	1	103	138	172	207	241	275	310	344	379	413
29	1	97	129	161	194	226	258	290	323	355	387
30	1	91	121	152	182	212	242	273	303	333	364
31	1	86	114	143	171	200	228	257	285	314	342
32	1	81	108	134	161	188	215	242	269	296	323
33	1	76	102	127	152	178	203	229	254	280	305
34	1	72	96	120	144	168	192	216	240	265	289
35	1	68	91	114	137	160	182	205	228	251	273
36	1	65	87	108	130	151	173	195	216	238	260
37	1	62	82	103	123	144	165	185	206	226	247
38	1	59	78	98	117	137	157	176	196	215	235
39	1	56	75	93	112	131	149	168	187	205	224
40	1	53	71	89	107	125	142	160	178	196	214

*Flow rate from Sections 10.1 and 10.2.

Table 10.4.9.2(g) Allowable Pipe Length for $\frac{3}{4}$ in. PEX Tubing

Sprinkler Flow Rate* (gpm)	Water Distribution Size (in.)	Available Pressure, P_t (psi)									
		15	20	25	30	35	40	45	50	55	60
Allowable Length of Pipe from Service Valve to Farthest Sprinkler (ft)											
8	$\frac{3}{4}$	93	123	154	185	216	247	278	309	339	370
9	$\frac{3}{4}$	74	99	124	149	174	199	223	248	273	298
10	$\frac{3}{4}$	61	82	102	123	143	163	184	204	225	245
11	$\frac{3}{4}$	51	68	86	103	120	137	154	171	188	205
12	$\frac{3}{4}$	44	58	73	87	102	117	131	146	160	175
13	$\frac{3}{4}$	38	50	63	75	88	101	113	126	138	151
14	$\frac{3}{4}$	33	44	55	66	77	88	99	110	121	132
15	$\frac{3}{4}$	29	39	48	58	68	77	87	96	106	116
16	$\frac{3}{4}$	26	34	43	51	60	68	77	86	94	103
17	$\frac{3}{4}$	23	31	38	46	54	61	69	77	84	92
18	$\frac{3}{4}$	21	28	34	41	48	55	62	69	76	83
19	$\frac{3}{4}$	19	25	31	37	44	50	56	62	69	75
20	$\frac{3}{4}$	17	23	28	34	40	45	51	57	62	68
21	$\frac{3}{4}$	16	21	26	31	36	41	47	52	57	62
22	$\frac{3}{4}$	NP	19	24	28	33	38	43	47	52	57
23	$\frac{3}{4}$	NP	17	22	26	31	35	39	44	48	52
24	$\frac{3}{4}$	NP	16	20	24	28	32	36	40	44	49
25	$\frac{3}{4}$	NP	NP	19	22	26	30	34	37	41	45
26	$\frac{3}{4}$	NP	NP	17	21	24	28	31	35	38	42
27	$\frac{3}{4}$	NP	NP	16	20	23	26	29	33	36	39
28	$\frac{3}{4}$	NP	NP	15	18	21	24	27	30	33	36
29	$\frac{3}{4}$	NP	NP	NP	17	20	23	26	28	31	34
30	$\frac{3}{4}$	NP	NP	NP	16	19	21	24	27	29	32
31	$\frac{3}{4}$	NP	NP	NP	15	18	20	23	25	28	30
32	$\frac{3}{4}$	NP	NP	NP	NP	17	19	21	24	26	28
33	$\frac{3}{4}$	NP	NP	NP	NP	16	18	20	22	25	27
34	$\frac{3}{4}$	NP	NP	NP	NP	NP	17	19	21	23	25
35	$\frac{3}{4}$	NP	NP	NP	NP	NP	16	18	20	22	24
36	$\frac{3}{4}$	NP	NP	NP	NP	NP	15	17	19	21	23
37	$\frac{3}{4}$	NP	NP	NP	NP	NP	NP	16	18	20	22
38	$\frac{3}{4}$	NP	NP	NP	NP	NP	NP	16	17	19	21
39	$\frac{3}{4}$	NP	NP	NP	NP	NP	NP	NP	16	18	20
40	$\frac{3}{4}$	NP	NP	NP	NP	NP	NP	NP	16	17	19

NP: Not permitted.

*Flow rate from Sections 10.1 and 10.2.

Table 10.4.9.2(h) Allowable Pipe Length for 1 in. PEX Tubing

Sprinkler Flow Rate* (gpm)	Water Distribution Size (in.)	Available Pressure, P_t (psi)									
		15	20	25	30	35	40	45	50	55	60
Allowable Length of Pipe from Service Valve to Farthest Sprinkler (ft)											
8	1	314	418	523	628	732	837	941	1046	1151	1255
9	1	252	336	421	505	589	673	757	841	925	1009
10	1	208	277	346	415	485	554	623	692	761	831
11	1	174	232	290	348	406	464	522	580	638	696
12	1	148	198	247	296	346	395	445	494	543	593
13	1	128	170	213	256	298	341	383	426	469	511
14	1	111	149	186	223	260	297	334	371	409	446
15	1	98	131	163	196	229	262	294	327	360	392
16	1	87	116	145	174	203	232	261	290	319	348
17	1	78	104	130	156	182	208	233	259	285	311
18	1	70	93	117	140	163	187	210	233	257	280
19	1	63	84	106	127	148	169	190	211	232	253
20	1	58	77	96	115	134	154	173	192	211	230
21	1	53	70	88	105	123	140	158	175	193	211
22	1	48	64	80	97	113	129	145	161	177	193
23	1	44	59	74	89	104	119	133	148	163	178
24	1	41	55	69	82	96	110	123	137	151	164
25	1	38	51	64	76	89	102	114	127	140	152
26	1	35	47	59	71	83	95	106	118	130	142
27	1	33	44	55	66	77	88	99	110	121	132
28	1	31	41	52	62	72	82	93	103	113	124
29	1	29	39	48	58	68	77	87	97	106	116
30	1	27	36	45	54	63	73	82	91	100	109
31	1	26	34	43	51	60	68	77	85	94	102
32	1	24	32	40	48	56	64	72	80	89	97
33	1	23	30	38	46	53	61	68	76	84	91
34	1	22	29	36	43	50	58	65	72	79	86
35	1	20	27	34	41	48	55	61	68	75	82
36	1	19	26	32	39	45	52	58	65	71	78
37	1	18	25	31	37	43	49	55	62	68	74
38	1	18	23	29	35	41	47	53	59	64	70
39	1	17	22	28	33	39	45	50	56	61	67
40	1	16	21	27	32	37	43	48	53	59	64

*Flow rate from Sections 10.1 and 10.2.

Chapter 11 System Acceptance

11.1 General.

11.1.1 The installer shall perform all required acceptance tests prior to asking for approval of the installation.

11.1.2 When the authority having jurisdiction is required to be present during the acceptance tests, the installer shall coordinate the time and date of testing with the authority having jurisdiction and other interested parties.

11.2 Acceptance Tests.

11.2.1* Hydrostatic Tests.

11.2.1.1 Where a fire department pumper connection is not provided, the system shall be hydrostatically tested at normal system operating pressure without evidence of leakage.

11.2.1.2 Where a fire department pumper connection is provided, the system shall pass a hydrostatic pressure test performed in accordance with NFPA 13.

11.2.1.3 Evidence of leakage shall be determined by a drop in pressure at a gauge over a period of 2 hours or by visually checking the piping system for leakage.

11.2.1.4 When systems are being hydrostatically tested, the test shall be permitted to be conducted with sprinklers or plugs installed in the fittings.

11.2.1.4.1 Any plugs used during the hydrostatic testing shall be replaced with sprinklers after the test is completed.

11.2.1.4.2 No additional hydrostatic testing shall be required after the sprinklers are installed.

11.2.2* Pump Tests.

11.2.2.1 Prior to system acceptance, a system utilizing a pump shall be tested by opening the drain/test connection.

11.2.2.1.1* The pump shall sense the flow, turn on, and flow water for the required duration of 6.1.2 or 6.1.3 without interruption.

11.2.3 System Operational Tests.

11.2.3.1 Waterflow Devices. Where waterflow detection devices are installed, these devices, including the associated alarm circuits, shall be flow tested through the inspector's test connection and shall result in an audible alarm on the premises.

11.2.3.2 Preaction Systems. The operation of the preaction system shall be tested in accordance with the manufacturer's instructions.

11.2.3.3 Dry Pipe and Double-Interlock Preaction Systems. A test shall be conducted in accordance with the valve manufacturer's instructions to measure the time to trip the valve and the time for water to be discharged from the inspector's test connection.

11.2.3.3.1 All times shall be measured from the time the inspector's test connection is completely open.

Chapter 12 Inspection, Testing, and Maintenance

12.1* General. The installer shall provide to the owner/occupant instructions on inspecting, testing, and maintaining the system.

12.2* Inspections and Tests. The sprinkler system shall be inspected and tested periodically to make sure the system is in good working condition.

12.3 Maintenance.

12.3.1 The sprinkler system shall be properly maintained in accordance with this standard and the manufacturers' instructions.]

12.3.2 Any sprinkler that is operated, damaged, corroded, covered with foreign materials, or showing signs of leakage shall be replaced with a new listed sprinkler having the same performance characteristics as the original equipment.

12.3.3 Painting Sprinklers.

12.3.3.1 Sprinklers shall not be painted unless applied by the manufacturer.

12.3.3.2* Any sprinklers that have been painted outside of the factory shall be replaced with a new listed sprinkler.

12.3.4* Wet Pipe Systems. A wet pipe system shall be maintained above 40°F (4°C), including areas properly insulated to maintain 40°F (4°C).

12.3.5* Antifreeze Systems.

12.3.5.1 Annual Antifreeze Solution Test and Replacement Procedure.

12.3.5.1.1 Samples of antifreeze solution shall be collected by qualified individuals in accordance with 12.3.5.1.1.2 or 12.3.5.1.1.3 on an annual basis.

12.3.5.1.1.1 The system shall be drained to verify the following:

- (1) The solution is in compliance with 9.2.2.1.1.
- (2) The solution provides the necessary freeze protection.

12.3.5.1.1.2 Solution samples shall be taken near the beginning and near the end of the draining process.

12.3.5.1.1.3* Solution samples shall be taken at the highest practical elevation and the lowest practical elevation of the system.

12.3.5.1.2 The two samples collected in accordance with the procedures specified in 12.3.5.1.1.2 or 12.3.5.1.1.3 shall be tested to verify that the specific gravity of both samples is similar and that the solution is in compliance with 9.2.2.1.1.

12.3.5.1.2.1 The specific gravity of each solution shall be checked using a hydrometer with a suitable scale or a refractometer having a scale calibrated for the antifreeze solution.

12.3.5.1.3* If concentrations of the two samples collected in accordance with the procedures in 12.3.5.1.1.2 or 12.3.5.1.1.3 are similar and in compliance with 9.2.2.1.1, then (a) the solution drained in accordance with 12.3.5.1.1.1 can be used to refill the system, or (b) the existing undrained solution tested in accordance with 12.3.5.1.1.3 shall be permitted to continue to be used.

12.3.5.1.3.1 If the two samples are not similar and not in compliance with 9.2.2.1.1, then a solution in compliance with 9.2.2.1.1 shall be used to refill the system.

12.3.5.1.4 Tag.

12.3.5.1.4.1 A tag shall be attached to the riser indicating the date the antifreeze solution was tested.

12.3.5.1.4.2 The tag shall also indicate the type and concentration of antifreeze solution (by volume) with which the system is filled, the date the antifreeze was replaced (if applicable), the name of the contractor that tested and/or replaced the antifreeze solution, the contractor's license number, a statement indicating if the entire system was drained and replaced with antifreeze, and a warning to test the concentration of the antifreeze solutions at yearly intervals per NFPA 13D.

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

A.1.1 NFPA 13D is appropriate for protection against fire hazards only in one- and two-family dwellings and manufactured homes. Residential portions of any other type of building or occupancy should be protected with residential sprinklers in accordance with NFPA 13 or in accordance with NFPA 13R. Other portions of such buildings should be protected in accordance with NFPA 13 or NFPA 13R as appropriate for areas outside the dwelling unit.

The criteria in this standard are based on full-scale fire tests of rooms containing typical furnishings found in residential living rooms, kitchens, and bedrooms. The furnishings were arranged as typically found in dwelling units in a manner similar to that shown in Figure A.1.1(a), Figure A.1.1(b), and Figure A.1.1(c). Sixty full-scale fire tests were conducted in a two-story dwelling in Los Angeles, California, and 16 tests were

conducted in a 14 ft (4.3 m) wide mobile home in Charlotte, North Carolina.

Sprinkler systems designed and installed according to this standard are expected to prevent flashover within the compartment of origin where sprinklers are installed in the compartment. A sprinkler system designed and installed according to this standard cannot, however, be expected to completely control a fire involving fuel loads that are significantly higher than average for dwelling units [10 lb/ft² (49 kg/m²)] and where the interior finish has an unusually high flame spread index (greater than 225) when tested in accordance with ASTM E 84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, or ANSI/UL 723, *Standard for Test for Surface Burning Characteristics of Building Materials*.

(For protection of multifamily dwellings, see NFPA 13 or NFPA 13R.)

A.1.2 While the purpose of this standard is to provide improved protection against injury and loss of life, the use of these systems has demonstrated an ability to provide improved protection against property damage. Various levels of fire safety are available to dwelling occupants to provide life safety and property protection.

This standard recommends, but does not require, sprinklering of all areas in a dwelling; it permits sprinklers to be omitted in certain areas. These areas have been proved by NFPA statistics [see Table A.1.2(a), Table A.1.2(b), and Table A.1.2(c)] to be those where the incidence of life loss from fires in dwellings is low. Such an approach provides a reasonable degree of fire safety. Greater protection to both life and property is achieved by sprinklering all areas.

Guidance for the installation of smoke detectors and fire detection systems is found in NFPA 72.

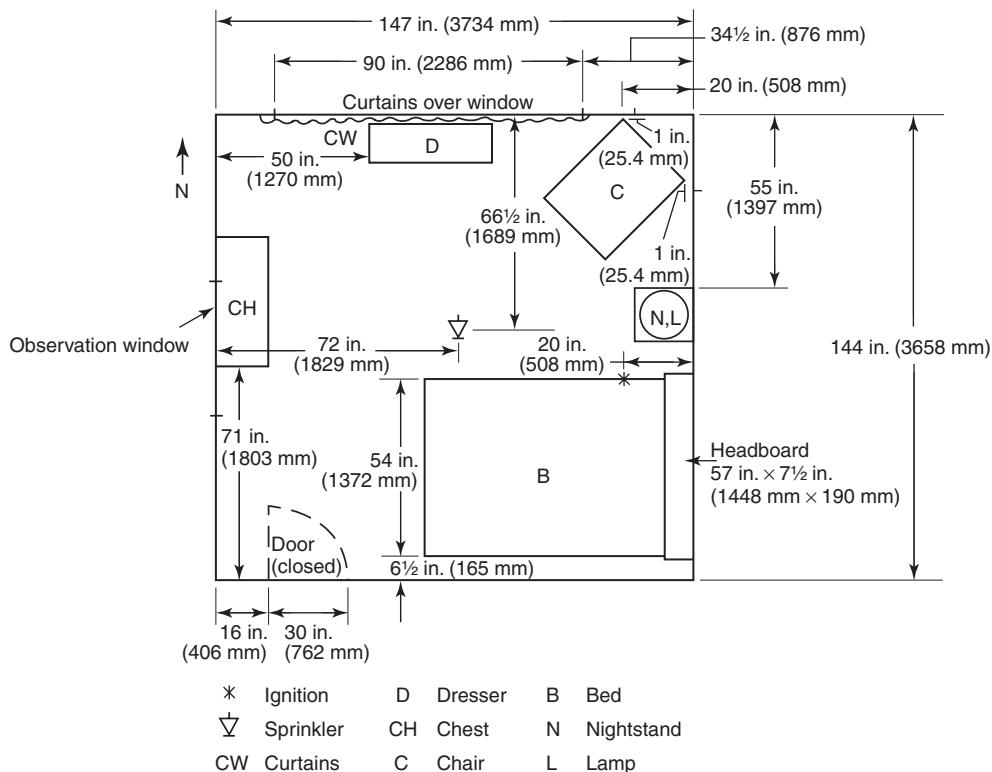


FIGURE A.1.1(a) Bedroom.

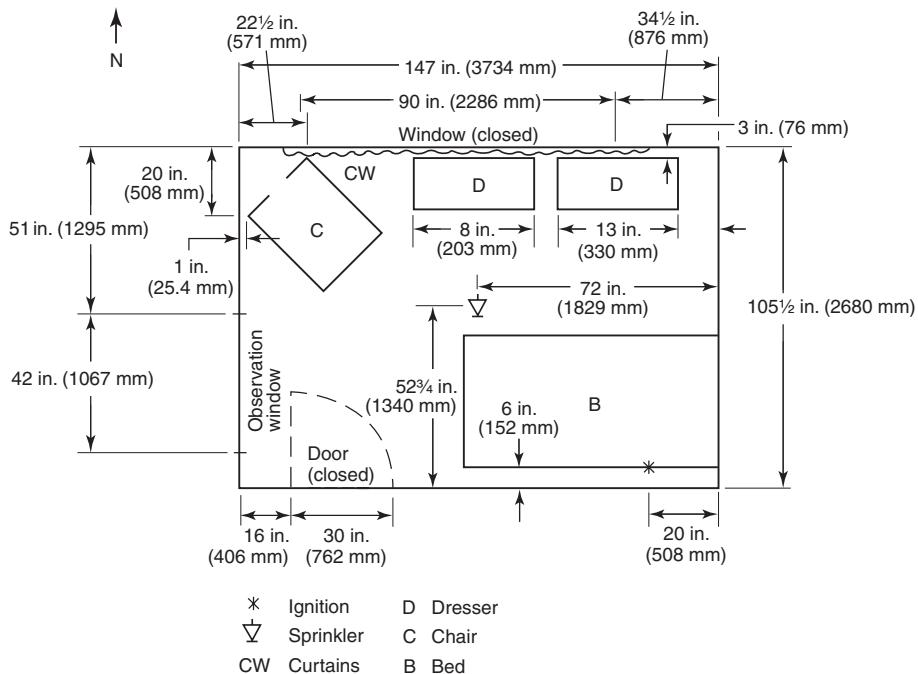


FIGURE A.1.1(b) Manufactured Home Bedroom.

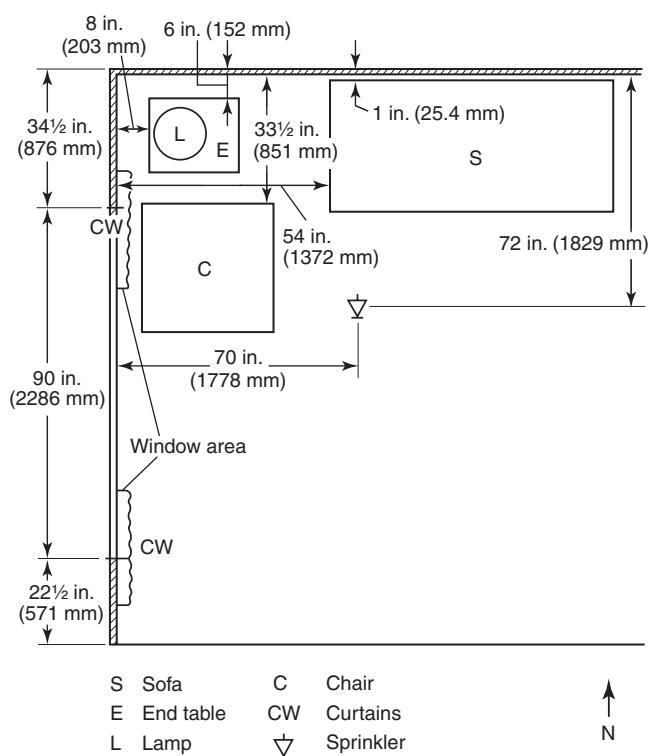


FIGURE A.1.1(c) Living Room.

A.1.5.1 For additional conversions and information, see IEEE/ASTM SI 10, *Standard for Use of the International System of Units (SI): The Modern Metric System*.

A.1.5.4 A given equivalent value is considered to be approximate.

A.3.2.1 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

A.3.2.2 Authority Having Jurisdiction (AHJ). The phrase “authority having jurisdiction,” or its acronym AHJ, is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

Table A.1.2(a) Fires and Associated Deaths and Injuries in Dwellings, Duplexes, and Manufactured Homes by Area of Origin: Annual Average of 2005–2009 Structure Fires Reported to U.S. Fire Departments

Area of Origin	Civilian Deaths	Civilian Percent	Fires	Percent	Injuries	Percent
Living room, family room, or den	540	24	11,300	4	990	11
Bedroom	540	24	22,300	8	1,810	20
Kitchen	310	14	85,600	32	2,870	32
Unclassified function area	240	11	7,900	3	480	5
Unclassified structural area	80	4	5,200	2	150	2
Crawl space or substructure space	50	2	5,000	2	190	2
Unclassified area of origin	40	2	6,500	2	70	1
Laundry room or area	40	2	8,900	3	280	3
Garage or vehicle storage area*	30	1	8,600	3	420	5
Bathroom	30	1	5,500	2	200	2
Exterior balcony or unenclosed porch	30	1	4,600	2	140	2
Wall assembly or concealed space	30	1	6,400	2	110	1
Attic or ceiling/roof assembly or concealed space	30	1	9,000	3	90	1
Heating equipment room	20	1	6,000	2	140	2
Unclassified outside area	10	0	6,600	2	50	1
Exterior wall surface	10	0	8,500	3	90	1
Confined chimney or flue fire [†]	0	0	22,500	8	30	0
Other known area of origin	200	9	34,100	13	740	8
Total	2,210	100	264,500	100	8,860	100

Source: NFIRS 5.0 and NFPA survey.

Note: Sums may not equal totals due to rounding errors.

*Does not include fires with property use coded as residential garage.

[†]NFIRS 5.0 does not have a separate area of origin code for fires starting in chimneys. Any home fire with NFIRS incident type 114 (Chimney of fire originating in and confined to a chimney or flue) is captured here.

Table A.1.2(b) Fires and Associated Deaths and Injuries in Dwellings, Duplexes, and Manufactured Homes by Heat Source: Annual Average of 2005–2009 Structure Fires Reported to U.S. Fire Departments

Heat Source	Civilian Deaths	Civilian Percent	Fires	Percent	Injuries	Percent
Smoking materials	510	23	11,600	4	760	9
Radiated or conducted heat from operating equipment	290	13	46,000	17	1,920	22
Arcing	290	13	29,900	11	850	10
Unclassified heat source	160	7	22,900	9	500	6
Unclassified heat from powered equipment	160	7	39,900	15	1,290	15
Spark, ember, or flame from operating equipment	140	6	16,900	6	620	7
Lighter	130	6	7,300	3	590	7
Candle	110	5	10,000	4	740	8
Unclassified hot or smoldering object	100	4	18,600	7	450	5
Hot ember or ash	100	4	21,200	8	340	4
Match	80	4	9,000	3	240	3
Heat from direct flame or convection current	10	1	5,900	2	90	1
Lightning	10	0	4,100	2	30	0
Other known heat source	130	6	21,200	8	440	5
Total fires	2,210	100	264,500	100	8,860	100

Source: NFIRS 5.0 and NFPA survey.

Note: Sums may not equal totals due to rounding errors.

Table A.1.2(c) Fires and Associated Deaths and Injuries in Dwellings, Duplexes, and Manufactured Homes by Item First Ignited: Annual Average of 2005–2009 Structure Fires Reported to U.S. Fire Departments

Item First Ignited	Civilian Deaths	Civilian Percent	Fires	Percent	Injuries	Percent
Upholstered furniture	420	19	5,400	2	560	6
Mattress or bedding	280	13	8,000	3	910	10
Flammable or combustible liquid or gas or associated part	200	9	13,200	5	880	10
Structural member or framing	120	6	18,500	7	330	4
Floor covering rug, carpet, or mat	110	5	4,500	2	200	2
Unclassified furniture or utensil	110	5	5,000	2	300	3
Clothing	110	5	6,200	2	390	4
Electrical wire or cable insulation	90	4	15,200	6	360	4
Cooking materials, including food	90	4	53,300	20	2,000	23
Multiple items first ignited	80	4	4,900	2	210	2
Unclassified item first ignited	80	4	23,600	9	340	4
Interior wall covering	70	3	7,100	3	220	3
Unclassified structural component or finish	60	3	6,600	2	140	2
Magazine, newspaper, or writing paper	50	2	4,100	2	140	2
Rubbish, trash, or waste	40	2	9,100	3	180	2
Cabinetry	40	2	4,600	2	210	2
Appliance housing or casing	30	2	8,700	3	200	2
Exterior wall covering or finish	30	1	12,000	5	140	2
Household utensil	10	1	5,700	2	130	1
Insulation within structural area	10	0	5,500	2	80	1
Unclassified organic material	0	0	6,300	2	40	0
Film or residue, including paint, resin, and creosote	0	0	4,400	2	10	0
Other known item first ignited	160	7	32,500	12	890	10
Total	2,210	100	264,500	100	8,860	100

Source: NFIRS 5.0 and NFPA survey.

Note: Sums may not equal totals due to rounding errors.

A.3.2.4 Listed. The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

A.3.3.5 Manufactured Home. Manufactured homes were formerly referred to as “mobile homes” or “trailer coaches.”

A.3.3.6 Premixed Antifreeze Solution. Where a tank is used as the water supply for the sprinkler system, the tank is not permitted to be filled with antifreeze.

A.3.3.9 Shadow Area. Water is not required to fall on every square inch of floor space of the occupancy. This definition establishes a term that will be used to address the rules for acceptable dry spaces that occur when walls interfere with the sprinkler’s spray pattern. Angled walls, wing walls, and slightly indented walls can disrupt water discharging from a sprinkler, which does not travel only in an absolute straight line, as if it were beams of light. Where small (typically triangular) shadowed areas are formed on the floor adjacent to the wall, these shadowed areas are purely on paper and do not take into account the dynamic variables of sprinkler discharge. In order to

be acceptable, the shadow area needs to be within the coverage area of a sprinkler, meaning that water would discharge to the space directly if the structural or architectural feature was not there. The purpose of the shadow area is not to replace any existing obstruction requirements. Instead the shadow area concept has been added to the standard to provide clarity to specific situations in which walls form non-rectangular-shaped rooms as shown in Figure A.3.3.9.

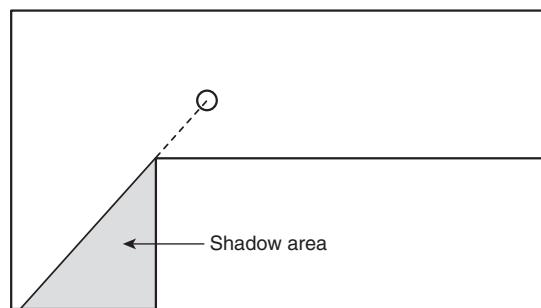


FIGURE A.3.3.9 Shadow Area Created by a Wall.

A.3.3.11.3 Multipurpose Piping Sprinkler System. Examples of multipurpose piping systems are shown in Figure A.3.3.11.3(a), Figure A.3.3.11.3(b), and Figure A.3.3.11.3(c).

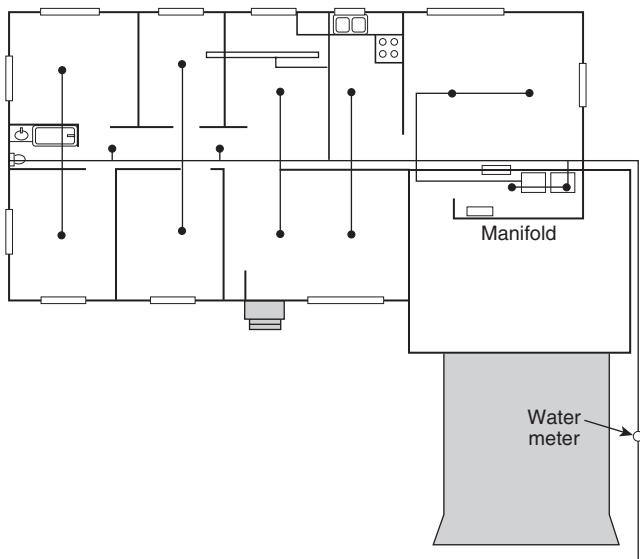


FIGURE A.3.3.11.3(a) Multipurpose Piping System (Tree System) — Example 1.

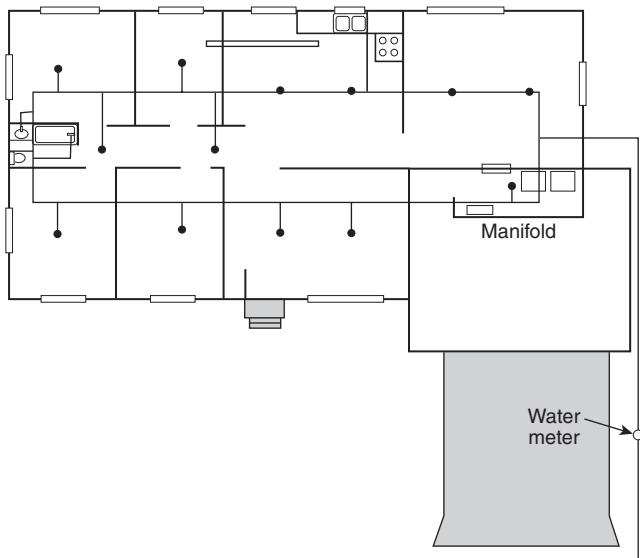


FIGURE A.3.3.11.3(b) Multipurpose Piping System (Looped System) — Example 2.

A.3.3.11.4 Network Sprinkler System. A network system is a type of multipurpose system that often uses $\frac{1}{2}$ in. (13 mm) piping to serve both domestic and fire protection needs, providing an equivalent level of suppression capability as larger piping systems. To accomplish this protection, each sprinkler is supplied by water flowing to it from at least three separate paths. An example of a network system is shown in Figure A.3.3.11.3(c).

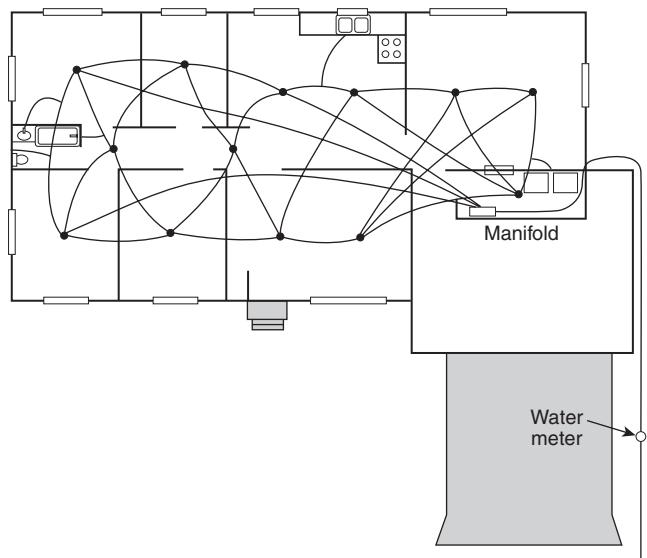


FIGURE A.3.3.11.3(c) Multipurpose Piping System — Example 3 (Network System).

A.3.3.11.5 Passive Purge Sprinkler System. The domestic plumbing fixture should be on a remote portion of the system or the system should be designed as a loop so that water moves through a majority of the system when the fixture is used. This type of system is also called a “flow through system” in much of North America.

A.3.3.11.9 Stand-Alone Sprinkler System. Underground piping is permitted to serve domestic use as well as sprinkler system use, but once the split is made between systems, the piping serving fire sprinklers only serves the fire sprinklers.

A.3.3.13.2 Control Valve. System control valves should be of the indicating type, such as plug valves, ball valves, butterfly valves, or OS&Y gate valves.

A.4.5 A scaled drawing where required should show the following:

- (1) Address (if known)
- (2) Size and type of domestic line, including length to city connection
- (3) Water meter size
- (4) Current static water pressure
- (5) Interior walls
- (6) Model, manufacturer, temperature, orifice size, and spacing requirements of sprinklers
- (7) Type of pipe
- (8) Hanger spacing requirement per the pipe manufacturer
- (9) Riser detail
- (10) Installing contractor information
- (11) Preliminary hydraulic calculations

A.5.1.1 Where fused sprinklers are replaced by the owner, fire department, or others, care should be taken to ensure that the replacement sprinkler has the same operating characteristics.

A.5.2.2 For reference, the information in Table A.5.2.2(a) through Table A.5.2.2(d) is provided to assist in the determination of acceptable water availability.

Table A.5.2.2(a) SDR 13.5 IPS Pipe (CPVC)

Nominal Pipe Size (in.)	Average Outside Diameter (in.)	Average Inside Diameter (in.)
3/4	1.05	0.87
1	1.32	1.10
1 1/4	1.66	1.39
1 1/2	1.90	1.60
2	2.38	2.00
2 1/2	2.88	2.42
3	3.50	2.95

Table A.5.2.2(b) SDR 9 CTS Pipe (PEX)

Nominal Diameter (in.)	Outside Diameter		Wall		Inside Diameter	
	in.*	mm	in. [†]	mm	in.	mm
3/8	0.50	12.7	0.07	1.8	0.36	9.1
1/2	0.63	15.9	0.07	1.8	0.49	12.3
3/4	0.88	22.2	0.10	2.5	0.68	17.2
1	1.30	28.6	0.13	3.2	0.88	22.2
1 1/4	1.38	34.9	0.15	3.9	1.07	27.2
1 1/2	1.63	41.2	0.18	4.6	1.26	32.1
2	2.13	54.0	0.24	6.0	1.65	42.0

* Average dimensions from ASTM F 876, *Standard Specification for Crosslinked Polyethylene (PEX) Tubing*.

† Minimum wall thickness from ASTM F 876.

Table A.5.2.2(c) Steel Pipe Dimensions

Nominal Pipe Size	Schedule 5				Schedule 10 ^a				Schedule 30				Schedule 40				
	Outside Diameter	Inside Diameter	Wall Thickness	Inside Diameter	Wall Thickness	Inside Diameter	Wall Thickness	Inside Diameter	Wall Thickness	Inside Diameter	Wall Thickness	Inside Diameter	Wall Thickness	Inside Diameter	Wall Thickness		
in.	in.	in.	in.	in.	in.	in.	in.	in.	in.	in.	in.	in.	in.	in.	in.		
1/2 ^b	15	0.84	21.3	—	—	—	—	0.67	17.0	0.08	2.1	—	—	0.62	15.8	0.11	2.8
3/4 ^b	20	1.05	26.7	—	—	—	—	0.88	22.4	0.08	2.1	—	—	0.82	21.0	0.11	2.9
1	25	1.32	33.4	1.19	30.1	0.07	1.7	1.10	27.9	0.11	2.8	—	—	1.05	26.6	0.13	3.4
1 1/4	32	1.66	42.2	1.53	38.9	0.07	1.7	1.44	36.6	0.11	2.8	—	—	1.38	35.1	0.14	3.6
1 1/2	40	1.90	48.3	1.77	45.0	0.07	1.7	1.68	42.7	0.11	2.8	—	—	1.61	40.9	0.15	3.7
2	50	2.38	60.3	2.25	57.0	0.07	1.7	2.16	54.8	0.11	2.8	—	—	2.07	52.5	0.15	3.9
2 1/2	65	2.88	73.0	2.71	68.8	0.08	2.1	2.64	66.9	0.12	3.0	—	—	2.47	62.7	0.20	5.2
3	80	3.50	88.9	3.33	84.7	0.08	2.1	3.26	82.8	0.12	3.0	—	—	3.07	77.9	0.22	5.5

^a Schedule 10 defined to 5 in. (127 mm) nominal pipe size by ASTM A 135, *Standard Specification for Electric-Resistance-Welded Steel Pipe*.

^b These values applicable when used in conjunction with 8.15.19.3 and 8.15.19.4 of NFPA 13. [13: Table A.6.3.2]

A.5.2.2.2 In most installations, pressure increases due to temperature fluctuations or pressure surges do not cause the system pressure to exceed the pressure rating of the pipe. In situations where the system pressure has the potential to exceed the pipe pressure rating, installation of a relief valve should be considered. Where a relief valve is installed, consideration should be given to making sure that an adequate drain is available to handle the anticipated discharge.

A.5.2.3.2 Not all pipe or tube made to ASTM F 442, *Standard Specification for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe (SDR-PR)*, as described in 5.2.3.2 is listed for fire sprinkler service. Listed pipe is identified by the logo of the listing agency.

All nonmetallic pipe and fitting materials can be damaged by contact with chemicals found in some construction products, such as thread sealants, leak detectors, firestops, insulation, spray foams, cutting oils, termiticides, insecticides, antifreeze, coupling lubes, communication cables, wires, flux, solder, mastic, PVC-coated floor clamps, pipe tapes, grease and cooking oils, rubber and plasticizers, antimicrobial coatings, and so forth. The chemical compatibility of such products with the particular pipe or fitting material must be verified prior to use. Otherwise, contact between the construction product and the pipe or fitting must be avoided.

A.5.2.9.2 Compatible thread sealant or Teflon tape can be used in a CPVC sprinkler head adapter. The combination of the two cannot be used together. The manufacturer of the sprinkler head adapter installation instructions must be followed for each sprinkler head adapter used. Not all fittings made to ASTM F 437, *Standard Specification for Threaded Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80*; ASTM F 438, *Standard Specification for Socket-Type Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 40*; and ASTM F 439, *Standard Specification for Socket-Type Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80*, as described in 5.2.9.2 are listed for fire sprinkler service. Listed fittings are identified by the logo of the listing agency.

A.5.3 It is not the intent of NFPA 13D to require the use of NFPA 24 for any supply piping.

Table A.5.2.2(d) Copper Tube Dimensions

Nominal Tube Size	Outside Diameter	Type K				Type L				Type M					
		Inside Diameter		Wall Thickness		Inside Diameter		Wall Thickness		Inside Diameter		Wall Thickness			
in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm		
3/4	20	0.88	22.2	0.75	18.9	0.07	1.7	0.79	19.9	0.05	1.1	0.81	20.6	0.03	0.8
1	25	1.13	28.6	1.00	25.3	0.07	1.7	1.03	26.0	0.05	1.3	1.06	26.8	0.04	0.9
1 1/4	32	1.38	34.9	1.25	31.6	0.07	1.7	1.27	32.1	0.06	1.4	1.29	32.8	0.04	1.1
1 1/2	40	1.63	41.3	1.48	37.6	0.07	1.8	1.51	38.2	0.06	1.5	1.53	38.8	0.05	1.2
2	50	2.13	54.0	1.96	49.8	0.08	2.1	1.99	50.4	0.07	1.8	2.01	51.0	0.06	1.5
2 1/2	65	2.63	66.7	2.44	61.8	0.10	2.4	2.47	62.6	0.08	2.0	2.50	63.4	0.07	1.7
3	80	3.13	79.4	2.91	73.8	0.11	2.8	2.95	74.8	0.09	2.3	2.98	75.7	0.07	1.8


[13: Table A.6.3.5]

A.6.2 The connection to city mains for fire protection is often subject to local regulation of metering and backflow prevention requirements. Preferred and acceptable water supply arrangements are shown in Figure A.6.2(a), Figure A.6.2(b), and Figure A.6.2(c). Where it is necessary to use a meter between the city water main and the sprinkler system supply, an acceptable arrangement as shown in Figure A.6.2(c) can be used. Under these circumstances, the flow characteristics of the meter are to be included in the hydraulic calculation of the system [see Table 10.4.3(a)]. Where a tank is used for both domestic and fire protection purposes, a low water alarm that actuates when the water level falls below 110 percent of the minimum quantity specified in 6.1.2 should be provided.

The effect of pressure-reducing valves on the system should be considered in the hydraulic calculation procedures.

Figure A.6.2(a) is the preferred method for getting the water supply into the unit for a stand-alone sprinkler system (one that does not also provide direct connections to the cold water fixtures) because the common supply pipe for the domestic system and the sprinkler system between the water supply and the dwelling unit has a single control valve that shuts the sprinkler system, which helps to ensure that people who have running water to their domestic fixtures also have fire protection. This serves as a form of supervision for the control valve and can be used to make sure that the valve stays open in place of other, more expensive options such as tamper switches with a monitoring service.


Some water utilities insist on separate taps and supply pipes from the water supply to the dwelling unit for fire sprinkler systems as shown in Figure A.6.2(b), due to concerns about shutting off the water supply for nonpayment of bills and the desire not to shut off fire protection if this ever occurs. While this type of arrangement is acceptable, it is not cost efficient and should be discouraged due to the extra cost burden this places on the building owner. The concern over shutting off the water for nonpayment of bills is a nonissue for a number of reasons. First, the water utilities rarely actually shut off water for nonpayment. Second, if they do shut off water for nonpayment, they are creating violations of all sorts of health and safety codes, allowing people to live in a home without running water. Concern over the fire protection for those individuals when they are violating all kinds of other health codes is disingenuous. More likely, the water utility will not shut off the water and will follow other legal avenues to collect on unpaid bills, such as liens on property. Millions of people should not have to pay hundreds

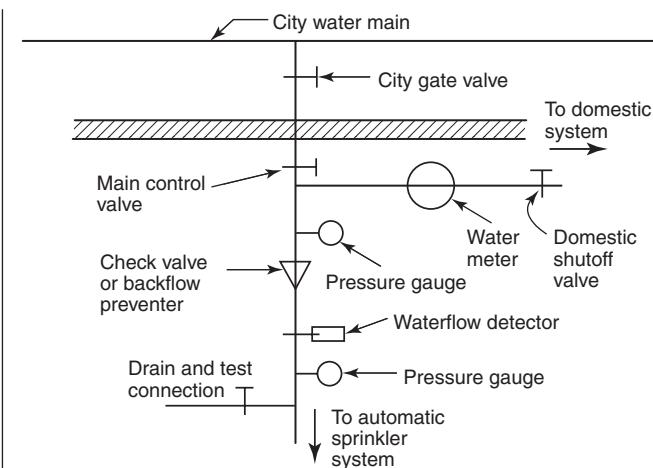**FIGURE A.6.2(a) Preferable Arrangement for Stand-Alone Piping Systems.**

of millions of dollars to install separate water taps and lines for the few services that might get shut off.


• **A.6.2.3** The best method for getting the water supply into the unit for a stand-alone sprinkler system (one that does not also provide direct connections to the cold water fixtures) is to have a common pipe for the domestic system and the sprinkler system between the water supply and the dwelling unit. Once inside the dwelling unit, the pipes can be split to provide the individual domestic and sprinkler systems. In this arrangement, a single control valve on the combined pipe (prior to the split) as shown in Figure A.6.2(a) being the only control valve that shuts the sprinkler system is preferred because it ensures that people who have running water to their domestic fixtures also have fire protection. This serves as a form of supervision for the control valve and can be used to make sure that the valve stays open in place of other, more expensive options such as tamper switches with monitoring service.

Some water utilities insist on separate taps and supply pipes from the water supply to the dwelling unit for fire sprinkler systems due to concerns about shutting off the water supply for nonpayment of bills and the desire not to shut off fire is

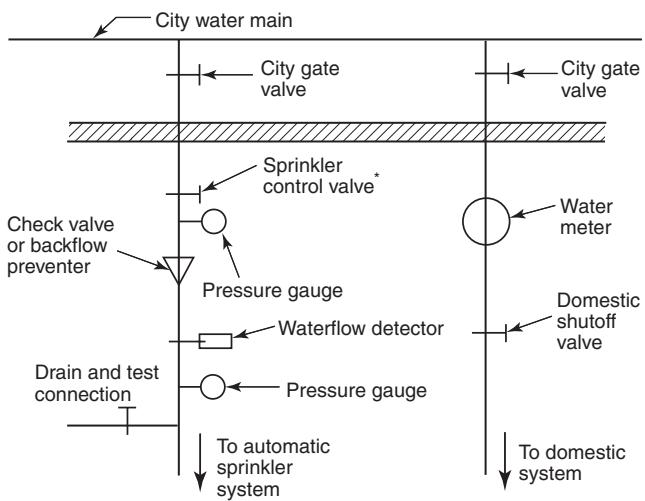

*Optional valve: See 7.1.2.

FIGURE A.6.2(b) Acceptable Arrangement for Stand-Alone Piping Systems with Valve Supervision — Option 1.

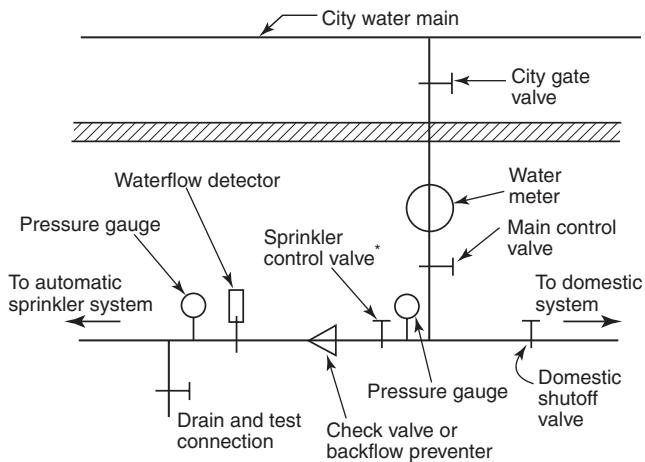

*Optional valve: See 7.1.2.

FIGURE A.6.2(c) Acceptable Arrangement for Stand-Alone Piping Systems with Valve Supervision — Option 2.

acceptable [see Figure A.6.2(b)], it is not cost efficient and should be discouraged due to the extra burden this places on the building owner. The concern over shutting off the water for nonpayment of bills is a nonissue for a number of reasons. First, the water utilities rarely actually shut off water for nonpayment. Second, if they do shut off water for nonpayment, they are creating violations of all sorts of health and safety codes, allowing people to live in a home without running water. Concern over the fire protection for those individuals when they are violating all kinds of other health codes is disingenuous. More likely, the water utility will not shut off the water and will follow other legal avenues to collect on unpaid bills such as liens on property. Millions of people should not have to pay hundreds of millions of dollars to install separate water taps and lines for the few services that might get shut off.

A.6.3 Multipurpose piping systems consist of a single piping system within a residential occupancy that is intended to serve both domestic and fire protection needs. Basic forms of this system are shown in Figure A.6.3(a), Figure A.6.3(b), Figure A.6.3(c), and Figure A.6.3(d). A network system, as defined in 3.3.11.4, is a type of multipurpose system that utilizes a common piping system supplying domestic fixtures and fire sprinklers where each sprinkler is supplied by a minimum of three separate paths. In dwellings where long-term use of lawn sprinklers is common, provision should be made for such usage.

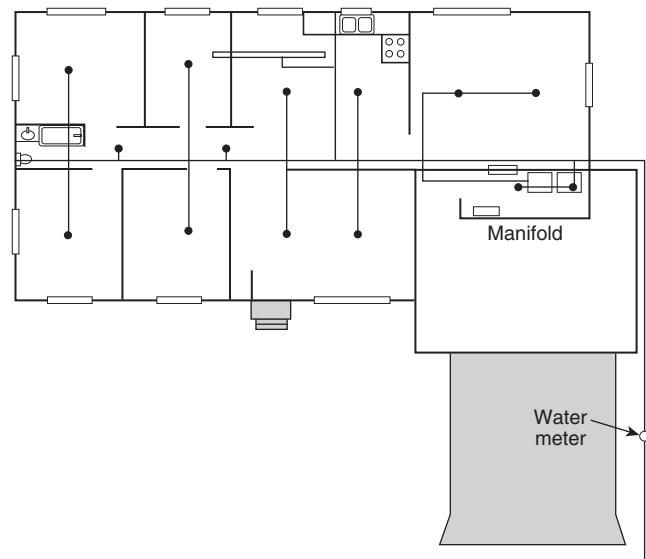


FIGURE A.6.3(a) Multipurpose Piping System (Tree System) — Example 1.

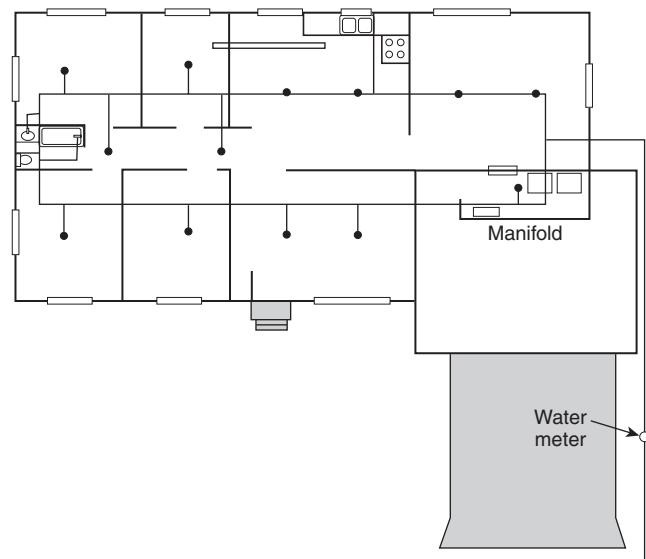


FIGURE A.6.3(b) Multipurpose Piping System (Looped System) — Example 2.

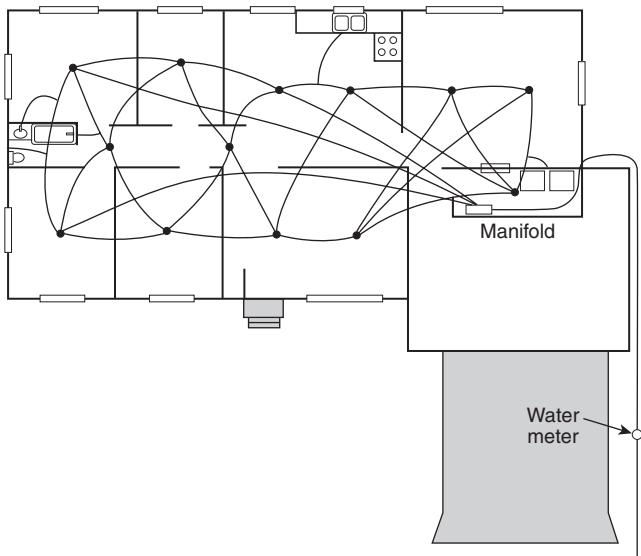


FIGURE A.6.3(c) Multipurpose Piping System — Example 3 (Network System).

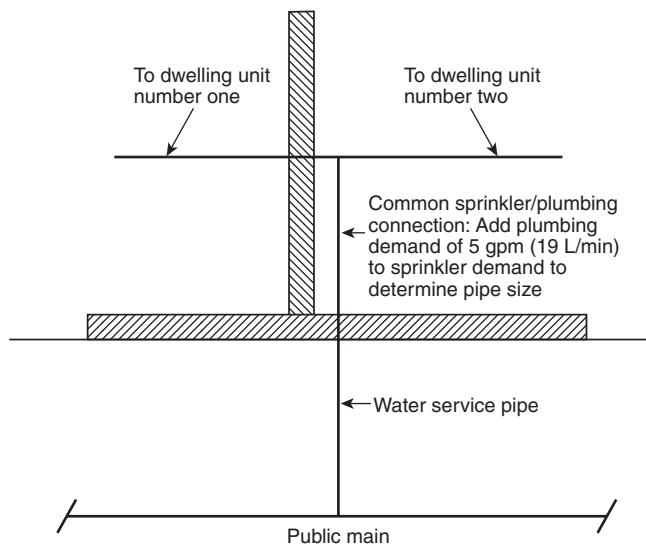


FIGURE A.6.3(d) Common Water Supply Connection Serving More Than One Dwelling Unit.

A.7.2.4 These connections should be installed so that the valve can be opened fully and for a sufficient time period to ensure a proper test without causing water damage. The test connection should be designed and sized to verify the sufficiency of the water supply and alarm mechanisms.

A.7.2.6 Where the pressure-reducing or pressure-regulating valve also serves the domestic water supply, the domestic fixtures in the home serve as the connection for which the device can be tested, but a gauge is still needed downstream to verify valve performance and function.

A.7.4.4 The reaction forces caused by the flow of water through the sprinkler could result in displacement of the sprinkler, thereby adversely affecting sprinkler discharge.

A.7.5.1 See A.10.2.

A.7.5.5 Corrosion-resistant sprinklers should be considered for use in steam rooms.

A.7.5.6.3 Care should be taken in positioning sprinklers in bathrooms near exhaust fan units. Some exhaust fan units have heaters built in to warm up the bathroom, and these units have the potential to activate sprinklers. Combination exhaust fan and heater units should be treated as wall-mounted diffusers for the purposes of using Table 7.5.6.3.

A.7.5.7 Decorative painting of a residential sprinkler is not to be confused with the temperature identification colors as specified in 6.2.5 of NFPA 13.

A.7.6 The waterflow detection device and the audible alarm device do not have to be listed. The local waterflow alarm is intended to be a single alarm audible from the outside of the building. It can be mounted on the outside of the home or within the building close to the outside. This should not limit its use to prevent interior or remote notification. Interconnection with a smoke alarm or remote monitoring might improve notification, but is considered too costly to mandate for every system installed in accordance with this standard. It is not the intent of this standard to require central station monitoring or a fire alarm system.

An exterior alarm can be of benefit in areas where a neighbor could alert the fire department or to enhance the ability for an assisted rescue by a passerby.

A waterflow test is normally conducted using the system drain. Figure A.6.2(a), Figure A.6.2(b), and Figure A.6.2(c) show examples of this arrangement.

A.8.1.3.1.2 See A.10.2.

A.8.2.5 The objective is to position sprinklers so that the response time and discharge are not unduly affected by obstructions such as ceiling slope, beams, light fixtures, or ceiling fans. The rules in this section, while different from the obstruction rules of NFPA 13 provide a reasonable level of life safety while maintaining the philosophy of keeping NFPA 13D relatively simple to apply and enforce.

Fire testing has indicated the need to wet walls in the area protected by residential sprinklers at a level closer to the ceiling than that accomplished by standard sprinkler distribution. Where beams, light fixtures, sloped ceilings, and other obstructions occur, additional residential sprinklers are necessary to achieve proper response and distribution. In addition, for sloped ceilings, higher flow rates could be needed. Guidance should be obtained from the manufacturer.

A series of 33 full-scale tests were conducted in a test room with a floor area of 12 ft × 24 ft (3.6 m × 7.2 m) to determine the effect of cathedral (sloped) and beamed ceiling construction, and combinations of both, on fast-response residential sprinkler performance. The testing was performed using one pendent-type residential sprinkler model, two ceiling slopes (0 degrees and 14 degrees), and two beam configurations on a single enclosure size. In order to judge the effectiveness of sprinklers in controlling fires, two baseline tests, in which the ceiling was smooth and horizontal, were conducted with the pendent sprinklers installed and with a total water supply of 26 gpm (98 L/min) as required by this standard. The results of the baseline tests were compared with tests in which the ceiling was beamed or sloped, or both, and two pendent sprinklers were installed with the same water supply. Under the limited conditions used for testing, the comparison indicates

that sloped or beamed ceilings, or a combination of both, represent a serious challenge to the fire protection afforded by fast-response residential sprinklers. However, further tests with beamed ceilings indicated that fire control equivalent to that obtained in the baseline tests can be obtained where one sprinkler is centered in each bay formed by the beams and a total water supply of 36 gpm (136 L/min) is available. Fire control equivalent to that obtained in the baseline tests was obtained for the smooth, sloped ceiling tests where three sprinklers were installed with a total water supply of 54 gpm (200 L/min). In a single smoldering-started fire test, the fire was suppressed.

- Where the obstruction criteria established by this standard are followed, sprinkler spray patterns will not necessarily get water to every square foot of space within a room. As such, a sprinkler in a room with acceptable obstructions as outlined in this standard might not be capable of passing the fire test (specified by ANSI/UL 1626, *Residential Sprinklers for Fire-Protection Service*, and other similar laboratory standards) if the fire is started in one of these dry areas. This occurrence is not to be interpreted as a failure of the sprinkler. The laboratory fire tests are sufficiently challenging to the sprinkler without additional obstructions as a safety factor to account for the variables that actually occur in dwellings, including acceptable obstructions to spray patterns.

The rules on 8.2.5.2 and 8.2.5.3 were developed from a testing series conducted by the National Fire Sprinkler Association and The Viking Corporation that included fire modeling, sprinkler response tests, sprinkler distribution tests, and full-scale fire tests (Valentine and Isman, *Interaction of Residential Sprinklers, Ceiling Fans and Similar Obstructions*, National Fire Sprinkler Association, November 2005). This test series, along with additional industry experience, shows that a difference exists between obstructions that are tight to the ceiling and obstructions that hang down from the ceiling, allowing spray over the top. Residential sprinklers require high wall wetting, which means that they tend to spray over obstructions that hang down from the ceiling. The test series showed that the fan blades were not significant obstructions and that as long as the sprinkler was far enough from the fan motor housing (measured from the center of the housing), the sprinkler could control a fire on the other side of the fan in a small room. In larger rooms, the sprinkler will need to be augmented by additional sprinklers on the other side of the fan. The test series showed that the fan on low or medium speed did not make a significant difference in sprinkler performance. On high speed (pushing air down), the fan did impact sprinkler performance, but fire control was still achieved in small rooms. In larger rooms, it is expected that additional sprinklers would be installed. The test series also showed that the fan blowing down was more significant than the fan pulling air up.

The rules in 8.2.5.6 were developed from years of experience with obstruction rules and an additional test series conducted by the National Fire Sprinkler Association with the help of Tyco International (Valentine and Isman, *Kitchen Cabinets and Residential Sprinklers*, National Fire Sprinkler Association, November 2005), which included fire modeling, distribution tests, and full-scale fire tests. The test series showed that pendent sprinklers definitely provide protection for kitchens, even for fires that start under the cabinets. The information in the series was less than definitive for sidewall sprinklers, but distribution data show that sprinklers in the positions in this standard provide adequate water distribution in front of the cabinets and that sidewall sprinklers should be able to control a fire that starts under the cabinets. When protecting kitchens or similar rooms with cabinets, the pendent sprinkler should be the first option. If pendent sprinklers cannot be installed, the next best option is a sidewall

sprinkler on the opposite wall from the cabinets, spraying in the direction of the cabinets. The third best option is the sidewall sprinkler on the same wall as the cabinets on a soffit flush with the face of the cabinet. The last option should be putting sprinklers on the wall back behind the face of the cabinet because this location is subject to being blocked by items placed on top of the cabinets. It is not the intent of the committee to require sprinklers to be installed under kitchen cabinets.

A.8.2.5.7 Corridors being protected with sidewall sprinklers will frequently have small areas behind the sprinklers that are inset for a doorway. Even though these areas are slightly behind the sprinklers, it is not the intent of NFPA 13D to require additional sprinkler protection in these doorways.

Examples of shadow areas are provided in Figure A.8.2.5.7(a) and Figure A.8.2.5.7(b).

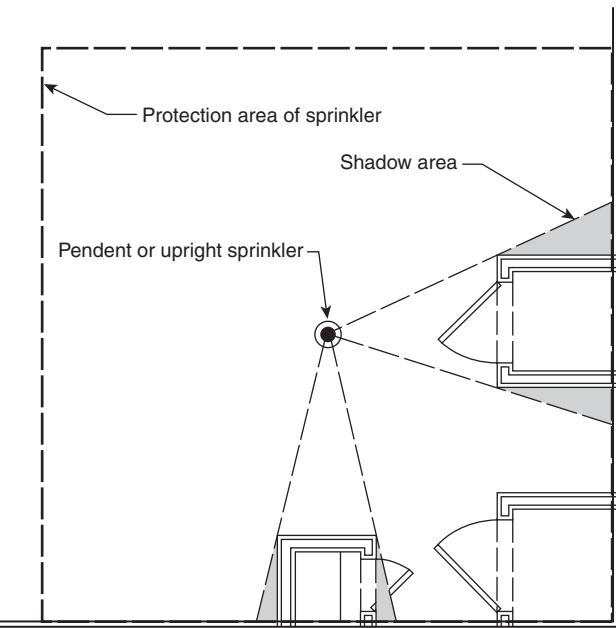


FIGURE A.8.2.5.7(a) Example of Shadow Areas (SSU/SSP).

A.8.2.6 Dry sprinklers must be of sufficient length to avoid freezing of the water-filled pipes due to conduction along the barrel. The values of exposed barrel length in Table 8.2.6.1(a) and Table 8.2.6.1(b) have been developed using an assumption of a properly sealed penetration and an assumed maximum wind velocity on the exposed sprinkler of 30 mph (48 km/h). Where higher wind velocity is expected, longer exposed barrel lengths will help avoid freezing of the wet piping. The total length of the barrel of the dry sprinkler must be longer than the values shown in Table 8.2.6.1(a) and Table 8.2.6.1(b) because the length shown in the tables is the minimum length of the barrel that needs to be exposed to the warmer ambient temperature in the heated space. See Figure A.8.2.6(a) for an example of where to measure the exposed barrel length for a sidewall sprinkler penetrating an exterior wall and Figure A.8.2.6(b) for an example of where to measure the exposed barrel length for a pendent sprinkler penetrating a ceiling or top of a freezer. [See Figure A.8.2.6(c).]

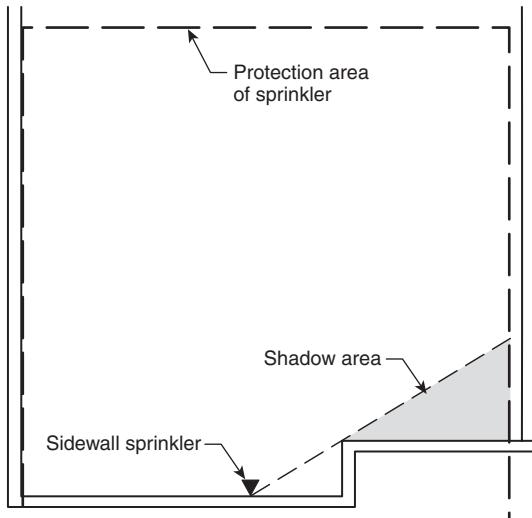


FIGURE A.8.2.5.7(b) Example of Shadow Areas (HSW).


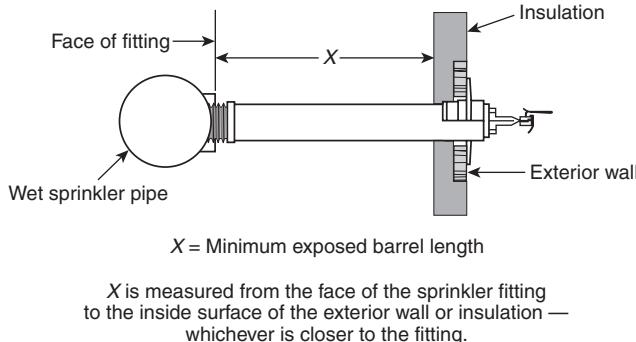


FIGURE A.8.2.6(a) Dry Sidewall Sprinkler Through Wall.

A.8.3.4 Although NFPA 13D does not require garages to be sprinklered, some authorities having jurisdiction take it upon themselves to add this requirement locally. In such circumstances, residential or quick-response sprinklers with a two-sprinkler design in the garage with the same piping used in the rest of the dwelling can be used. It is recognized that residential sprinklers have not been tested specifically for fires in garages, but field experience has shown that the sprinklers help to alert occupants to the fact that there is a fire, to reduce the possibility of flashover, and to improve the chances for occupants to escape.

A.8.3.7(3) It is common to have combustible crown molding as decoration.

A.9.1.1 In areas subject to freezing, care should be taken in unheated attic spaces to cover sprinkler piping completely with insulation. Installation should follow the guidelines of the insulation manufacturer. Figure A.9.1.1(a) through Figure A.9.1.1(e) show several methods that can be considered. These are for illustrative purposes only. Consultation with the general contractor and/or owner is recommended to ensure proper methods and materials are used to make sure 40°F (4°C) will be maintained.

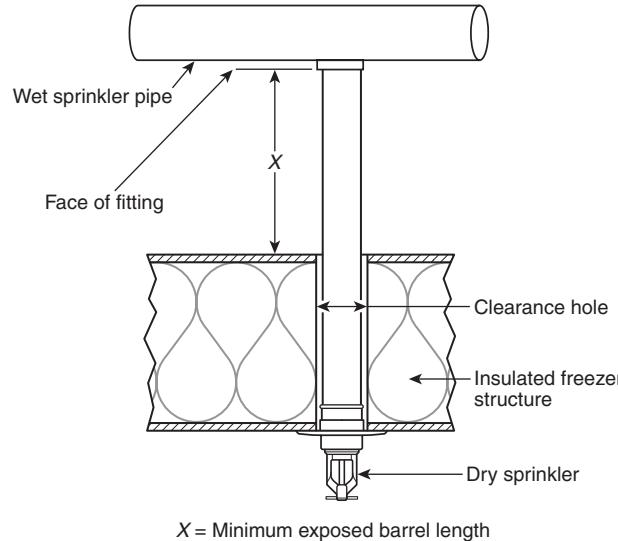

X is measured from the face of the sprinkler fitting to the inside surface of the exterior wall or insulation — whichever is closer to the fitting.

FIGURE A.8.2.6(b) Dry Pendent Sprinkler Through Ceiling or Top of Freezer.

The Fire Protection Research Foundation completed a research project ("Sprinkler Insulation: A Literature Review," July 2011) on the use of insulation to protect sprinkler pipe from freezing that can be downloaded for free from their website.

A.9.1.2(4) Where listed heat tracing is used on CPVC piping, it should be compatible with the CPVC piping.

Annex A to Section 9.2 was revised by a tentative interim amendment (TIA). See page 1.

A.9.2 Where protection of pipes from freezing is a concern, options other than antifreeze are available. Such alternatives include running the piping in warm spaces, tenting insulation over pipe, dry pipe systems, and preaction systems.

A.9.2.1 Antifreeze solutions can be used for maintaining automatic sprinkler protection in small, unheated areas. Antifreeze solutions are recommended only for systems not exceeding 40 gal (151 L).

Because of the cost of refilling the system or replenishing small leaks, small, dry valves should be used where more than 40 gal (151 L) are to be supplied.

Propylene glycol or other suitable material can be used as a substitute for priming water to prevent evaporation of the priming fluid and thus reduce ice formation within the system.

A.9.2.2 Listed nonmetallic sprinkler pipe and fittings should be protected from freezing with an antifreeze solution that is compatible with the nonmetallic material. Laboratory testing shows that glycol-based antifreeze solutions present a chemical environment detrimental to nonmetallic pipe.

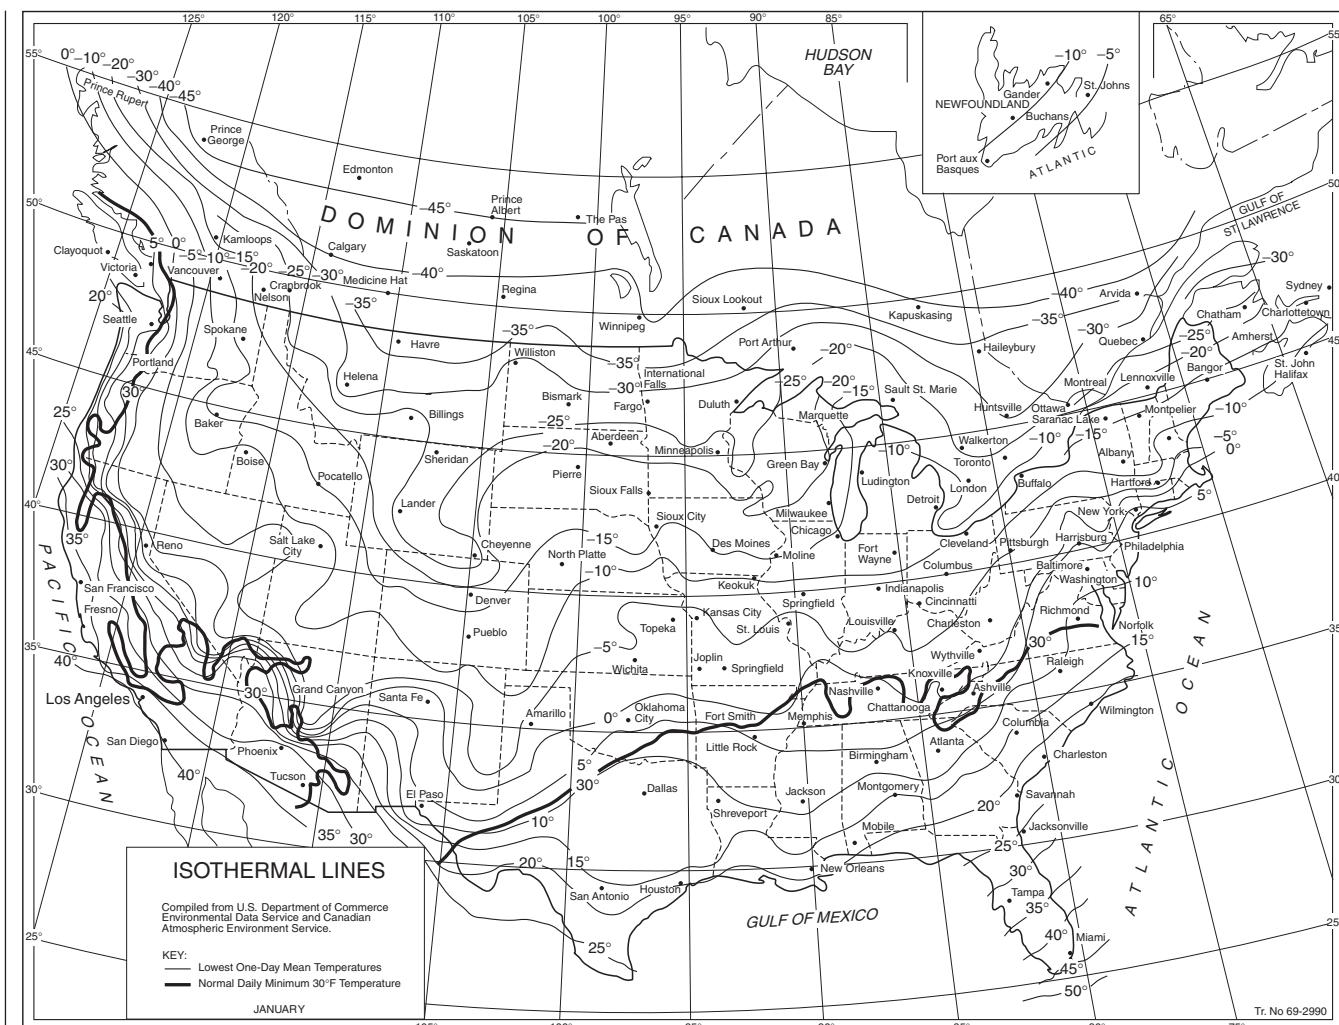


FIGURE A.8.2.6(c) Isothermal Lines — Lowest One-Day Mean Temperature (°F). [24:Figure A.10.5.1]

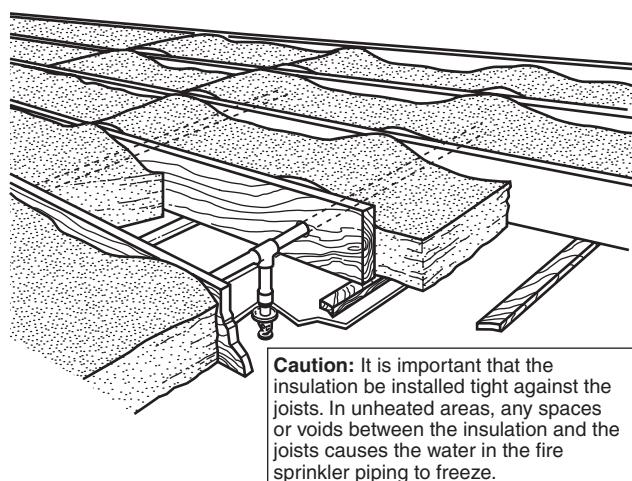


FIGURE A.9.1.1(a) Insulation Recommendations — Arrangement 1.

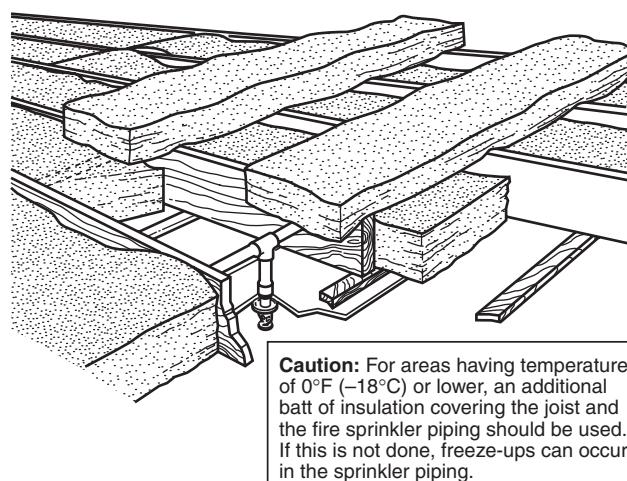


FIGURE A.9.1.1(b) Insulation Recommendations — Arrangement 2.

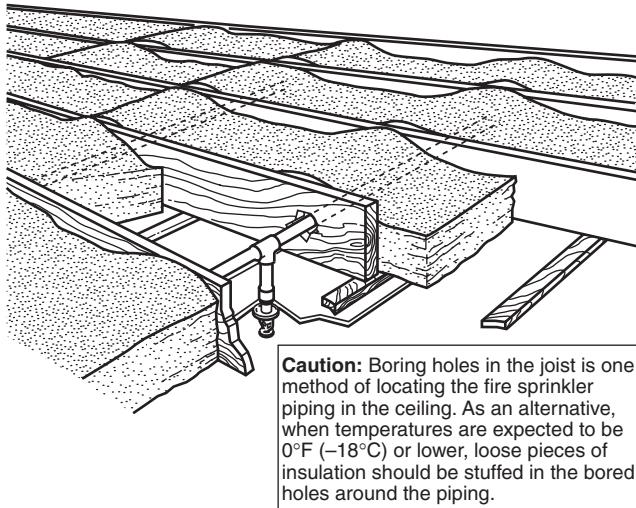


FIGURE A.9.1.1(c) Insulation Recommendations — Arrangement 3.

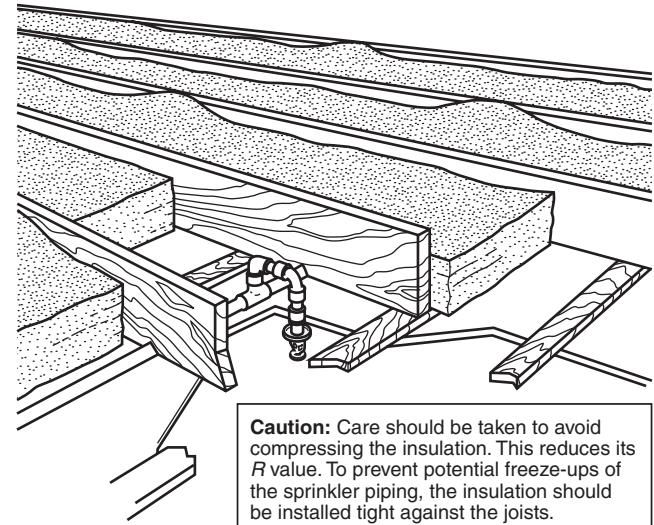


FIGURE A.9.1.1(e) Insulation Recommendations — Arrangement 5.

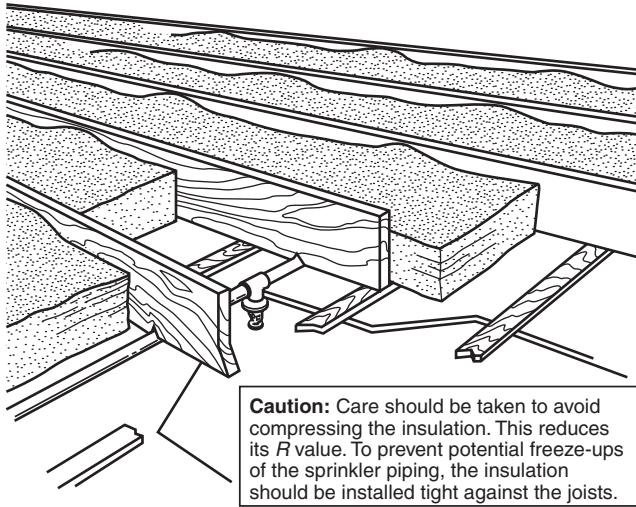


FIGURE A.9.1.1(d) Insulation Recommendations — Arrangement 4.

A.9.2.2.2 Examples of specific areas might include piping installed in an exterior wall or an unheated concealed space above a cathedral ceiling that cannot be protected with insulation or heat tracing. Premixed solutions of glycerine and propylene glycol should be used only where other freeze protection options are not practical. The specific areas protected

by premixed glycerine and propylene glycol shall be limited to the greatest extent possible.

Propylene glycol and glycerine antifreeze solutions discharged from sprinklers have the potential to ignite under certain conditions. Research testing has indicated that several variables can influence the potential for large-scale ignition of the antifreeze solution discharged from a sprinkler. These variables include, but are not limited to, the concentration of antifreeze solution, sprinkler discharge characteristics, the inlet pressure at the sprinkler, the location of the fire relative to the sprinkler, and the size of the fire at the time of sprinkler discharge. Research testing also indicates that propylene glycol or glycerine solutions can be used successfully with certain other combinations of these same variables. Given the need for additional testing to further define acceptable versus unacceptable scenarios, the use of propylene glycol and glycerine antifreeze solutions should be considered only when other sprinkler system design alternatives are not practical. If these solutions are used, all relevant data and information should be carefully reviewed and considered in the sprinkler system. The following is a list of research reports that have been issued by the Fire Protection Research Foundation related to the use of antifreeze in sprinkler systems:

- (1) *Antifreeze Systems in Home Fire Sprinkler Systems — Literature Review and Research Plan*
- (2) *Antifreeze Systems in Home Fire Sprinkler Systems — Phase II Final Report*
- (3) *Antifreeze Solutions Supplied through Spray Sprinklers — Interim Report*

Table A.9.2.2.2 provides an overview of the testing.

Table A.9.2.2.2 FPRF Antifreeze Testing Summary

Topic	Information
Scope of sprinklers tested	<p>The following sprinklers were used during the residential sprinkler research program described in <i>Antifreeze Systems in Home Fire Sprinkler Systems — Phase II Final Report</i>:</p> <ol style="list-style-type: none"> (1) Residential pendent style having nominal K-factors of 3.1, 4.9, and 7.4 gpm/psi^{1/2} (2) Residential concealed pendent style having a nominal K-factor of 4.9 gpm/psi^{1/2} (3) Residential sidewall style having nominal K-factors of 4.2 and 5.5 gpm/psi^{1/2} <p>The following sprinklers were used during the spray sprinkler research program described in <i>Antifreeze Solutions Supplied through Spray Sprinklers — Interim Report</i>:</p> <ol style="list-style-type: none"> (1) Residential pendent style having a nominal K-factor of 3.1 gpm/psi^{1/2} (2) Standard spray pendent style having nominal K-factors of 2.8, 4.2, 5.6, and 8.0 gpm/psi^{1/2} (3) Standard spray concealed pendent style having a nominal K-factor of 5.6 gpm/psi^{1/2} (4) Standard spray upright style having a nominal K-factor of 5.6 gpm/psi^{1/2} (5) Standard spray extended coverage pendent style having a nominal K-factor of 5.6 gpm/psi^{1/2}
Antifreeze solution concentration	<p><50% glycerine and <40% propylene glycol antifreeze solutions: Solutions were not tested.</p> <p>50% glycerine and 40% propylene glycol antifreeze solutions: Large-scale ignition of the sprinkler spray did not occur in tests with sprinkler discharge onto a fire having a nominal heat release rate (HRR) of 1.4 MW. Large-scale ignition of the sprinkler spray occurred in multiple tests with sprinkler discharge onto a fire having a nominal HRR of 3.0 MW.</p> <p>55% glycerine and 45% propylene glycol antifreeze solutions: Large-scale ignition of the sprinkler spray occurred in tests with sprinkler discharge onto a fire having a nominal HRR of 1.4 MW.</p> <p>>55% glycerine and >45% propylene glycol antifreeze solutions: Large-scale ignition of the sprinkler spray occurred in tests with sprinkler discharge onto a fire having an HRR <500 kW.</p> <p>70% glycerine and 60% propylene glycol antifreeze solutions: Maximum antifreeze solution concentrations were tested.</p>
Sprinkler inlet pressure	Large-scale ignition of the sprinkler discharge spray was not observed when the sprinkler inlet pressure was ≤50 psi for tests using 50% glycerine or 40% propylene glycol.
Ceiling height	<p>When 50% glycerine and 40% propylene glycol antifreeze solutions were discharged onto fires having an HRR of 1.4 MW, no large-scale ignition of the sprinkler spray was observed with ceiling heights up to 20 ft.</p> <p>When 50% glycerine and 40% propylene glycol antifreeze solutions were discharged onto fires having an HRR of 3.0 MW, large-scale ignition of the sprinkler spray was observed at a ceiling height of 20 ft.</p>
Fire control	<p>The test results described in <i>Antifreeze Systems in Home Fire Sprinkler Systems — Phase II Final Report</i> and <i>Antifreeze Solutions Supplied through Spray Sprinklers — Interim Report</i> indicated that discharging glycerine and propylene glycol antifreeze solutions onto a fire can temporarily increase the fire size until water is discharged.</p> <p>As a part of the residential sprinkler research described in <i>Antifreeze Systems in Home Fire Sprinkler Systems — Phase II Final Report</i>, tests were conducted to evaluate the effectiveness of residential sprinklers to control fires involving furniture and simulated furniture. The results of those tests indicated that 50% glycerine and 40% propylene glycol antifreeze solutions demonstrated the ability to control the furniture-type fires in a manner similar to water.</p> <p>For standard spray-type sprinklers, no tests were conducted to investigate the ability of those sprinklers to control the types and sizes of fires they are intended to protect.</p>