

NFPA[®] 69

Standard on Explosion Prevention Systems

2024 Edition



NFPA, 1 Batterymarch Park, Quincy, MA 02169-7471
An International Codes and Standards Organization

IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

NFPA® codes, standards, recommended practices, and guides (“NFPA Standards”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

REVISION SYMBOLS IDENTIFYING CHANGES FROM THE PREVIOUS EDITION

Text revisions are shaded. A **Δ** before a section number indicates that words within that section were deleted and a **Δ** to the left of a table or figure number indicates a revision to an existing table or figure. When a chapter was heavily revised, the entire chapter is marked throughout with the **Δ** symbol. Where one or more sections were deleted, a **•** is placed between the remaining sections. Chapters, annexes, sections, figures, and tables that are new are indicated with an **N**.

Note that these indicators are a guide. Rearrangement of sections may not be captured in the markup, but users can view complete revision details in the First and Second Draft Reports located in the archived revision information section of each code at www.nfpa.org/docinfo. Any subsequent changes from the NFPA Technical Meeting, Tentative Interim Amendments, and Errata are also located there.

REMINDER: UPDATING OF NFPA STANDARDS

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

ADDITIONAL IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

NOTICE: The user’s attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: stds_admin@nfpa.org.

For more information about NFPA, visit the NFPA website at www.nfpa.org. All NFPA codes and standards can be viewed at no cost at www.nfpa.org/docinfo.

NFPA® 69**Standard on****Explosion Prevention Systems****2024 Edition**

This edition of NFPA 69, *Standard on Explosion Prevention Systems*, was prepared by the Technical Committee on Explosion Protection Systems. It was issued by the Standards Council on December 1, 2023, with an effective date of December 21, 2023, and supersedes all previous editions.

This edition of NFPA 69 was approved as an American National Standard on December 21, 2023.

Origin and Development of NFPA 69

In 1965, an NFPA committee was appointed to develop standards for explosion protection systems. These standards included information on inerting to prevent explosions and on venting to minimize damage from an explosion.

A tentative draft on explosion prevention systems was presented at the NFPA Annual Meeting in New York City in May 1969. This tentative document was officially adopted in May 1970. NFPA 69 was revised in 1973 and reconfirmed in 1978.

In 1982, the Committee on Explosion Protection Systems began a thorough review of NFPA 69, including the development of a chapter on the technique of deflagration pressure containment. The results of that effort became the 1986 edition.

The 1992 edition of NFPA 69 incorporated a new chapter on deflagration isolation systems. Partial amendments were made to refine definitions, improve descriptions of oxidant concentration reduction techniques, improve material on deflagration suppression, and fine-tune deflagration pressure containment material.

The 1997 edition of this standard included some reorganization and updating of the technical material to improve its usability. New material was added on enrichment to operate above the upper flammable limit as a means of explosion protection with minimum oxidant concentrations for preventing explosions. Material was added for provisions on reliability of explosion protection control systems and deflagration suppression systems for consistency with other NFPA standards.

The 2002 edition of NFPA 69 included new information on spark detection and extinguishment system design. A reorganization of the protection methods reflected a hierarchy based on the degree of explosion prevention. The limiting oxidant concentration (LOC) values for gases and vapors in Annex C were updated based on recent research. The standard was revised to reflect the requirements of the *Manual of Style for NFPA Technical Committee Documents*.

The 2008 edition incorporated a comprehensive revision to the standard that included a performance-based option in addition to the existing specification methods for explosion prevention. This revision included new requirements for detection and ignition control, suppression, and active and passive isolation. The committee also added a chapter on passive suppression using expanded metal mesh or polymer foams. A new chapter on installation, inspection, and maintenance addressed the concept of safety integrity and reliability. New definitions supporting the expanded requirements were added, and existing definitions were updated to conform to the *NFPA Glossary of Terms*.

The 2014 edition was revised and updated to improve the overall clarity and use of the document. Design requirements for flow-actuated flap valves and a new annex, Deflagration Containment Calculation Method for Two Interconnected Vessels, were incorporated. The operating safety margins for oxidant concentration control were also modified in order to remove discontinuity. In addition, the use of the term *commissioning* was updated throughout the document for compatibility with the 2012 edition of NFPA 3, *Recommended Practice for Commissioning and Integrated Testing of Fire Protection and Life Safety Systems*.

In the 2019 edition, the adjustment for LOC values obtained in flammability tubes was revised, reconfirming the change made by a Tentative Interim Amendment (TIA) to the 2014 edition. Requirements were added to consider the concentration variation with time and location within the protected enclosure, and all foreseeable variations in operating conditions and material loadings, when using the combustible concentration reduction method of explosion prevention. A new section on safety instrumented systems (SIS) was added with the requirement that explosion prevention system controls installed after November 5, 2021, be implemented as an SIS. New annex material was added to provide example calculations on how to estimate the LOC for a fuel or a fuel mixture.

The 2024 edition clarifies how the chapters are used in combination to achieve explosion prevention and standardizes terminology and requirements for automatic shutdown and orderly shutdown. Requirements were added for dust flame-arresting devices, and requirements for safety instrumented systems have been revised to clarify when they are or are not listed for explosion prevention service, and to permit different levels of protection when determined by a risk evaluation. Language has been added to address the effect of elevated temperatures on close-clearance rotary valves, and battery backup requirements for control panels were revised. All inspection, testing, and maintenance requirements for various types of equipment have been consolidated into Chapter 15.

Technical Committee on Explosion Protection Systems

Thomas C. Scherpa, *Chair*
DuPont, NH [U]

Sumit Anand, BASF Corporation, TX [U]
C. Regis Bauwens, FM Global, MA [I]
 Rep. FM Global
Geof Brazier, BS&B Safety Systems, LLC, OK [M]
Daniel Bustamante, FNX-INNOV, Canada [SE]
Martin P. Clouthier, JENSEN HUGHES, Canada [SE]
William V. F. Cosey, Savannah River Nuclear Solutions, LLC, SC [U]
Michael Davies, PROTEGO, Germany [M]
Randal R. Davis, IEP Technologies/HOERBIGER, MA [M]
Nathan R. Egbert, Schenck Process LLC, MO [SE]
Walter L. Frank, Frank Risk Solutions, Inc., PA [SE]
Richard G. Fredenburg, State of North Carolina, NC [E]
 Rep. International Fire Marshals Association
Dan A. Guaricci, ATEX Explosion Protection, L.P., FL [M]
Michael D. Hard, Hard Fire Suppression Systems, Inc., OH [M]
 Rep. Fire Suppression Systems Association
Alfonso F. Ibarreta, Exponent, Inc., MA [SE]
Jason Krbec, CV Technology, Inc., FL [M]
Tae H. Lee, Consolidated Nuclear Security, TN [U]
Robert A. Leishear, Leishear Engineering LLC, SC [SE]
Joyce Miles, ExxonMobil Research & Engineering, TX [U]
 Rep. American Petroleum Institute

Farai Oliver Mvere, Nordson Corporation, OH [M]
Niels H. Pedersen, Nederman LLC, NC [M]
Alvin Grant Roach, Professional Loss Control Inc., Canada [SE]
Michael Rons, Schaumburg Fire Department-Village of Schaumburg, IL [E]
Nicholas P. Schlentz, Boss Products LLC, TX [M]
Bashir Shaikh, New York City Department of Buildings, NY [E]
Cleveland B. Skinker, Bechtel Infrastructure and Power Corporation, VA [SE]
Jeremy Slaunwhite, Rembe Inc., Canada [M]
David R. Stottmann, CST Storage, KS [M]
Jeffery W. Sutton, TUV SUD America Inc./Global Risk Consultants Corporation, MN [SE]
James Kelly Thomas, Baker Engineering & Risk Consultants, Inc., TX [SE]
David E. Trull, AXA XL/Global Asset Protection Services, LLC, WA [I]
Andrew Tworek, Fike Corporation, MO [M]
Tod Allen Webb, Ingredion, MO [U]
 Rep. NFPA Industrial Fire Protection Section

Alternates

Monir Ahammad, BASF Corporation, MI [U]
 (Alt. to Sumit Anand)
Kamal M. Aljazireh, JENSEN HUGHES, IL [SE]
 (Alt. to Martin P. Clouthier)
Marius Bloching, Rembe GmbH Safety+Control, Germany [M]
 (Alt. to Jeremy Slaunwhite)
Alan Cummings, Ingredion, IL [U]
 (Alt. to Tod Allen Webb)
Burke Desautels, IEP Technologies/Hoerbiger, MA [M]
 (Alt. to Randal R. Davis)
Todd A. Dillon, AXA XL/Global Asset Protection Services, LLC, OH [I]
 (Alt. to David E. Trull)
Warren Greenfield, WG Associates LLC, NJ [SE]
 (Voting Alt.)
Edward M. Hawthorne, DFW Dynamics, TX [U]
 (Alt. to Joyce Miles)
Thomas Heidermann, Braunschweiger Flammenfilter G, Germany [M]
 (Alt. to Michael Davies)
Manuel Herce, DuPont de Nemours, Inc., DE [U]
 (Alt. to Thomas C. Scherpa)

Kirk W. Humbrecht, Phoenix Fire Systems, Inc., IL [M]
 (Alt. to Michael D. Hard)
Edward L. Jones, Nordson Corporation, OH [M]
 (Alt. to Farai Oliver Mvere)
David C. Kirby, Baker Engineering & Risk Consultants, Inc., WV [SE]
 (Alt. to James Kelly Thomas)
John A. LeBlanc, FM Global, MA [I]
 (Alt. to C. Regis Bauwens)
Keith McGuire, CST Storage, KS [M]
 (Alt. to David R. Stottmann)
Timothy J. Myers, Exponent, Inc., MA [SE]
 (Alt. to Alfonso F. Ibarreta)
David M. Nieman, Bechtel Corporation, VA [SE]
 (Alt. to Cleveland B. Skinker)
Dan Rousseau, Nederman, LLC, NC [M]
 (Alt. to Niels H. Pedersen)
Jerry Ruch, Honeywell International, LA [U]
 (Voting Alt.)

Nonvoting

Laurence G. Britton, Process Safety Consultant, WV [SE]
Vladimir Molkov, University of Ulster, Northern Ireland, UK [SE]
Laura E. Moreno, NFPA Staff Liaison

Jonathan William Russell, Occupational Safety & Health Administration (OSHA), DC [E]

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on explosion protection systems for all types of equipment and for buildings, except pressure venting devices designed to protect against overpressure of vessels such as those containing flammable liquids, liquefied gases, and compressed gases under fire exposure conditions, as now covered in existing NFPA standards.

Contents

Chapter 1 Administration	69– 7	Chapter 10 Deflagration Control by Suppression	69– 19
1.1 Scope.	69– 7	10.1 Application.	69– 19
1.2 Purpose.	69– 7	10.2 Limitations.	69– 19
1.3 Application.	69– 7	10.3 Personnel Safety.	69– 19
1.4 Retroactivity.	69– 8	10.4 Basic Design Considerations.	69– 19
1.5 Equivalency.	69– 8	10.5 Control Panels.	69– 20
Chapter 2 Referenced Publications	69– 8	10.6 Detection Devices.	69– 21
2.1 General.	69– 8	10.7 Electrically Operated Actuating Devices.	69– 21
2.2 NFPA Publications.	69– 8	10.8 Suppressant and Suppressant Storage Containers.	69– 21
2.3 Other Publications.	69– 8	Chapter 11 Deflagration Control by Active Isolation	69– 21
2.4 References for Extracts in Mandatory Sections. ...	69– 9	11.1 Application.	69– 21
Chapter 3 Definitions	69– 9	11.2 Isolation Techniques.	69– 21
3.1 General.	69– 9	11.3 Personnel Safety.	69– 23
3.2 NFPA Official Definitions.	69– 9	11.4 Basic Design and Operation.	69– 23
3.3 General Definitions.	69– 9	11.5 Detection Devices.	69– 25
Chapter 4 General Requirements	69– 11	11.6 Electrically Operated Actuating Devices.	69– 25
4.1 Goal.	69– 11	11.7 Control Panels.	69– 25
4.2 Objectives.	69– 11	Chapter 12 Deflagration Control by Passive Isolation	69– 25
4.3 Compliance Options.	69– 11	12.1 Application.	69– 25
Chapter 5 Performance-Based Design Option	69– 11	12.2 Passive Isolation Techniques.	69– 25
5.1 General Requirements.	69– 11	Chapter 13 Deflagration Control by Pressure Containment	69– 33
5.2 Performance Criteria.	69– 12	13.1 Application.	69– 33
Chapter 6 General Prescriptive Requirements	69– 12	13.2 Design Limitations.	69– 33
6.1 Methods.	69– 12	13.3 Design Bases.	69– 33
6.2 Limitations.	69– 12	13.4 Maintenance.	69– 34
6.3 Factors to Be Considered.	69– 12	Chapter 14 Passive Explosion Suppression Using Expanded Metal Mesh or Polymer Foams	69– 34
6.4 Plans.	69– 12	14.1 Applications.	69– 34
6.5 System Acceptance.	69– 12	14.2 Foam and Mesh Requirements.	69– 34
6.6 Inspection and Maintenance.	69– 13	14.3 Expanded Metal Mesh and Polymer Foam Explosion Suppression Testing.	69– 35
6.7 Housekeeping.	69– 13	14.4 Expanded Metal Mesh or Polymer Foam Installations.	69– 36
Chapter 7 Deflagration Prevention by Oxidant Concentration Reduction	69– 13	14.5 Expanded Metal Mesh or Polymer Foam Maintenance and Replacement.	69– 36
7.1 Application.	69– 13	Chapter 15 Installation, Inspection, and Maintenance of Explosion Prevention Systems	69– 36
7.2 Design and Operating Requirements.	69– 13	15.1 General.	69– 36
7.3 Purge Gas Sources.	69– 14	15.2 Installation.	69– 36
7.4 Purge Gas Conditioning.	69– 14	15.3 Mechanical Installation.	69– 37
7.5 Piping Systems.	69– 14	15.4 Agent, Agent Storage Containers, Automatic Fast-Acting Valves, Flame Arresters, and Flame Front Diverters.	69– 37
7.6 Application of Purge Gas at Points of Use.	69– 15	15.5 Electrical Installation.	69– 37
7.7 Instrumentation.	69– 15	15.6 System Acceptance.	69– 38
Chapter 8 Deflagration Prevention by Combustible Concentration Reduction	69– 15	15.7 Inspection and Testing.	69– 38
8.1 Application.	69– 15	15.8 Procedures Following System Actuation.	69– 40
8.2 Basic Design Considerations.	69– 15	15.9 Recordkeeping.	69– 40
8.3 Design and Operating Requirements.	69– 16	15.10 Personnel Safety and Training.	69– 40
8.4 Instrumentation.	69– 16	15.11 Management of Change.	69– 40
Chapter 9 Predeflagration Detection and Control of Ignition Sources	69– 16	15.12 Maintenance.	69– 41
9.1 Application.	69– 16	Annex A Explanatory Material	69– 41
9.2 Limitations.	69– 17	Annex B Control of Flammable Gas Mixtures by Oxidant Concentration Reduction and Combustible Concentration Reduction	69– 65
9.3 Optical Sensing System and Gas Sensing System Design Considerations.	69– 17	Annex C Limiting Oxidant Concentrations	69– 73
9.4 Testing.	69– 17		
9.5 Protection System Design and Operation.	69– 18		
9.6 System Manufacturer's Additional Responsibilities.	69– 18		
9.7 Actuation of Other Devices and Systems.	69– 18		
9.8 Process Shutdown.	69– 18		

Annex D	Ventilation Calculations	69– 78	Annex H	Informational References	69– 89
Annex E	Purging Methods	69– 80	Index		69– 93
Annex F	Flame Arresters	69– 82			
Annex G	Deflagration Containment Calculation Method for Two Interconnected Vessels	69– 88			

NFPA 69

Standard on

Explosion Prevention Systems

2024 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading “Important Notices and Disclaimers Concerning NFPA Standards.” They can also be viewed at www.nfpa.org/disclaimers or obtained on request from NFPA.

UPDATES, ALERTS, AND FUTURE EDITIONS: New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with all TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by TIAs or Errata, please consult the National Fire Codes® Subscription Service or the “List of NFPA Codes & Standards” at www.nfpa.org/docinfo. In addition to TIAs and Errata, the document information pages also include the option to sign up for alerts for individual documents and to be involved in the development of the next edition.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced and extracted publications can be found in Chapter 2 and Annex H.

Chapter 1 Administration

1.1 Scope. This standard applies to the design, installation, operation, maintenance, and testing of systems for the prevention of explosions by means of the following methods:

- (1) Control of oxidant concentration
- (2) Control of combustible concentration
- (3) Predeflagration detection and control of ignition sources
- (4) Explosion suppression
- (5) Active isolation
- (6) Passive isolation
- (7) Deflagration pressure containment
- (8) Passive explosion suppression

1.2 Purpose.

1.2.1 This standard shall cover the minimum requirements for installing systems for the prevention of explosions in enclosures that contain flammable concentrations of flammable gases, vapors, mists, dusts, or hybrid mixtures.

1.2.2 This standard shall provide basic information for design engineers, operating personnel, and authorities having jurisdiction.

1.2.3* To meet a minimum level of reliability, explosion prevention and control systems provided in accordance with the requirements of this standard shall include, but not be limited to, the following:

- (1) Design system verification through testing
- (2) Design documentation
- (3) System acceptance
- (4) Management of change
- (5) Regular testing and maintenance

1.3* Application. This standard shall apply to methods for achieving explosion prevention where the need for prevention has been established.

Δ 1.3.1 Where provided, explosion prevention shall be achieved by the requirements in Chapter 4 and one of the following:

- (1) Chapter 5
- (2) Chapter 6 plus one or more of the following:
 - (a) Using the methods in Chapters 7, 8, or 9 to control the environment within the protected enclosure to prevent a deflagration
 - (b) Using the methods in Chapters 10, 13, or 14 or in NFPA 68 to limit the consequences of a deflagration and the methods in Chapters 11 and 12 to limit propagation of a deflagration

1.3.1.1* When another standard requires explosion prevention or control in accordance with NFPA 69 for an enclosure and that enclosure is interconnected to other enclosures by a line containing combustible dust, gas, mist, or hybrid mixtures that could transmit flame or pressure from the original enclosure, explosion prevention or control shall be provided for interconnected enclosures by one of the following methods:

- (1) Deflagration isolation as discussed in Chapters 11 and 12
- (2) Explosion venting of the interconnected enclosures within the limitations specified in Section 8.10 of NFPA 68
- (3) Containment as discussed in Chapter 13
- (4) Expanded metal mesh or polymer foam as discussed in Chapter 14

1.3.1.2 It shall be permitted to eliminate deflagration isolation protection for interconnected enclosures based on a documented risk analysis acceptable to the authority having jurisdiction, unless isolation protection is specifically required for such enclosure by other standards.

1.3.2 This standard shall not apply to the following conditions:

- (1) Devices or systems designed to protect against detonations
- (2)* Design, construction, and installation of deflagration vents
- (3) Protection against overpressure due to phenomena other than internal deflagrations
- (4) Chemical reactions other than combustion processes
- (5) Unconfined deflagrations, such as open-air or vapor cloud explosions
- (6) Rock dusting of coal mines, as covered by 30 CFR 75
- (7) General use of inert gas for fire extinguishment

- (8)* Preparation of tanks, piping, or other enclosures for hot work, such as cutting and welding
- (9) Ovens or furnaces handling flammable or combustible atmospheres, as covered by NFPA 86
- (10) Marine vapor control systems regulated by 33 CFR 154
- (11) Marine vessel tanks regulated by 46 CFR 30, 46 CFR 32, 46 CFR 35, and 46 CFR 39

1.4 Retroactivity. The provisions of this standard reflect a consensus of what is necessary to provide an acceptable degree of protection from the hazards addressed in this standard at the time the standard was issued.

1.4.1 Unless otherwise specified, the provisions of this standard shall not apply to facilities, equipment, structures, or installations that existed or were approved for construction or installation prior to the effective date of the standard. Where specified, the provisions of this standard shall be retroactive.

1.4.2 In those cases where the authority having jurisdiction determines that the existing situation presents an unacceptable degree of risk, the authority having jurisdiction shall be permitted to apply retroactively any portions of this standard deemed appropriate.

1.4.3 The retroactive requirements of this standard shall be permitted to be modified if their application clearly would be impractical in the judgment of the authority having jurisdiction, and only where it is clearly evident that a reasonable degree of safety is provided.

1.5 Equivalency. Nothing in the standard is intended to prevent the use of systems, methods, or devices of equivalent or superior quality, strength, fire resistance, effectiveness, durability, and safety over those prescribed by this standard.

1.5.1 Technical documentation shall be submitted to the authority having jurisdiction to demonstrate equivalency.

1.5.2 The system, method, or device shall be approved for the intended purpose by the authority having jurisdiction.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

2.2 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 61, *Standard for the Prevention of Fires and Dust Explosions in Agricultural and Food Processing Facilities*, 2020 edition.

NFPA 68, *Standard on Explosion Protection by Deflagration Venting*, 2023 edition.

NFPA 70®, *National Electrical Code*®, 2023 edition.

NFPA 72®, *National Fire Alarm and Signaling Code*®, 2022 edition.

NFPA 86, *Standard for Ovens and Furnaces*, 2023 edition.

NFPA 326, *Standard for the Safeguarding of Tanks and Containers for Entry, Cleaning, or Repair*, 2020 edition.

NFPA 484, *Standard for Combustible Metals*, 2022 edition.

NFPA 654, *Standard for the Prevention of Fire and Dust Explosions from the Manufacturing, Processing, and Handling of Combustible Particulate Solids*, 2020 edition.

2.3 Other Publications.

2.3.1 ANSI Publications. American National Standards Institute, Inc., 25 West 43rd Street, 4th Floor, New York, NY 10036.

ANSI/ISA 61511, *Parts 1-3, Functional Safety: Safety Instrumented Systems for the Process Industry Sector*, 2004.

2.3.2 API Publications. American Petroleum Institute, 200 Massachusetts Avenue, NW, Suite 1100, Washington, DC 20001-5571.

API 510, *Pressure Vessel Inspection Code: In-Service Inspection, Rating, Repair, and Alteration*, 2022.

2.3.3 ASME Publications. American Society of Mechanical Engineers, Two Park Avenue, New York, NY 10016-5990.

ASME B31.3, *Process Piping*, 2022.

Boiler and Pressure Vessel Code, 2023.

2.3.4 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM D257, *Standard Test Methods for DC Resistance or Conductance of Insulating Materials*, 2014 (reapproved 2021) e1.

ASTM D3574, *Standard Test Methods for Flexible Cellular Materials — Slab, Bonded, and Molded Urethane Foams*, 2017.

ASTM E1354, *Standard Test Method for Heat and Visible Smoke Release Rates for Materials and Products Using an Oxygen Consumption Calorimeter*, 2023.

ASTM E2079, *Standard Test Methods for Limiting Oxygen (Oxidant) Concentration in Gases and Vapors*, 2019.

2.3.5 ISO Publications. International Organization for Standardization, ISO Central Secretariat, BIBC II, Chemin de Blandonnet 8, CP 401, 1214 Vernier, Geneva, Switzerland.

ISO 16852, *Flame arresters — Performance requirements, test methods and limits for use*, 2016.

2.3.6 Military Specifications. US Department of Defense Single Stock Point, Document Automation and Production Service, Building 4/D, 700 Robbins Avenue, Philadelphia, PA 19111-5094.

MIL-DTL-83054C, *Baffle and Inerting Material, Aircraft Fuel Tank*, 2003.

MIL-PRF-87260B, *Foam Material, Explosion Suppression, Inherently Electrostatically Conductive, for Aircraft Fuel Tanks*, 2006.

2.3.7 US Government Publications. US Government Publishing Office, 732 North Capitol Street, NW, Washington, DC 20401-0001.

Title 29, Code of Federal Regulations, Part 1910.146, “Permit-Required Confined Spaces.”

Title 29, Code of Federal Regulations, Part 1910.147, “The Control of Hazardous Energy (Lockout/Tagout).”

Title 30, Code of Federal Regulations, Part 75, “Mandatory Safety Standards — Underground Coal Mines.”

Title 33, Code of Federal Regulations, Part 154, “Facilities Transferring Oil or Hazardous Materials in Bulk.”

Title 46, Code of Federal Regulations, Part 30, “General Provisions.”

Title 46, Code of Federal Regulations, Part 32, “Special Equipment, Machinery, and Hull Requirements.”

Title 46, Code of Federal Regulations, Part 35, “Operations.”

Title 46, Code of Federal Regulations, Part 39, “Vapor Control Systems.”

Title 49, Code of Federal Regulations, Part 173.24, “General Requirements for Packagings and Packages.”

2.3.8 Other Publications.

Bartknecht, W., *Explosions: Course, Prevention, Protection*, Springer-Verlag, Heidelberg, Germany, 1989.

Merriam-Webster's Collegiate Dictionary, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2020.

2.4 References for Extracts in Mandatory Sections.

NFPA 68, *Standard on Explosion Protection by Deflagration Venting*, 2023 edition.

NFPA 72®, *National Fire Alarm and Signaling Code*®, 2022 edition.

NFPA 302, *Fire Protection Standard for Pleasure and Commercial Motor Craft*, 2020 edition.

NFPA 497, *Recommended Practice for the Classification of Flammable Liquids, Gases, or Vapors and of Hazardous (Classified) Locations for Electrical Installations in Chemical Process Areas*, 2021 edition.

NFPA 652, *Standard on the Fundamentals of Combustible Dust*, 2019 edition.

Chapter 3 Definitions

3.1 General.

3.1.1 The definitions contained in this chapter shall apply to the terms used in this standard.

3.1.2 Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used.

3.1.3 Merriam-Webster's Collegiate Dictionary, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1* Approved. Acceptable to the authority having jurisdiction.

3.2.2* Authority Having Jurisdiction (AHJ). An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

3.2.3 Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

3.2.4* Listed. Equipment, materials, or services included in a list published by an organization that is acceptable to the

authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

3.2.5 Shall. Indicates a mandatory requirement.

3.2.6 Should. Indicates a recommendation or that which is advised but not required.

3.2.7 Standard. An NFPA standard, the main text of which contains only mandatory provisions using the word “shall” to indicate requirements and that is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered a part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA manuals of style. When used in a generic sense, such as in the phrase “standards development process” or “standards development activities,” the term “standards” includes all NFPA standards, including codes, standards, recommended practices, and guides.

3.3 General Definitions.

3.3.1 Blanketing (or Padding). The technique of maintaining an atmosphere that is either inert or fuel-enriched in the vapor space of a container or vessel.

3.3.2 Burning Velocity.

3.3.2.1 Flame Burning Velocity. The burning velocity of a laminar flame under specified conditions of composition, temperature, and pressure for unburned gas.

3.3.2.2 Fundamental Burning Velocity. The burning velocity of a laminar flame under stated conditions of composition, temperature, and pressure of the unburned gas. [68, 2023]

3.3.3 Combustible. Capable of undergoing combustion.

3.3.4* Combustible Dust. A finely divided combustible particulate solid, including combustible fibers/flyings, that presents a flash fire hazard or explosion hazard when suspended in air or the process-specific oxidizing medium over a range of concentrations [652, 2019].

3.3.5* Combustible Particulate Solid. An oxidizable, solid-phase material comprising distinct particles or pieces.

3.3.6 Combustion. A chemical process of oxidation that occurs at a rate fast enough to produce heat and usually light in the form of either a glow or flame.

3.3.7 Concentration Reduction.

3.3.7.1 Combustible Concentration Reduction. The technique of maintaining the concentration of combustible material in a closed space below the lower flammable limit.

3.3.7.2 Oxidant Concentration Reduction. The technique of maintaining the concentration of an oxidant in a closed space below the concentration required for ignition to occur.

3.3.8 Deflagration. Propagation of a combustion zone at a velocity that is less than the speed of sound in the unreacted medium. [68, 2023]

3.3.9 Deflagration Pressure Containment. The technique of specifying the design pressure of a vessel and its appurtenances so they are capable of withstanding the maximum pressures resulting from an internal deflagration.

3.3.10 Deflagration Suppression. The technique of detecting and arresting combustion in a confined space while the combustion is still in its incipient stage, thus preventing the development of pressures that could result in an explosion.

Δ 3.3.11 Detonation. Propagation of a combustion zone at a velocity greater than the speed of sound in the unreacted medium. [68, 2023]

N 3.3.12* Dust Flame-Arresting Device. A device that prevents the transmission of a flame and burning dust through a heat dissipating and filtering medium.

3.3.13 Enclosure. A confined or partially confined volume. [68, 2023]

3.3.14 Enclosure Strength (P_{es}). Up to two-thirds the ultimate strength for low-strength enclosures; for high-strength enclosures the enclosure design pressure sufficient to resist P_{red} . [68, 2023]

3.3.15 Explosion. The bursting or rupture of an enclosure or a container due to the development of internal pressure from a deflagration.

3.3.16 Fast-Acting Valve. A valve that closes a path of deflagration propagation in a pipe or duct in response to upstream detection of a deflagration.

3.3.17* Flame Arrester. A device that prevents the transmission of a flame through a flammable gas/air mixture by quenching the flame on the surfaces of an array of small passages through which the flame must pass.

3.3.18 Flame Front Diverter. A device that opens in response to the pressure wave preceding the flame front of the deflagration, thereby venting the pressure wave and flame front.

3.3.19 Flame Speed. The speed of a flame front relative to a fixed reference point. [68, 2023]

3.3.20* Flammable Limits. The minimum and maximum concentrations of a combustible material in a homogeneous mixture with a gaseous oxidizer that will propagate a flame.

3.3.20.1 Lower Flammable Limit (LFL). The lowest concentration of a combustible substance in an oxidizing medium that will propagate a flame.

3.3.20.2 Upper Flammable Limit (UFL). The highest concentration of a combustible substance in a gaseous oxidizer that will propagate a flame. [68, 2023]

3.3.21 Flammable Range. The range of concentrations between the lower and upper flammable limits. [68, 2023]

3.3.22 Gas. The state of matter characterized by complete molecular mobility and unlimited expansion; used synonymously with the term *vapor*. [68, 2023]

3.3.22.1 Inert Gas. A gas that is noncombustible and nonreactive.

3.3.22.2 Purge Gas. An inert or a combustible gas that is continuously or intermittently added to a system to render the atmosphere nonignitable.

3.3.23* Hybrid Mixture. An explosible heterogeneous mixture, comprising gas with suspended solid or liquid particulates, in which the total flammable gas concentration is ≥ 10 percent of the lower flammable limit (LFL) and the total suspended particulate concentration is ≥ 10 percent of the minimum explosible concentration (MEC). [68, 2023]

N 3.3.24* Immediate, Automatic Shutdown. The prompt, system-initiated transition of the protected process from the normal operating condition to the “safe” shutdown condition.

3.3.25 Inerting. A technique by which a combustible mixture is rendered nonignitable by adding an inert gas or a noncombustible dust. [See also 3.3.1, *Blanketing (or Padding)*.]

3.3.26* Isolation. A means of preventing certain stream properties from being conveyed past a predefined point.

3.3.26.1 Chemical Isolation. A means of preventing flame front and ignition from being conveyed past a predetermined point by injection of a chemical suppressant.

3.3.26.2 Deflagration Isolation. A method employing equipment and procedures that interrupts the propagation of a deflagration flame front past a predetermined point.

3.3.26.3 Flow Isolation. A method employing equipment and procedures that interrupts flow and prevents pressure rise beyond a predetermined point.

3.3.26.4 Ignition Source Isolation. A method employing equipment and procedures that interrupts the propagation of an igniting medium past a predetermined point.

N 3.3.27 K_{St} . The deflagration index of a dust cloud. [68, 2023]

3.3.28* Limiting Oxidant Concentration (LOC). The concentration of oxidant in a fuel-oxidant-diluent mixture below which a deflagration cannot occur under specified conditions.

3.3.29 Liquid Seal. A device that prevents the passage of flame by passing the gas mixture through a noncombustible liquid.

3.3.30 Maximum Experimental Safe Gap (MESG). The maximum clearance between two parallel metal surfaces that has been found, under specified test conditions, to prevent an explosion in a test chamber from being propagated to a secondary chamber containing the same gas or vapor at the same concentration. [497, 2021]

3.3.31 Maximum Pressure (P_{max}). The maximum pressure developed in a contained deflagration of an optimum mixture. [68, 2023]

N 3.3.32* Minimum Ignition Energy (MIE). The minimum amount of energy released at a point in a combustible mixture that causes flame propagation away from the point, under specified test conditions. [68, 2023]

3.3.33 Mist. A dispersion of fine liquid droplets in a gaseous medium. [68, 2023]

N 3.3.34* Orderly Shutdown. The timely sequential shutdown of the process that would typically follow the steps required for a normal shutdown.

3.3.35 Oxidant. Any gaseous material that can react with a fuel (either gas, dust, or mist) to produce combustion. [68, 2023]

3.3.36 Padding. See 3.3.1, Blanketing (or Padding).

3.3.37 Pressure Piling. A condition during deflagration in which pressure increases in the unreacted medium ahead of the propagating combustion zone.

3.3.38 Qualified Person. A person who possesses a recognized degree, certificate, professional standing, or skill and who, by knowledge, training, and experience, has demonstrated the ability to deal with problems related to the subject matter, the work, or the project.

3.3.39* Reduced Pressure (P_{red}). The maximum pressure developed in a vented enclosure during a vented deflagration. [68, 2023]

3.3.40 Safety Instrumented Function (SIF). A safety function with a specified safety integrity level (SIL) that is necessary to achieve functional safety and that can be either a safety instrumented protection function or a safety instrumented control function.

3.3.41 Safety Instrumented System (SIS). An instrumented system used to implement one or more safety instrumented functions (SIFs) and composed of any combination of a sensor(s), logic solver(s), and final element(s).

3.3.42* Safety Integrity Level (SIL). Discrete level (1 out of 4) for specifying the safety integrity requirements of the safety instrumented functions (SIFs) to be allocated to the safety instrumented systems (SIS) with SIL 4 having the highest level of safety integrity and SIL 1 having the lowest.

3.3.43* Self-Decomposing Mixtures. Materials or mixtures capable of propagating a flame in the absence of oxidant.

3.3.44 Spark Extinguishing System. An extinguishing system in which the radiant energy of a spark or an ember is detected and the spark or ember is quenched.

3.3.45 Suppressant. The chemical agent used in a deflagration suppression system to extinguish the deflagration.

3.3.46 System Acceptance. A series of actions to verify installation, operation, and integration of the protection system in accordance with the basis of design, as well as training, validation testing, documentation, and arming of the system.

3.3.47 Trouble Signal. A signal that results from the detection of a trouble condition. [72, 2022]

3.3.47.1 Trouble Condition. An abnormal condition in a system due to a fault. [72, 2022]

3.3.48 Vapor. See 3.3.22.

3.3.49 Ventilation. The changing of air within a compartment by natural or powered means. [302, 2020]

Chapter 4 General Requirements

4.1 Goal. The goal of this standard shall be to provide effective deflagration prevention and control for enclosures where there is the potential for a deflagration.

4.2 Objectives.

4.2.1 Life Safety.

4.2.1.1 Deflagration prevention and control for occupied enclosures shall prevent the structural failure of the enclosure and minimize injury to personnel in adjacent areas outside of the enclosure.

4.2.1.2 Deflagration prevention and control for unoccupied enclosures shall prevent the rupture of the enclosure.

4.2.1.3 Deflagration prevention and control shall be arranged to avoid injury to personnel.

4.2.2 Property Protection.

4.2.2.1 Deflagration prevention and control systems shall be designed to limit damage of the protected enclosure.

4.2.2.2 Deflagration prevention and control systems shall be arranged to avoid ignition of adjacent property.

4.2.2.3 Deflagration prevention and control systems shall be designed to avoid damage to adjacent property.

4.2.2.4 Deflagration prevention and control shall be designed to avoid projectile damage to adjacent property.

4.2.3 Hazard Analysis.

4.2.3.1* The design basis deflagration hazard scenario shall be identified and documented.

4.2.3.2 A documented risk evaluation acceptable to the authority having jurisdiction shall be permitted to be conducted to determine the level of protection to be provided.

4.3 Compliance Options.

4.3.1 Options. Deflagration protection and control meeting the goals and objectives of Sections 4.1 and 4.2 shall be provided in accordance with either of the following:

- (1) The performance-based provisions of 4.3.2
- (2) The prescriptive-based provisions of 4.3.3

4.3.2 Performance-Based Design. A performance-based design shall be in accordance with Chapter 5 of this standard.

4.3.3 Prescriptive-Based Design. A prescriptive-based design shall be in accordance with Chapters 6 through 15 of this standard.

Chapter 5 Performance-Based Design Option

5.1* General Requirements.

5.1.1 Qualifications. The performance-based design shall be prepared by a person with qualifications acceptable to the authority having jurisdiction.

5.1.2 Design Documentation. The design methodology and data sources shall be documented and maintained for the life of the protected enclosure.

5.1.3 Management of Change.

5.1.3.1 To continue meeting the performance goals and objectives of this standard, the design features required for each prevention and control system shall be maintained for the life of the protected enclosure.

5.1.3.2 Any change to the process shall require review of the design basis for each affected prevention and control system prior to implementation of the change.

5.1.3.3 Any change to the design features shall require approval of the authority having jurisdiction prior to the actual change.

5.2 Performance Criteria.

5.2.1 Prevention and control system design shall be based on the documented hazard scenario.

5.2.2 Prevention and control systems shall limit the reduced pressure (P_{red}) within an enclosure to meet the objectives in 4.2.1.1 and 4.2.1.2.

5.2.3 Deflagration Prevention and Control.

5.2.3.1 Combustible material outside the enclosure shall not attain their ignition temperature from flame or hot gases.

5.2.3.2 Prevention and control systems shall limit the risk of damage to exposed structures.

5.2.3.3 Prevention and control systems shall not expose personnel to flame, hot gases, hot particles, toxic materials, or projectiles.

5.2.3.4 Prevention and control systems shall limit the risk of flame spread from vessel to vessel via interconnected ducts.

5.2.4 Inspection and Maintenance.

5.2.4.1 Prevention and control systems shall be regularly inspected and maintained to confirm the ability to perform as designed.

5.2.4.1.1 If no guidance is given from the performance-based design documents, the requirements of Chapter 15 of this standard shall apply.

5.2.4.2 Inspection and maintenance shall be documented and retained for at least 1 year or the last three inspections.

Chapter 6 General Prescriptive Requirements

6.1* Methods. The methods recognized in this standard shall be grouped based on the prevention of combustion or on the prevention or limitation of damage after combustion occurs.

6.1.1 Methods Based on the Prevention of Combustion. The following shall be considered methods based on preventing combustion:

- (1) Oxidant concentration reduction
- (2) Combustible concentration reduction

6.1.2 Methods Based on the Prevention or Limitation of Damage. The following shall be considered methods based on preventing or limiting damage:

- (1) Predeflagration detection and ignition control systems
- (2) Deflagration suppression
- (3) Isolation methods
- (4) Deflagration pressure containment

6.2 Limitations. The limitations specific to each method shall be considered and are specified in the corresponding chapter for each method.

6.3 Factors to Be Considered. The following factors shall be considered in the selection of one of the methods and the design of the system:

- (1) Effectiveness of each method
- (2) Reliability of the system
- (3) Personnel hazards inherent in each method

6.3.1 The reliability of the system chosen shall be assessed using the following factors:

- (1) System design basis
- (2) Possibility of electrical and mechanical malfunction (*see 15.5.5.1 for safety system controls and instrumentation reliability requirements*)
- (3) Dependence on sophisticated activating systems
- (4) Need for special installation, training, operating, testing, and maintenance procedures
- (5) Further limitations as presented in each chapter

6.3.2 In general, explosion prevention systems shall be used to protect processing, storage, and materials-handling equipment.

6.3.3 When explosion prevention techniques are applied to rooms, buildings, or other enclosures where personnel are present, consideration shall be given to the safety of the personnel.

6.3.4 When using the techniques of Chapters 10, 11, 12, or 13, or of NFPA 68, the enclosure strength, P_{es} , of the protected equipment shall be determined and all pertinent calculations or test information, acceptable to the AHJ, shall be documented and certified by a licensed professional engineer.

6.3.4.1 P_{red} shall not exceed two-thirds of the ultimate strength for the enclosure, provided deformation of the equipment can be tolerated.

6.3.4.2 Where deformation cannot be tolerated, P_{red} shall not exceed two-thirds of the yield strength for the enclosure.

6.3.4.3 Determination of required enclosure strength shall be in accordance with Section 4.3 of NFPA 68.

6.4 Plans.

6.4.1 Plans, system specifications, and manufacturer's recommendations for testing and maintenance shall contain information that enables the authority having jurisdiction to evaluate the explosion hazard and the effectiveness of the system.

6.4.2 Details of the plans shall include the following information:

- (1) Pertinent chemical and physical characteristics of the materials involved
- (2) Location of hazards
- (3) Enclosures or limits and isolation of the hazards
- (4) Exposures to the hazards

6.5 System Acceptance. All new protection installations and modifications shall be tested or otherwise evaluated to confirm operational integrity.

6.5.1 Tests shall be in accordance with the manufacturer's recommendations.

6.5.2 A written report of the tests shall be provided to the users.

6.6* Inspection and Maintenance.

6.6.1* All systems shall be inspected for operability in accordance with the manufacturer's recommendations.

6.6.2 An inspection and preventive maintenance schedule shall be established in accordance with the manufacturer's recommendations.

N 6.6.3 Inspection and maintenance shall comply with the requirements of Chapter 15.

6.7 Housekeeping. In facilities handling combustible particulate solids where such material(s) cannot be completely and reliably contained within the process equipment during normal operation, there can be a significant risk for secondary explosions from dust deposits in the process area. In such situations, housekeeping shall be performed in accordance with NFPA 654, NFPA 484, and NFPA 61.

Chapter 7 Deflagration Prevention by Oxidant Concentration Reduction

7.1 Application. The technique for oxidant concentration reduction for deflagration prevention shall be permitted to be considered where a mixture of oxidant and flammable material is confined to an enclosure within which the oxidant concentration can be controlled.

7.1.1* The system shall be maintained at an oxidant concentration that is low enough to prevent a deflagration.

7.1.2 Oxidant concentration reduction shall be permitted to be applied to rooms or buildings, but because oxygen-deficient atmospheres cannot sustain life, one of the following shall apply:

- (1) Operations in such areas shall be remotely controlled.
- (2) Operating personnel shall be provided with breathing apparatus as well as other safeguards.

7.1.3* The owner or operator shall evaluate the need for other fire and explosion protection measures where the combustible material leaves the low oxidant concentration environment.

7.1.4 Warning Signs.

7.1.4.1 Where oxidant concentration reduction that poses an asphyxiation hazard is employed, warning signs shall be posted.

7.1.4.2 These warning signs shall be applied to either the inerting system components, the enclosure, or both.

7.2 Design and Operating Requirements.

7.2.1* **Design Considerations.** The following factors shall be considered in the design of a system intended to reduce the oxidant concentration:

- (1) Required reduction in oxidant concentration
- (2) Variations in the process, process temperature and pressure, and materials being processed
- (3) Source purge gas supply and equipment installation
- (4) Compatibility of the purge gas with the process
- (5) Operating controls
- (6) Maintenance, inspection, and testing
- (7) Personnel exposure due to leakage of purge gas to surrounding areas
- (8) Need for breathing apparatus by personnel

- (9)* Reduced effectiveness of purge gas due to equipment leakage and loss through vents

7.2.2 Protection System Design and Operation.

7.2.2.1* The owner or operator shall be responsible for a thorough analysis of the process to determine the type and degree of deflagration hazards inherent in the process.

7.2.2.2 Information required for the oxidant concentration monitoring and control shall be compiled and documented. This shall include, but not be limited to, the following information:

- (1) Monitoring and control objectives
- (2) Monitored and controlled areas of the process
- (3) Dimensioned drawings of the process with the following information:
 - (a) Equipment make and model if available, including volumes and diameters and design strengths
 - (b) Plan and elevation views with flows indicated
- (4) Startup, normal, shutdown, temporary operations, and emergency shutdown process conditions and ranges for the following factors:
 - (a) Flow
 - (b) Temperature
 - (c) Pressure
 - (d) Oxidant concentration
- (5) Process flow diagram and description
- (6) Ambient temperature in process area
- (7) Process interlocks

7.2.2.3 The owner or operator shall disclose any and all process information required for the protection system design.

7.2.2.4 The protection system design shall be subject to a documented review by a qualified person.

7.2.2.5 The owner or operator shall be responsible for the maintenance of the system after installation and acceptance based on procedures provided by the vendor. Maintenance records shall be retained for inspection by the authority having jurisdiction.

7.2.2.6 The owner or operator shall be responsible for periodic inspection of the system by personnel trained by the system manufacturer. The inspection frequency shall be in accordance with Section 15.7.

7.2.2.7 **Management of Change.** The effect of any process change shall be addressed as specified in Section 15.11.

7.2.2.8 All documentation relevant to the protection system shall be retained in accordance with Chapter 15.

7.2.3 Limiting Oxidant Concentrations (LOCs).

7.2.3.1* Table C.1(a) and Table C.1(b) shall be permitted to be used as a basis for determining LOCs of flammable gases or suspensions of combustible dusts.

7.2.3.1.1 For gases and vapors, if the LOC values according to ASTM E2079, *Standard Test Methods for Limiting Oxygen (Oxidant) Concentration in Gases and Vapors*, are available, then these shall be used.

7.2.3.1.2 For gases and vapors, if the LOC values according to ASTM E2079 are not available, then the LOC values obtained in flammability tubes shall be used after adjustment by subtracting 1.5 percent by volume oxidant for LOC values of 10 percent or greater or by multiplying by a factor of 0.85 for LOC values less than 10 percent, as indicated in the adjusted columns in Table C.1(a).

7.2.3.1.3 In no case shall the adjusted LOC value for carbon dioxide inerting result in a value lower than that required for nitrogen inerting.

7.2.3.2 For fuel, inert, and oxidant combinations not listed in Table C.1(a) or Table C.1(b) or for situations when the process conditions differ from the conditions under which the existing data were obtained, the test methods described in ASTM E2079 shall be permitted to be used.

7.2.3.3 The extent of oxidant reduction shall be determined by testing where conditions vary significantly from the test conditions under which the data were obtained.

7.2.4 Use of Purge Gas Systems.

7.2.4.1 An additional backflash prevention or protection system shall be installed if a purge gas system is used for lines collecting flammable mixtures and the collection system terminates at a flare or incinerator.

7.2.4.2 Hard-piped vapor control systems shall not require flame arresters at each source connection to the system, provided that the system is designed to operate outside the flammable range.

7.2.4.3 Systems requiring hookups prior to vapor transfer, such as vapor collection from mobile vehicles, shall be purged to a level below the LOC prior to transfer, or backflash protection shall be provided near the point of connection.

7.2.4.4* Where oxygen-deficient atmospheres are maintained in equipment operating under conditions that might form pyrophoric iron sulfides or other pyrophoric materials, a procedure shall be developed to prevent uncontrolled oxidation of the sulfides or other pyrophoric materials.

7.3 Purge Gas Sources.

7.3.1 The purge gas shall be obtained from a source that is capable of continuously supplying the required amount of purge gas to maintain the necessary degree of oxidant deficiency.

7.3.2 Possible sources of purge gas shall include, but shall not be limited to, the following sources:

- (1) Commercially available inert gas, such as nitrogen, carbon dioxide, argon, or helium, supplied from high-pressure tanks or cylinders or from air separation plants
- (2) Inert gas supplied from a gas generator that burns or catalytically oxidizes a hydrocarbon to produce an oxygen-deficient purge gas
- (3) Products of combustion from process furnaces or boiler furnaces for which purification or cooling could be necessary to avoid contamination
- (4)* Steam, if it can be supplied at a rate that raises and maintains the protected vessel or system at a temperature high enough to prevent condensation of the steam
- (5) High-purity nitrogen supplied by air oxidation of ammonia

- (6) Inert gas supplied by removal of oxygen from air by absorption, adsorption, chemical reaction, or membrane permeation
- (7) Fuel gases such as methane or natural gas

7.4 Purge Gas Conditioning.

7.4.1 Purge gas shall be conditioned to minimize contaminants that might be harmful to the gas distribution system or that might interfere with the operation of the system.

7.4.2 Before introduction, the purge gas shall be at a temperature compatible with the process being protected to minimize the chance of thermal ignition or condensation.

7.4.3 Purge gas that is distributed in a system subject to freezing temperatures shall have a dew point such that water condensation cannot occur at the minimum ambient temperature to which the system will be exposed.

7.5 Piping Systems. Purge gas distribution systems shall be designed and installed in accordance with recognized engineering practices.

7.5.1 Where purge gas exceeds a gauge pressure of 103 kPa (15 psi), the piping system shall be designed in accordance with ASME B31.3, *Process Piping*.

7.5.2 Where required, piping systems shall be provided with filters, screens, or other means of preventing foreign material from entering critical parts of the system, such as pressure regulators, valves, and instrumentation.

7.5.3 Where required, moisture traps shall be provided and lines shall drain toward the traps.

7.5.3.1 Blowdown connections for moisture traps shall be provided.

7.5.3.2 Moisture traps shall be protected from freezing.

7.5.4 When flue gas or combustion gas is used, means shall be provided to prevent propagation of flame into the system being protected.

7.5.5* Manual shutoff valves shall be provided at each major division point in the distribution system.

7.5.6 The inert gas distribution system shall be designed to prevent contamination by hazardous process materials.

7.5.6.1 Where required, check valves or other design features shall be incorporated to prevent the potential for contamination due to loss of purge gas supply or to excessive pressure in the process unit being protected.

7.5.6.2 A single check valve shall not be considered a positive backflow connection.

7.5.7* Cross-connections between the purge gas distribution system and any other system shall be prohibited unless one of the following criteria is met:

- (1) Positive measures shall be taken to prevent backflow from the other system into the purge gas system.
- (2) Cross-connections to backup purge gas systems shall be permitted without backflow prevention unless backflow could create a hazard.

7.5.8 The entire distribution system shall be cleaned and functionally tested prior to being placed in service.

7.5.9 The gases from an enclosure or vessel being purged shall be vented to a safe location.

7.6 Application of Purge Gas at Points of Use. Purge gas shall be introduced and exhausted so that distribution is ensured and the desired reduction in oxidant concentration is maintained throughout the system being protected.

7.6.1 Multiple inlets and outlets shall be permitted.

7.6.2 Connections between the purge gas distribution piping and the protected enclosure or system shall be designed for maximum purge gas pressure.

7.7 Instrumentation.

7.7.1* General. Instrumentation shall be provided to monitor the purge gas being supplied to the distribution system.

7.7.1.1 Instrumentation shall be calibrated according to the requirements in Chapter 15.

7.7.1.2 When the conditions being measured are critical to the safety of personnel, alarms shall be provided to indicate abnormal operation of the system.

7.7.2 Systems Operated Below the Limiting Oxidant Concentration (LOC).

7.7.2.1* Instrumentation shall be installed in as many points as necessary to ensure the desired oxidant concentration reduction within the protected system.

7.7.2.2 The determination of the LOC for the system shall be based on the worst credible case gas mixture yielding the smallest LOC.

7.7.2.3 A safety margin shall be maintained between the LOC and the maximum oxygen concentration permitted within the system.

7.7.2.4* The safety margin shall take into account all of the following factors:

- (1) Fluctuations occurring in the system
- (2) Sensitivity and reliability of monitoring and control equipment
- (3) Probability and consequences of an explosion

▲ 7.7.2.5* One of the following requirements shall be met where the oxygen concentration is continuously monitored and controlled with safety interlocks:

- (1) Where the LOC is greater than or equal to 5 percent, a safety margin of at least 2 volume percent below the LOC shall be maintained.
- (2) Where the LOC is less than 5 percent, the equipment shall be operated at no more than 60 percent of the LOC.

7.7.2.6 Risk Assessment. A documented risk assessment acceptable to the AHJ shall be permitted to be conducted to determine the safety margin to be maintained between the worst credible case LOC and safety interlocks addressed in 7.7.2.5.

7.7.2.7 The requirement of 7.7.2.5 shall not apply to partial oxidation processes.

▲ 7.7.2.8* Where the oxygen concentration is not continuously monitored and controlled with safety interlocks, one of the following requirements shall be met:

- (1) Where the LOC is greater than or equal to 7.5 percent, a safety margin of at least 4.5 volume percent below the LOC shall be maintained.
- (2) Where the LOC is less than 7.5 percent, the oxygen concentration shall be designed to operate at no more than 40 percent of the LOC.

7.7.2.8.1 The oxygen concentration shall be checked on a regularly scheduled basis.

7.7.2.8.1.1* The vapor space in low-pressure field storage tanks that have padding shall not require checking of the oxygen concentration.

7.7.2.8.1.2 The procedure of pulling a partial vacuum and then breaking the vacuum with inert gas shall be permitted without measuring the oxygen concentration if all of the following conditions apply:

- (1) The vacuum condition is held for a time to check for leakage.
- (2) The vacuum level is monitored.
- (3) The vacuum-creating medium is compatible with the process chemistry.
- (4) The residual oxygen partial pressure is calculated or demonstrated by test to be at least 40 percent below the LOC.

7.7.3 Systems Operated Above the Upper Flammable Limit (UFL).

7.7.3.1* Systems operating above the UFL shall be permitted to be used, and the UFL shall be determined at the conditions applicable to the system.

7.7.3.2 Vent headers operated near atmospheric pressure shall be permitted to be rendered nonflammable by the addition of at least 25 volume percent of natural gas or methane where both of the following criteria are met:

- (1) The vent headers shall not contain any vapor with a UFL greater than that of hydrogen in air (75 percent).
- (2) The vent headers shall not contain oxygen in concentrations greater than can be derived from ambient air.

7.7.3.3 Instrumentation to control methane flow shall be acceptable to the authority having jurisdiction.

Chapter 8 Deflagration Prevention by Combustible Concentration Reduction

8.1* Application. The technique for combustible concentration reduction shall be permitted to be considered where a mixture of a combustible material and an oxidant is confined to an enclosure and where the concentration of the combustible can be maintained below the lower flammable limit (LFL).

8.2 Basic Design Considerations.

8.2.1 All of the following factors shall be considered in the design of a system intended to reduce the combustible concentration below the LFL:

- (1) Required reduction in combustible concentration
- (2) Variations in the process, process temperature and pressure, and materials being processed
- (3) Operating controls
- (4) Maintenance, inspection, and testing

- (5) Concentration variation with time and location within the protected enclosure

8.2.2* The LFLs of the combustible components shall be determined at all operating conditions, including startup and shutdown.

8.2.3 Protection System Design and Operation.

8.2.3.1* The owner or operator shall be responsible for a thorough analysis of the process to determine the type and degree of deflagration hazards inherent in the process.

8.2.3.2 Information required for the monitoring and control of the concentration of combustible components shall be compiled and documented. This information shall include, but not be limited to, the following:

- (1) Monitoring and control objectives
- (2) Monitored and controlled areas of the process
- (3) Dimensioned drawings of the process with the following:
 - (a) Equipment make and model if available, including volumes and diameters and design strengths
 - (b) Plan and elevation views with flows indicated
- (4) Startup, normal, shutdown, temporary operations, and emergency shutdown process conditions and ranges for the following:
 - (a) Flow
 - (b) Temperature
 - (c) Pressure
 - (d) Oxidant concentration
 - (e) Fuel concentration
- (5) Process flow diagram and description
- (6) Ambient temperature in process area
- (7) Process interlocks

8.2.3.3 The owner or operator shall disclose any and all process information required for the protection system design.

8.2.3.4 The protection system design shall be subject to a documented review by a qualified person.

8.2.3.5 The owner or operator shall be responsible for the maintenance of the system after installation and acceptance based on procedures provided by the vendor. Maintenance records shall be retained for inspection by the authority having jurisdiction.

8.2.3.6 The owner or operator shall be responsible for periodic inspection of the system by personnel trained by the system manufacturer. The inspection frequency shall be in accordance with Section 15.7.

8.2.3.7 Management of Change. The effect of any process change shall be addressed as specified in Section 15.11.

8.2.3.8 All documentation relevant to the protection system shall be retained in accordance with Chapter 15.

8.3 Design and Operating Requirements.

8.3.1* Combustible Concentration Limit. The combustible concentration shall be maintained at or below 25 percent of the LFL for all foreseeable variations in operating conditions and material loadings, unless the following conditions apply:

- (1) Where continuously monitored and controlled with safety interlocks, the combustible concentration shall be permitted to be maintained at or below 60 percent of the LFL.

- (2) Aluminum powder production systems designed and operated in accordance with NFPA 484 shall be permitted to be maintained at or below 50 percent of the LFL.

8.3.2* Catalytic Oxidation. Where catalytic oxidation is used for combustible concentration reduction, the following shall apply:

- (1) Isolation systems shall be provided in all inlets to the catalytic oxidation unit.
- (2) Unless the combustible concentration is monitored continuously, the effectiveness of the catalytic oxidation system shall be verified periodically in accordance with the manufacturer's recommendations.

8.3.3 Ventilation or Air Dilution.

8.3.3.1 If ventilation is used, the outlets from the protected enclosures shall be located so that hazardous concentrations of the exhausted air cannot enter or be drawn into the fresh air intakes of environmental air-handling systems.

8.3.3.2 Air intakes shall meet one of the following requirements:

- (1) They shall be located so that combustible material cannot enter the air-handling system, even in the event of spills or leaks.
- (2) They shall be provided with gas detectors that automatically interlock to stop air intake.

8.3.3.3 Filters, dryers, or precipitators in the air intakes shall be located such that they are accessible for cleaning and maintenance.

8.4 Instrumentation.

8.4.1* Instrumentation shall be provided to monitor and control the process flows.

8.4.2 Instrumentation shall be calibrated according to the requirements of Chapter 15.

8.4.3 Where the enclosure being protected presents a personnel hazard, alarms shall be provided to indicate abnormal operation of the system.

Chapter 9 Predeflagration Detection and Control of Ignition Sources

9.1* Application. Systems used for the predeflagration detection and control of certain specific ignition sources shall be permitted to be used to reduce the probability of the occurrence of deflagrations in systems that handle combustible particulate solids.

9.1.1 Systems used for the predeflagration detection and control of ignition sources shall be permitted to be used in conjunction with other explosion prevention or explosion protection measures, such as deflagration suppression or deflagration venting, for those systems posing a dust explosion hazard.

N 9.1.1.1 These methods shall be permitted to be used independently to reduce the frequency of deflagrations.

N 9.1.1.2 These methods shall be permitted to be used as an additional detector for a method of Chapter 10, 11, 12, or 13.

N 9.1.1.3 These methods shall not interfere with the operation of the validated system.

9.1.2 Design of systems used for predeflagration detection and control of ignition sources shall be based on various techniques that include, but are not limited to, the use of the following systems:

- (1) Optical sensing systems
- (2) Gas sensing systems

9.1.3 Optical sensing and gas sensing systems shall be permitted to be used for the detection, control, and extinguishment of ignition sources as they pass through ducts, chutes, hoppers, belts, or similar conveyors or develop in an enclosure.

9.1.4 The optical sensing systems shall operate by means of detectors that sense the radiation from a hot or glowing particle and immediately actuate a means to control or extinguish, such as water spray, carbon dioxide flooding, steam snuffing, diversion of material out of the process, or stopping material in-feed to the process, if appropriate.

9.1.5 The gas sensing systems shall operate by means of sensing the formation of gaseous thermal decomposition products and immediately actuate a means to control or extinguish such as alarms, automated shutdown, or the release of the extinguishing system.

9.1.6 General. Systems shall be listed or approved as complete systems that include a means to immediately implement the selected action described in 9.1.4 or 9.1.5.

9.2 Limitations.

9.2.1 Optical sensing systems and gas sensing systems shall not be used for systems handling flammable gases or hybrid mixtures.

9.2.2 Optical sensing systems and gas sensing systems shall not be used in extinguishing or isolating deflagration flame fronts.

N 9.2.3 These methods presented in Chapter 9 shall not be permitted to be used as the sole detector for a method of Chapter 10, 11, 12, or 13.

9.3 Optical Sensing System and Gas Sensing System Design Considerations.

9.3.1 Optical Sensing Equipment.

9.3.1.1 Spacing between a detector and control mechanism shall be based on parameters including, but not limited to, the following criteria:

- (1) Linear velocity of the material in the duct
- (2) Response time of the sensor
- (3) Actuator circuitry
- (4) Response time of the control mechanism

9.3.1.2 The system manufacturer's application design and guidance shall ensure that a sufficient number of detectors are installed to detect radiant energy at any location in the cross-sectional area of the duct, chute, hopper, belt conveyor, or similar transport system.

9.3.1.3 Provisions shall be made to prevent obscuration of optical sensors.

9.3.1.4 Sensors shall be protected from the accumulation of foreign material that would prevent functioning.

9.3.2 Gas Sensing Equipment.

9.3.2.1 The system shall take air samples at inlets and outlets and evaluate the differential concentration of the selected thermal decomposition products.

9.3.2.2 The design of the gas sensing system shall be based on parameters including, but not limited to, the following criteria:

- (1) Process flow
- (2) Process flow velocity
- (3) Potential measurement interferences (contamination)
- (4) Volume
- (5) Air exchange rate
- (6) Sensor response time

9.3.2.3 The system sampling flow rates and residence times shall be balanced to ensure a relative sample of all air inputs and outputs.

9.3.3 Power and Control Units.

9.3.3.1 A power and control unit shall supply energy to accomplish all of the following processes:

- (1) Power all sampling devices, sample preparation unit, control processor, etc.
- (2) Energize all electrically actuated extinguishing and control systems
- (3) Energize visual and audible alarms
- (4) Transfer all auxiliary control and alarm contacts
- (5) Control system-disabling interlock and process shutdown circuits

9.3.3.2 The power and control unit shall, as a minimum, fully and continuously supervise all of the following components:

- (1) Wiring circuits for opens and other faults
- (2) AC power supply (primary)
- (3) System safety interlock circuitry
- (4) System-disabling interlock circuitry
- (5) Releasing outputs
- (6) Electrical extinguishing actuators
- (7) Air sampler flow (gas sensing only)
- (8) Visible and audible alarms
- (9) Circuit ground fault

9.3.3.3 Upon receipt of a trouble signal, which indicates the protection system could be compromised, an orderly shutdown of the protected process shall be initiated.

N 9.3.3.4 Upon receipt of a supervisory signal, which indicates that a problem exists but that the protection system is not compromised, qualified personnel shall investigate and repair the problem at the next shutdown period.

9.3.3.5 The supervisory signal circuits shall be provided with visual and audible trouble signals.

9.4 Testing.

9.4.1 A functional test of all system functions shall be conducted in accordance with the manufacturer's specifications.

9.4.2 The design system shall be based on testing relevant to the early detection and control system.

9.4.3 The sensing system shall be calibrated in accordance with manufacturer's recommendations.

9.5 Protection System Design and Operation.

9.5.1 Process Analysis.

9.5.1.1* The owner or operator shall be responsible for a thorough analysis of the process to determine the type and degree of deflagration hazards inherent in the process.

9.5.1.2 Factors such as the type of combustible material, the enclosure internal geometry, the total volume to be protected, and the operating conditions shall be reviewed in detail.

9.5.1.3 The potential process malfunctions that could affect the extent of the deflagration hazard shall be determined.

9.5.2 The information required for the detection and control system design shall include, but not be limited to, the following:

- (1) Protection objective
- (2) Protected area of the process
- (3) Dimensioned plan and elevation drawings of the process with equipment make and model, if available
- (4) Dimensions of inlet and outlet connections
- (5) Internal obstructions of protected enclosure
- (6) Startup, normal, shutdown, temporary operations, and emergency shutdown process conditions and ranges for the following:
 - (a) Flow rate and direction
 - (b) Temperature
 - (c) Pressure
 - (d) Oxidant concentration
 - (e) Fuel concentration
- (7) Process flow diagram and description
- (8) Currently installed protection equipment
- (9) Ambient temperature in process area
- (10) Explosibility properties of the combustible material
- (11) Process interlocks

9.5.3 The owner or operator shall disclose any and all process information required for the protection system design.

9.5.4 The protection system design shall be subject to a documented review by a qualified person.

9.5.5 Maintenance and Inspection.

9.5.5.1 The owner or operator shall be responsible for the maintenance of the system after installation and acceptance.

9.5.5.2 Maintenance records shall be retained for inspection by the authority having jurisdiction in accordance with Section 15.9.

9.5.5.3 The owner or operator shall be responsible for periodic inspection of the system by personnel trained by the system manufacturer.

9.5.5.4 The inspection frequency shall be in accordance with Section 15.7.

9.5.6 Management of Change. The effect of any process change shall be addressed as specified in Section 15.11.

9.5.7 All design documentation relevant to the detection and control system shall be retained in accordance with Chapter 15.

9.6 System Manufacturer's Additional Responsibilities.

9.6.1* The system manufacturer shall provide the owner or operator with information and documentation supporting the design; this information shall be suitable for review by the AHJ.

9.6.2 Upon request, the system manufacturer shall provide to the owner or operator documentation supporting that the design is in compliance with the manufacturer's independent third-party approval, including application limitations, and is suitable for the hazard to be protected.

9.6.3 The system manufacturer shall provide to the owner or operator design specifications based on the data provided by the owner or operator as specified in 9.5.2.

9.6.3.1 Documentation shall be made of the data used in the design.

9.6.3.2 Method of determination shall be consistent with third-party approval and available for review by the authority having jurisdiction.

9.6.4 The system manufacturer shall provide to the owner or operator mechanical and electrical drawings of the system.

9.6.5 The system manufacturer shall provide to the owner or operator installation instructions, operating manuals, and maintenance instructions.

9.6.6 As part of system acceptance, the system manufacturer and the owner or operator shall document that the installation is in accordance with the design and that the system is armed and functional. (*See Section 15.6.*)

9.6.6.1 Variances and any corrective actions shall be identified with the responsible party for any action identified.

9.6.6.2 Changes made at or during installation shall be approved by the system manufacturer and the owner or operator and suitably documented.

9.6.6.3 Concurrence of the AHJ shall be obtained as appropriate.

9.7 Actuation of Other Devices and Systems.

9.7.1 The detection and control system shall be permitted to actuate other devices and systems such as high-speed isolation valves, chemical or mechanical isolation devices, or deluge valves as applicable.

9.8 Process Shutdown. Upon activation, the detection and control system shall be permitted to initiate an immediate, automatic shutdown of the protected process.

Chapter 10 Deflagration Control by Suppression

10.1* Application.

10.1.1 The technique for deflagration suppression shall be permitted for flammable gases, combustible mists, combustible dusts, or hybrid mixtures that are subject to deflagration in a gas-phase oxidant.

10.1.2 Enclosures that can be protected by a deflagration suppression system shall include, but shall not be limited to, the following equipment:

- (1) Processing equipment, such as reactor vessels, mixers, blenders, pulverizers, mills, dryers, ovens, filters, screens, and dust collectors
- (2) Storage equipment, such as atmospheric or low-pressure tanks, pressure tanks, and mobile facilities
- (3) Material-handling equipment, such as pneumatic and screw conveyors and bucket elevators
- (4) Laboratory and pilot plant equipment, including hoods, glove boxes, test cells, and other equipment
- (5) Aerosol filling rooms

10.1.3* The suppression system shall be of a design that has been tested under deflagration conditions to verify performance.

10.1.4 The detection conditions; the positioning of the detection points; and the location, quantity, and volume of suppressant containers shall be based upon factors such as, but not limited to:

- (1) Time required for detection
- (2) Suppressant discharge pattern
- (3) Suppressant concentration as a function of time
- (4) Suppressant efficiency
- (5) Explosibility characteristics of the combustible material
- (6) Physical characteristics of the protected enclosure

10.2 Limitations.

10.2.1 Deflagration suppression is successful only where the suppressant can be distributed during the early stages of flame and pressure development.

10.2.2 Deflagration suppression is limited by the physical and chemical properties of the reactants in the system, as well as the design and pressure resistance of the enclosure.

10.2.3* The pressure resistance of the protected enclosure shall not be less than the maximum suppressed deflagration pressure (including effects of suppressant discharge) for the duration of the pressure increase.

10.3 Personnel Safety.

10.3.1* Disarming and Lockout and Tagout Procedures.

10.3.1.1 Disarming and OSHA lockout and tagout procedures (found in 29 CFR 1910.147) and confined space entry procedures (found in 29 CFR 1910.146), NFPA 326, or local country equivalent, shall be followed prior to entering an enclosure protected by deflagration suppression systems.

10.3.1.2 The deflagration suppression system shall be disarmed and locked out and tagged out prior to performing maintenance operations on the protected enclosure or suppression system if discharging the suppressant could result in injury.

10.3.1.3 All suppressors shall be provided with a means to prevent release of stored energy into the protected enclosure.

10.3.1.4 The suppression system shall be configured to prevent arming while such means are in place.

10.3.1.5 Locks and tagging shall be used to identify suppressors that have such prevention means in place.

10.3.1.6 Operation of the protected process shall be interlocked through the suppression system control panel so that operation cannot be resumed until the suppression system is armed.

10.3.2 Warning Signs.

10.3.2.1 Suppression systems shall be equipped with warning signs indicating that the enclosure is protected with a suppression system.

10.3.2.2 These warning signs shall be applied to suppression system components, the enclosure, or both.

10.4 Basic Design Considerations.

10.4.1 General. The design of a deflagration suppression system shall consider, but shall not be limited to, the following components:

- (1) Deflagration characteristics of the combustible material
- (2) Identification and design specifications of equipment to be protected
- (3) Detection technique(s)
- (4) Suppressant type, quantity, and suppressing characteristics
- (5) Access to components and ease of maintenance
- (6) Deflagration propagation between process vessels
- (7) Startup, normal operation, and upset conditions

10.4.2 System Design Certification.

10.4.2.1* System design methodology and application range shall be supported by appropriate testing and certified by a recognized testing organization acceptable to the authority having jurisdiction.

10.4.2.2 The system design shall be based on testing relevant to the application.

10.4.3 Suppression System Design and Operation.

10.4.3.1 Process Analysis.

10.4.3.1.1* The owner or operator shall be responsible for a thorough analysis of the process to determine the type and degree of deflagration hazards inherent in the process.

10.4.3.1.2 Factors such as the type of combustible material, the enclosure internal geometry, the total volume to be protected, and the operating conditions shall be reviewed in detail.

10.4.3.1.3 The potential process malfunctions that could affect the extent of the deflagration hazard shall be determined.

10.4.3.2 The suppression system design shall include, but not be limited to, the following information:

- (1) Protection objective
- (2) Protected area of the process
- (3) Dimensioned plan and elevation drawings of the process with equipment make and model, if available
- (4) Pressure resistance of protected enclosures

- (5) Internal obstructions of protected enclosure
- (6) Startup, normal, shutdown, temporary operations, and emergency shutdown process conditions and ranges for:
 - (a) Flow
 - (b) Temperature
 - (c) Pressure
 - (d) Oxidant concentration
 - (e) Fuel concentration
- (7) Process flow diagram and description
- (8) Currently installed protection equipment
- (9) Ambient temperature in process area
- (10) Explosibility properties of the combustible material
- (11) Process interlocks

10.4.3.3 The owner or operator shall disclose any and all process information required for the protection system design.

10.4.3.4 Maintenance and Inspection.

10.4.3.4.1 The owner or operator shall be responsible for the maintenance of the system after installation and acceptance.

10.4.3.4.2 Maintenance records shall be retained for inspection by the authority having jurisdiction in accordance with Section 15.9.

10.4.3.4.3 The owner or operator shall be responsible for periodic inspection of the system by personnel trained by the system manufacturer.

10.4.3.4.4 The inspection frequency shall be in accordance with Section 15.7.

10.4.3.5 Management of Change. The effect of any process change shall be addressed as specified in Section 15.11.

10.4.3.6 All design documentation relevant to the protection system shall be retained in accordance with Chapter 15.

10.4.4 System Manufacturer's Additional Responsibilities.

10.4.4.1* The system manufacturer shall provide the owner or operator with information and documentation that supports the design and is suitable for review by the AHJ.

10.4.4.2 Upon request, the system manufacturer shall provide to the owner or operator documentation supporting that the design is in compliance with the manufacturer's independent third-party approval, including application limitations, and is suitable for the hazard to be protected.

10.4.4.3 The system manufacturer shall provide to the owner or operator design specifications based on the data provided by the owner or operator as specified in 10.4.1.

10.4.4.3.1 Documentation shall be made of the data used in the design.

10.4.4.3.2 The final reduced deflagration pressures shall be provided.

10.4.4.3.3 Method of determination shall be third party approved and available for review by the authority having jurisdiction.

10.4.4.4 The system manufacturer shall provide to the owner or operator mechanical and electrical drawings of the protection system.

10.4.4.5 The system manufacturer shall provide to the owner or operator installation instructions, operating manuals, and maintenance instructions.

10.4.4.6 As part of system acceptance, the system manufacturer and the owner or operator shall document that the installation is in accordance with the design and that the system is armed and functional. (See Section 15.6.)

10.4.4.6.1 Variances and any corrective actions shall be identified with the responsible party for any action identified.

10.4.4.6.2 Changes made at or during installation shall be approved by the system manufacturer and the owner or operator and suitably documented.

10.4.4.6.3 Concurrence of the AHJ shall be obtained as appropriate.

10.4.5 Actuation of Other Devices and Systems. The deflagration suppression system shall be permitted to actuate other devices and systems such as high-speed isolation valves, chemical or mechanical isolation devices, or deluge valves as applicable.

10.4.6 Process Shutdown. Upon activation, the suppression system shall initiate an immediate, automatic shutdown of the protected process.

Δ 10.4.6.1 Upon receipt of a trouble signal, which indicates the protection system could be compromised, an orderly shutdown of the protected process shall be initiated.

Δ 10.4.6.2 Upon receipt of a supervisory signal, which indicates that a problem exists but that the protection system is not compromised, qualified personnel shall investigate and repair the problem at the next shutdown period.

10.5 Control Panels.

10.5.1 Each suppression system shall be provided with a control panel having a standby battery backup that supplies energy for no less than 4 hours to accomplish the following actions:

- (1) Power all detection devices
- (2) Energize all electrically operated actuating devices
- (3) Energize local visual and audible alarms
- (4) Transfer all auxiliary control and alarm contacts
- (5) Control system-disabling interlock and process shutdown circuits

10.5.2 The control panel shall, as a minimum, fully and continuously supervise the following components:

- (1) Wiring circuits for opens and other faults
- (2) ac power supply (primary)
- (3) Battery voltage, presence, and polarity
- (4) System safety interlock circuitry
- (5) System-disabling interlock circuitry, including lockout and tagout status
- (6) Releasing outputs
- (7) Electrically operated actuating devices
- (8) Detection devices
- (9) Local visual and audible alarms
- (10) Circuit ground fault
- (11) Suppressor pressure indicators

10.5.2.1 Failure of, or critically low voltage from, the battery backup shall generate a trouble signal to shut down the protected process per 10.4.6.1.

N 10.5.2.2 The minimum number of detection devices shall be either one device that is a transducer with a continuously monitored process parameter output, or two devices that are switches or transducers that are not continuously monitored, where the two switches are connected such that an alarm condition on either switch will activate the system.

10.5.2.3* Additional detection devices shall be permitted for the purpose of reducing spurious failures.

10.5.3* The supervisory circuits in 10.5.2 shall be provided with a visual and an audible signal.

Δ 10.5.4 Control panel contacts shall be provided that enable the owner or operator to initiate an automatic shutdown of the process and protection system should unauthorized entry of a protected enclosure be attempted.

10.6 Detection Devices.

10.6.1* The deflagration shall be detected by the sensing of one or more of a specified pressure, a specified rate of pressure rise, a vent burst, or the radiant energy from the combustion process.

10.6.2 Provisions shall be made to minimize obscuration of radiant energy detectors.

10.6.3 Detection devices shall be located to minimize accumulation of foreign material that would affect functioning.

10.6.4 Detection devices shall be mounted so that their maximum temperature rating, as specified by the manufacturer, is not exceeded.

10.7 Electrically Operated Actuating Devices.

10.7.1* Electrically operated actuating devices shall be mounted so that their maximum temperature rating, as specified by the manufacturer, is not exceeded.

10.7.2 The operating characteristics of the as-installed actuating device circuits shall be within the manufacturer's specifications.

10.8* Suppressant and Suppressant Storage Containers.

10.8.1* The suppressant shall be compatible with the combustible material in the protected enclosure.

10.8.2 The suppressant shall be effective at the expected extremes of temperature encountered in the protected enclosure.

10.8.3 If agent storage container pressure falls below the manufacturer's required level, a trouble signal shall be sent to the control unit indicating a disabled protection system.

10.8.4 Suppressant storage containers, if used as pressurized shipping containers, shall be designed to meet the requirements of the **US** Department of Transportation, 49 CFR Part 173.24.

10.8.5 Suppressant storage containers, if not used as pressurized shipping containers, shall be designed, fabricated, inspected, certified, and stamped in accordance with Section VIII of the ASME *Boiler and Pressure Vessel Code*.

10.8.6 The design pressure shall be suitable for the maximum pressure developed at 55°C (130°F) or at the maximum controlled temperature limit.

Chapter 11 Deflagration Control by Active Isolation

11.1 Application.

11.1.1* The technique of deflagration isolation shall be permitted for interruption or mitigation of flame, deflagration pressures, pressure piling, and flame-jet ignition between enclosures that are interconnected by pipes or ducts.

11.1.2* Active isolation techniques shall incorporate detection, control, and an energy source independent of the process (e.g., pneumatic or electrical response) that creates an isolating barrier.

11.1.3 Active isolation system design shall be permitted to be based on various techniques that include, but are not limited to, the use of the following equipment:

- (1) Flame front extinguishing system (chemical isolation)
- (2) Fast-acting mechanical valve (explosion isolation valves)
- (3) Actuated float valve
- (4) Actuated pinch valve

11.1.4 The isolation system type shall be of a design that has been tested under deflagration conditions to verify performance.

11.1.5* The detection conditions, and the positioning of the detection points and the minimum and maximum barrier locations shall be based on a quantitative analysis that includes factors such as, but not limited to, the following parameters:

- (1) The entire range of flammable concentrations
- (2) Time required for detection for the least-sensitive and the most-sensitive mixtures
- (3) Possible ignition locations in the primary enclosure
- (4) Time required for barrier formation
- (5) Flame speeds and pressures expected in the pipe
- (6) Time of flame front propagation to the barrier position
- (7) Flow velocity

11.1.6 Piping, ducts, and enclosures protected by an isolation system shall be designed to withstand estimated pressures as provided by the isolation system manufacturer.

11.2* Isolation Techniques. Isolation methods shall be permitted to be used to interrupt or mitigate flame propagation, deflagration pressure, pressure piling, and flame-jet ignition between items of equipment. Active isolation systems shall be permitted to be based on various techniques that include, but are not limited to, the use of the following components:

- (1) Chemical barrier
- (2) Fast-acting mechanical valve
- (3) Externally actuated float valve
- (4) Actuated pinch valve

11.2.1 Chemical Barrier.

11.2.1.1* The function of a chemical isolation system is to inject a barrier of extinguishing agent into the interconnection prior to the arrival of the flame front.

11.2.1.2 The chemical isolation system shall consist of one or more detectors, a control panel, and agent injection equipment.

11.2.1.2.1 Actuation shall be based on detection of pressure or radiant energy with a control panel to provide the initiating signal to the agent containers.

11.2.1.2.2 The agent containers shall be fitted with a fast-acting release that permits injection of agent within milliseconds of receiving the initiating signal.

11.2.1.2.3 Agent containers shall be designed to discharge the agent rapidly.

11.2.1.2.4 The size and number of containers shall be selected to provide the required barrier.

11.2.1.3 The isolation design shall include all information required to install and operate the system, including the following information:

- (1) Detection specification of activation pressure or pressure rate of rise
- (2) Detector location requirements and limits for pressure or optical detection
- (3) Minimum placement location for agent container(s) relative to the protected volume or detector location
- (4) Maximum placement location for agent container(s) relative to the protected volume or detector location
- (5) Required distance downstream of agent container(s)
- (6) Agent identity and minimum container pressure at ambient conditions
- (7) Size, number, and orientation of agent container(s)
- (8) Maximum process and ambient temperature

11.2.1.4 Extinguishing Agents and Containers.

11.2.1.4.1 The extinguishing agent shall be chemically compatible with the material normally conveyed through the pipe system being protected.

11.2.1.4.2 The extinguishing agent shall be of a type that is effective at all temperatures that are to be encountered in the application.

11.2.1.4.3* Extinguishing agent containers, if used as shipping containers, shall be designed to meet the requirements of the US Department of Transportation, 49 CFR Part 173.24.

11.2.1.4.4 If not used as shipping containers, extinguishing agent containers shall be designed, fabricated, inspected, certified, and stamped in accordance with Section VIII of the ASME *Boiler and Pressure Vessel Code*.

11.2.1.4.5 The design pressure shall be suitable for the maximum pressure developed at 55°C (130°F) or at the maximum controlled temperature limit.

11.2.1.5 Limitations. The specific application limitations created by equipment performance specifications and process conditions shall not be exceeded. These limitations include the following:

- (1) Minimum and maximum distance of a barrier from the duct entrance
- (2) Process flow rates
- (3) Direction of flow
- (4) Flow resistance
- (5) $P_{\text{detection}}$ less than P_{stat} when the enclosure is vented
- (6) Process temperature and pressure

11.2.1.6 Chemical isolation system components exposed to the process environment shall be capable of withstanding the maximum expected deflagration pressure.

11.2.2* Fast-Acting Mechanical Valves.

11.2.2.1 Fast-acting mechanical valves shall prevent propagation of flame and combustion-generated pressure beyond the fast-acting valves by providing a positive mechanical seal. The mechanical valve shall be capable of withstanding the maximum expected deflagration pressures, including pressure piling.

11.2.2.2* The mechanical isolation system shall consist of one or more detectors, a control panel, and a fast-acting valve assembly.

11.2.2.2.1 Actuation shall be based on detection of pressure or radiant energy with a control panel, to provide the initiating signal to the mechanical valve.

11.2.2.2.2 The mechanical valve assembly shall include a means of rapidly moving the valve trim.

11.2.2.3 The isolation design shall include all information required to install and operate the system, including the following information:

- (1) Detection specification of activation pressure or rate for pressure detection
- (2) Detector location requirements and limits for pressure or optical detection
- (3) Minimum placement location for mechanical valve relative to the protected volume or detector location
- (4) Maximum placement location for mechanical valve relative to the protected volume or detector location
- (5) Maximum process and ambient temperature
- (6) Minimum actuation pressure

11.2.2.4 Limitations. The specific application limitations created by equipment performance specifications and process conditions shall not be exceeded. These limitations include the following:

- (1) Minimum and maximum distance of a valve from the duct entrance
- (2) Process flow rates
- (3) Direction of flow
- (4) Orientation of the valve
- (5) Flow resistance
- (6) $P_{\text{detection}}$ less than P_{stat} when the enclosure is vented
- (7) Process temperature

11.2.2.5* Mechanical isolation system components exposed to the process environment shall be capable of withstanding the maximum expected deflagration pressure, including pressure piling.

11.2.3 Externally Actuated Float Valve.

11.2.3.1* The externally actuated float valve shall isolate the explosion by means of a moveable valve plug pressing upon a valve seat.

11.2.3.2* The float valve shall be actuated and caused to move by pneumatic discharge from a pressurized container, by the discharge of a gas generator into a pneumatic cylinder connected to the float, or by other high-speed actuation means.

11.2.3.3 The externally actuated float valve system shall consist of one or more detectors, a control panel, a float valve, and a pressure container or gas generator actuation device.

11.2.3.3.1 Actuation shall be based on detection of pressure or radiant energy with a control panel to provide the initiating signal to the actuator.

11.2.3.3.2 When used, the container shall be pressurized with gas to close the float valve rapidly and completely.

11.2.3.4* The isolation design shall include all information required to install and operate the system, including the following:

- (1) Detection specification of activation pressure or rate of pressure rise
- (2) Detector location requirements and limits for pressure or optical detection
- (3) Minimum placement location for float valve relative to the protected volume or detector location
- (4) Maximum placement location for float valve relative to the protected volume or detector location
- (5) Maximum process and ambient temperature
- (6) Maximum and minimum process flow rate
- (7) Maximum permissible dust loading
- (8) Minimum actuation pressure

11.2.3.5 Limitations. The specific application limitations created by equipment performance specifications and process conditions shall not be exceeded. These limitations include the following:

- (1) Minimum and maximum distance of a valve from the duct entrance
- (2) Process flow rates
- (3) Direction of flow
- (4) Orientation of the valve
- (5) Flow resistance
- (6) $P_{\text{detection}}$ less than P_{stat} when the enclosure is vented
- (7)* Process temperature and pressure

11.2.4 Actuated Pinch Valve.

11.2.4.1* The pinch valve shall isolate the explosion by means of a collapsible elastomer pinch.

11.2.4.2* The pinch valve shall be actuated and caused to close by gas discharge from a pressurized cylinder connected to the pinch.

11.2.4.3 The actuated pinch valve system shall consist of one or more detectors, a control panel, a pinch valve, and a pressure cylinder.

11.2.4.3.1 Actuation shall be based on detection of pressure or radiant energy with a control panel, to provide the initiating signal to the actuator.

11.2.4.3.2 The container shall be pressurized with gas sufficient to close the pinch valve rapidly and completely.

11.2.4.4 The isolation design shall include all information required to install and operate the system, including the following:

- (1) Detection specification of activation pressure or rate of pressure rise
- (2) Detector location requirements and limits for pressure or optical detection
- (3) Minimum placement location for pinch valve relative to the protected volume or detector location
- (4) Maximum placement location for pinch valve relative to the protected volume or detector location

- (5) Maximum process and ambient temperature
- (6) Maximum and minimum process flow rates
- (7)* Maximum permissible dust loading
- (8) Minimum actuation pressure

11.2.4.5 Limitations. The specific application limitations created by equipment performance specifications and process conditions shall not be exceeded. These limitations include the following:

- (1) Minimum and maximum distance of a valve from the duct entrance
- (2) Process and ambient temperatures
- (3) $P_{\text{detection}}$ less than P_{stat} when the enclosure is vented
- (4) Process flow rates
- (5) Maximum deflagration pressure

11.2.4.6 Where the normal operation of the equipment is under vacuum, the pinch valve shall be configured with an equalization line to avoid pinch infringement into the process flow stream.

11.3 Personnel Safety.

11.3.1 The safety of personnel working with and around explosion prevention equipment shall be addressed as specified in Section 15.10.

11.3.2* Disarming and Lockout/Tagout Procedures.

11.3.2.1 Disarming and OSHA lockout/tagout procedures (29 CFR 1910.147) and confined space entry procedures (29 CFR 1910.146), or local country equivalent, shall be followed prior to entering an enclosure or ductwork protected by an isolation system.

11.3.2.2 The isolation system shall be disarmed and locked out/tagged out prior to performing maintenance operations on the protected enclosure, ducting, or isolation system if actuation could result in injury.

11.3.2.3 Isolation systems shall be provided with a means to prevent release of stored energy.

11.3.2.4 The system shall be configured to prevent arming while such means are in place.

11.3.2.5 Locks and tagging shall be used to identify systems that have such prevention means in place.

11.3.2.6 Operation of the protected process shall be interlocked through the isolation system control panel so that operation cannot be resumed until the isolation system is armed.

11.4 Basic Design and Operation.

11.4.1 System Design Certification.

11.4.1.1 System design methodology and application range shall have been supported by appropriate testing and certified by a recognized testing organization acceptable to the authority having jurisdiction. (See A.10.4.2.1.)

11.4.1.2 The system design methodology shall be based on testing relevant to the isolation system.

11.4.1.3 Chemical (Barrier) Isolation. The system testing shall consider, but not be limited to, the following design factors or performance measures:

- (1) Flame propagation behavior for relevant system conditions

- (2) Detection parameters for specific placement locations, with consideration given to the potential range of fuels, ignition locations, and detector type
- (3) Barrier formation dynamics, including duration
- (4) Agent (barrier) concentration or quantity requirement
- (5) Minimum and maximum barrier locations from the equipment
- (6) Post-barrier extinguishing distance
- (7) Pressure at barrier placement

11.4.1.4 Mechanical Isolation. The system testing shall consider, but not be limited to, the following design factors or performance measures:

- (1) Flame propagation behavior for relevant system conditions
- (2) Detection parameters for specific placement locations, with consideration given to the potential range of fuels, ignition locations, and detector type
- (3) Activation dynamics of the closure
- (4) Minimum and maximum placements
- (5) Pressure at valve placement
- (6) Pressure limitation of hardware

11.4.1.5 Actuated Float Valve. The system testing shall consider, but not be limited to, the following design factors or performance measures:

- (1) Flame propagation behavior for relevant system conditions
- (2) Detection parameters for specific placement locations, with consideration given to the potential range of fuels, ignition locations, and detector type
- (3) Activation dynamics of the closure
- (4) Minimum and maximum placements
- (5) Pressure at valve placement
- (6) Pressure limitation of hardware

11.4.1.6 Actuated Pinch Valve. The system testing shall consider, but not be limited to, the following design factors or performance measures:

- (1) Flame propagation behavior for relevant system conditions
- (2) Detection parameters for specific placement locations, with consideration given to the potential range of fuels, ignition locations, and detector type
- (3) Activation dynamics of the closure
- (4) Minimum and maximum placements
- (5) Pressure at valve placement
- (6) Pressure limitation of hardware

11.4.2 Protection System Design and Operation.

11.4.2.1* The owner or operator shall be responsible for a thorough analysis of the process that shall be conducted to determine the type and degree of deflagration hazards inherent in the process.

11.4.2.2 The information required for the isolation design shall include, but not be limited to, the following:

- (1) Protection objective
- (2) Protected area of the process
- (3) Dimensioned drawings of the process with equipment make and model if available, including volumes and diameters and design strengths
- (4) Plan and elevation views with flows indicated

(5) Startup, normal, shutdown, temporary operations, and emergency shutdown process conditions and ranges for:

- (a) Flow
- (b) Temperature
- (c) Pressure
- (d) Oxidant concentration
- (e) Fuel concentration
- (6) Process flow diagram and description
- (7) Previously installed protection equipment
- (8) Ambient temperature in process area
- (9) Explosibility properties of the combustible materials
- (10) Process interlocks

11.4.2.3 The owner or operator shall disclose any and all process information required for the protection system design.

11.4.2.4 Maintenance.

11.4.2.4.1 The owner or operator shall be responsible for the maintenance of the system after installation and acceptance based on procedures provided by the vendor.

11.4.2.4.2 Maintenance records shall be retained for inspection by the authority having jurisdiction in accordance with Section 15.9.

11.4.2.5 Inspection.

11.4.2.5.1 The owner or operator shall be responsible for periodic inspection of the system by personnel trained by the system manufacturer.

11.4.2.5.2 The inspection frequency shall be in accordance with Section 15.7.

11.4.2.6 Management of Change. The effect of any process change shall be addressed as specified in Section 15.11.

11.4.2.7 All design documentation relevant to the protection system shall be retained in accordance with Chapter 15.

11.4.3* System Manufacturer's Additional Responsibilities. The system manufacturer shall provide the owner or operator with information and documentation that supports the design and that is suitable for review by the AHJ.

11.4.3.1 Upon request, the system manufacturer shall provide to the owner or operator documentation supporting that the design is in compliance with the manufacturer's independent third-party approval, including application limitations, and is suitable for the hazard to be protected.

11.4.3.2 The system manufacturer shall provide to the owner or operator design specifications based on the data provided by the owner or operator as specified in 11.4.2.2.

11.4.3.2.1 Documentation shall be made of the data used in the design.

11.4.3.2.2 The final reduced deflagration pressures shall be provided.

11.4.3.2.3 Method of determination shall be third party approved and available for review by the authority having jurisdiction.

11.4.3.3 The system manufacturer shall provide to the owner or operator mechanical and electrical drawings of the protection system.

11.4.3.4 The system manufacturer shall provide to the owner or operator installation instructions, operating manuals, and maintenance instructions.

11.4.3.5 As part of system acceptance, the system manufacturer and the owner or operator shall document that the installation is in accordance with the design and the system is armed and functional. (See Section 15.6.)

11.4.3.5.1 Variances and any corrective actions shall be identified with the responsible party for any action identified.

11.4.3.5.2 Changes made at or during installation shall be approved by the system manufacturer and owner or operator and suitably documented.

11.4.3.5.3 Concurrence of the AHJ shall be obtained as appropriate.

11.4.4 Process Shutdown. Upon activation, the isolation system shall initiate an immediate, automatic shutdown of the protected process.

11.4.4.1 Upon receipt of a trouble signal, which indicates the protection system could be compromised, an orderly shutdown of the protected process shall be initiated.

11.4.4.2 Upon receipt of a supervisory signal, which indicates that a problem exists but that the protection system is not compromised, qualified personnel shall investigate and repair the problem at the next shutdown period.

11.4.5 Installation, Inspection, and Maintenance. The installation, inspection, and maintenance of explosion prevention systems shall be addressed as specified in Chapter 15.

11.5 Detection Devices.

11.5.1* The deflagration shall be detected by sensing one or more of a specified pressure, a specified rate of pressure rise, a vent burst, or the radiant energy from the combustion process.

11.5.2 Provisions shall be made to minimize obscuration of radiant energy detectors.

11.5.3 Detection devices shall be located to minimize accumulation of foreign material that would affect functioning.

11.5.4 Detection devices shall be mounted so that their maximum temperature rating, as specified by the manufacturer, is not exceeded.

11.6 Electrically Operated Actuating Devices.

11.6.1* Electrically operated actuating devices shall be mounted so that their maximum temperature rating, as specified by the manufacturer, is not exceeded.

11.7 Control Panels.

11.7.1 Each isolation system shall be provided with a control panel having a standby battery backup that supplies energy for no less than 4 hours to accomplish the following actions:

- (1) Power all detection devices
- (2) Energize all electrically operated actuating devices
- (3) Energize local visual and audible alarms
- (4) Transfer all auxiliary control and alarm contacts
- (5) Control system-disabling interlock and process shutdown circuits

11.7.2 The control panel shall, as a minimum, fully and continuously supervise the following conditions:

- (1) Wiring circuits for opens and other faults
- (2) AC power supply (primary)
- (3) Battery voltage, presence, and polarity
- (4) System safety interlock circuitry
- (5) System-disabling interlock circuitry including lockout and tagout status
- (6) Releasing outputs
- (7) Electrically operated actuating devices
- (8) Detection devices
- (9) Local visual and audible alarms
- (10) Circuit ground fault
- (11) Isolation container pressure indicators

N 11.7.2.1 Failure of, or critically low voltage from, the battery backup shall generate a trouble signal to shut down the protected process per 11.4.4.1.

11.7.3* The supervisory circuits in 11.7.2 shall be provided with visual and audible signals.

Δ 11.7.4 Control panel contacts shall be provided that enable the owner or operator to initiate an automatic shutdown of the process and protection system should unauthorized entry of a protected enclosure be attempted.

11.7.5 If a pressurized container pressure falls below manufacturer's required level, a trouble signal shall be sent to the control unit indicating a disabled protection system.

Chapter 12 Deflagration Control by Passive Isolation

12.1* Application.

12.1.1* The technique of deflagration isolation by passive means shall be permitted for interruption or mitigation of flame, deflagration pressures, pressure piling, and flame-jet ignition between enclosures that are interconnected by pipes or ducts.

N 12.1.1.1* Deflagration isolation by passive means shall also be permitted for end-of-line applications as specified in 12.2.8.

12.1.2 Passive isolation techniques shall create an isolating barrier independent of energized detection and control equipment.

12.1.3 Piping, ducts, and enclosures protected by an isolation system shall be designed to withstand estimated pressures as provided by the isolation system manufacturer.

Δ 12.2 Passive Isolation Techniques. Passive isolation system design shall be permitted to be based on various techniques that include, but are not limited to, the use of the following equipment:

- (1) Flame front diverters
- (2) Flow-actuated float valves
- (3) Flow-actuated flap valves
- (4) Rotary valves
- (5) Static dry flame arresters
- (6) Hydraulic-type (liquid seal) flame arresters
- (7) Liquid product flame arresters
- (8) Dust flame-arresting devices

12.2.1* Flame Front Diverters.

12.2.1.1* Different Types of Flame Front Diverters. Flame front diverters shall be permitted to be any of the following types:

- (1) Rupture disc diverters
- (2) Explosion door diverters
- (3) Self-closing explosion door diverters

12.2.1.2 Basic System Design Considerations. The design of a flame front diverter system shall consider, but shall not be limited to, the following criteria:

- (1) Deflagration characteristics of the combustible material
- (2) Type of deflagration protection used on the upstream enclosure, if any
- (3) Length, cross-sectional area, configuration, and strength of the piping
- (4) Turbulence-generating features in the piping such as fittings, valves, elbows, and wall roughness
- (5) Velocity of the combustible fuel–air mixture in the pipe
- (6) Location of the flame front diverter relative to the protected downstream enclosure
- (7) Location of probable ignition sources

12.2.1.3 Flame Front Diverter Design Requirements.

12.2.1.3.1 The body design shall divert the flame front to atmosphere and away from the downstream piping.

12.2.1.3.2 The body shall be capable of withstanding the expected deflagration pressure.

12.2.1.3.3 The closure device shall be a rupture disc, cover plate, or door.

12.2.1.3.4 The opening pressure of the closure device shall be less than 100 mbar (1.74 psi).

12.2.1.3.5 Where the closure device could be a missile hazard, it shall be either tethered or contained in a cage.

12.2.1.3.6 The flame front diverter shall discharge to a safe, unrestricted, outdoor location, and the discharge shall not be obstructed.

12.2.1.3.7 Flame front diverters shall be marked with respect to the direction of deflagration propagation.

12.2.1.4 System Certification. The flame front diverter system design methodology and application range shall be supported by appropriate testing and certified by a recognized testing organization acceptable to the authority having jurisdiction. (*See A.10.4.2.1.*)

12.2.1.4.1* A performance demonstration shall include a determination that the device is capable of maintaining mechanical integrity under expected deflagration conditions and of limiting pressure piling in the downstream protected equipment.

12.2.1.4.2 Upon request, the system manufacturer shall provide to the owner or operator documentation supporting that the design is in compliance with the manufacturer's independent third-party approval, including application limitations, and is suitable for the hazard to be protected.

12.2.1.5 Flame Front Diverter Application Limits. Flame front diverter limitations shall include, but not be limited to, the following:

- (1) A flame front diverter shall not be permitted as the only means of isolation if the design intent is to completely stop flame propagation.
- (2) A flame front diverter shall not be permitted to be used for gases where the piping configuration could result in transition to detonation.
- (3) A flame front diverter shall not be permitted to be used with toxic process materials.
- (4) A flame front diverter shall be located outdoors.

N 12.2.1.6 Inspection. The flame front diverter shall be inspected in accordance with Section 15.7.

12.2.2* Flow-Actuated Float Valve. The interior of this valve shall be designed to contain a valve plug (float) that can be moved axially within its housing. If an explosion (deflagration) occurs, the valve shall close automatically because of the pressure wave preceding the flame front.

12.2.2.1* Flow-Actuated Float Valve Design. Float valve system design shall include the following considerations:

- (1) Deflagration characteristics of the combustible material
- (2) Volume, configuration, and operating characteristics of the equipment to be protected and the conveying system
- (3) Type of deflagration protection used on the enclosure, if any
- (4) Length, cross-sectional area, configuration, and strength of the piping
- (5) Turbulence-generating features in the piping such as fittings, valves, elbows, and wall roughness
- (6) Velocity of the combustible fuel–air mixture in the pipe
- (7) Location of probable ignition sources
- (8) Anticipated differential pressure across the valve during deflagration
- (9) Normal process flow velocity and direction at the valve location
- (10) Orientation of the valve

12.2.2.2 Float Valve Design Criteria. Float valve design criteria shall comply with 12.2.2.2.1 through 12.2.2.2.4.

12.2.2.2.1 The anticipated differential pressure across the valve during deflagration, as determined by the valve manufacturer, shall be greater than the float valve closing pressure.

12.2.2.2.2 The normal process flow velocity at the valve shall be less than the specified limit for the float valve closure.

12.2.2.2.3 The valve shall include a means to latch it in the closed position upon actuation.

12.2.2.2.4 Upon activation, the float valve shall initiate an immediate, automatic shutdown of the protected process.

12.2.2.3 System Certification. The float valve deflagration isolation system design methodology and application range shall be supported by appropriate testing and certified by a recognized testing organization acceptable to the authority having jurisdiction. (*See A.10.4.2.1.*)

12.2.2.3.1 A performance demonstration shall include the required minimum and maximum location placement distances from the expected ignition source and the range of allowable P_{red} for the enclosure where the ignition might occur.

12.2.2.3.2 Upon request, the system manufacturer shall provide to the owner or operator documentation supporting that the design is in compliance with the manufacturer's independent third-party approval, including application limitations, and is suitable for the hazard to be protected

12.2.2.4* Float Valve Application Limits. Float valves shall not be permitted to be used under the following circumstances:

- (1) With slow propagating explosions, below the limits of the test data (Bartknecht, 1989)
- (2) In a stream containing significant quantities of accumulating dust, as specified by the manufacturer

N 12.2.2.5 Inspection. The passive float valve and its interior shall be inspected in accordance with Section 15.7.

12.2.3 Flow-Actuated Flap Valve. The flap valve shall be mounted on the inlet conveying duct of a protected vessel and open in the direction of process flow.

12.2.3.1 The interior of the flap valve shall be designed to contain a flap plate on a perpendicular shaft that can be turned within its housing.

12.2.3.2 If an explosion (deflagration) occurs, the valve shall close automatically as a result of the pressure wave preceding the flame front.

12.2.3.3 Flow-Actuated Flap Valve Design. Flap valve system design shall include the following considerations:

- (1) Deflagration characteristics of the combustible material
- (2) Volume, configuration, and operating characteristics of the equipment to be protected and the conveying system
- (3) Type of deflagration protection used on the enclosure, if any
- (4) Material loading in the conveying duct
- (5) Material physical properties (i.e., abrasiveness, adhesiveness, etc.)
- (6) Length, cross-sectional area, configuration, and strength of the piping
- (7) Turbulence generating-features in the piping, such as fittings, valves, elbows, and wall roughness
- (8) Velocity of the combustible dust/air mixture in the pipe
- (9) Location of probable ignition sources
- (10) Normal process flow velocity and direction at the valve location
- (11) Orientation of the valve
- (12) Maximum allowable reduced explosion pressure of the valve

12.2.3.4 Flow-Actuated Flap Valve Design Criteria. Flap valve design criteria shall comply with 12.2.3.4.1 to 12.2.3.4.7.

12.2.3.4.1 The anticipated differential pressure across the valve during deflagration, as determined by the valve manufacturer, shall be greater than the flap valve closing pressure.

12.2.3.4.2 Upon actuation from a deflagration pressure wave, the flap plate shall close and remain sealed via a locking mechanism to prevent flame and burning material propagation.

12.2.3.4.3 The flap valve shall have an inspection door to allow periodic inspection of the flap plate and seal.

12.2.3.4.4 Upon activation, the flap valve shall initiate an immediate, automatic shutdown of the protected process.

Δ 12.2.3.4.5* A continuous signal shall be provided to indicate if valve operation is compromised by the accumulation of a dust layer on the interior of the valve.

12.2.3.4.5.1 Upon receipt of a trouble signal, which indicates that the protection system could be compromised, an orderly shutdown of the protected process shall be initiated.

N 12.2.3.4.5.2 Upon receipt of a supervisory signal, which indicates that a problem exists but that the protection system is not compromised, qualified personnel shall investigate and repair the problem at the next shutdown period.

N 12.2.3.4.6* The flow-actuated flap valve and its interior shall be inspected in accordance with Section 15.7.

12.2.3.4.7* The conveying ductwork between the protected vessel and the flap valve shall be of sufficient strength to withstand the expected peak pressure.

12.2.3.5 System Certification. The flow-actuated flap valve deflagration isolation system design methodology and application range shall be supported by appropriate testing and certified by a recognized testing organization acceptable to the authority having jurisdiction. (*See A.10.4.2.1.*)

12.2.3.5.1 A performance demonstration shall determine the following:

- (1) Minimum and maximum location placement distances from the expected ignition source
- (2) Minimum and maximum K_{St}
- (3) Maximum number of flow direction changes
- (4) Maximum dust loading
- (5) Maximum air velocity
- (6) Range of allowable P_{red} within the protected enclosure where the ignition might occur

12.2.3.5.2 Upon request, the system manufacturer shall provide to the owner or operator documentation supporting that the design is in compliance with the manufacturer's independent third-party approval, including application limitations, and is suitable for the hazard to be protected.

12.2.3.6 Flow-Actuated Flap Valve Application Limits. Flap valves shall not be permitted to be used under the following circumstances:

- (1) With slow propagating explosions, below the limits of the test data
- (2) In a stream containing significant quantities of agglomerating dust, as specified by the manufacturer
- (3) In a stream containing flammable gases/vapors or hybrid mixtures
- (4) In a stream containing chemically unstable material
- (5) In a stream containing pyrotechnic or explosive material
- (6) In a dense phase conveying stream

Δ 12.2.4 Rotary Valves. Rotary valves shall be designed and used as described in 12.2.4.

12.2.4.1* Rotary Valve System Design Considerations. Rotary valve system design considerations shall include the following:

- (1) Deflagration characteristics of the combustible material
- (2) Volume, configuration, and operating characteristics of the equipment to be protected and the conveying system
- (3) Type of deflagration protection used on the vessel
- (4) Maximum deflagration pressure that the rotary valve will experience

12.2.4.2 Rotary Valve Design Criteria. Rotary valves intended for deflagration isolation systems shall be designed according to one of the following isolation concepts:

- (1) Deflagration isolation by flame quenching (close-clearance valves)
- (2) Deflagration isolation by material blocking (product layer above the valve)

12.2.4.3* The design criteria in 12.2.4.3.1 through 12.2.4.3.9 shall be applicable to either concept defined in 12.2.4.2.

12.2.4.3.1 The valve body and rotor shall have sufficient strength to withstand the maximum anticipated explosion pressure, P_{md} .

12.2.4.3.2 The design basis shall include the specific explosion characteristics (K_{St} and P_{max}) of the powder being handled.

12.2.4.3.3 The valve pressure resistance shall be certified or tested by a knowledgeable test authority.

12.2.4.3.4 There shall be at least six vanes on the rotor, diametrically opposed.

12.2.4.3.5 At least two vanes on each side of the valve housing shall be in a position of minimum clearance at all times.

12.2.4.3.6 The valve shall have metal body and vanes unless it is shown by test data that nonmetallic or composite materials prevent flame passage.

12.2.4.3.7 Rotary valve bearings shall be mounted externally.

12.2.4.3.8 An independent explosion detection device or interlock from another installed explosion prevention or control system on the same protected enclosure shall be interlocked to automatically stop the rotary valve upon a deflagration event.

12.2.4.3.9 The need for performance testing of the valve design shall be determined by the authority having jurisdiction.

12.2.4.4* Rotary Valve with Material Blocking.

N 12.2.4.4.1* Material chokes shall be permitted to be used as isolation devices for processes handling dusts.

12.2.4.4.2 A material block shall be maintained above rotary valves with a design clearance between vane and valve body greater than 0.2 mm (0.008 in.).

12.2.4.4.3 A level control switch shall be provided and interlocked to the rotary valve to maintain a minimum material layer above the valve inlet flange.

12.2.4.4.4 The minimum maintained material level above the inlet flange shall be at least equal to the larger of the valve inlet equivalent diameter or 0.3 m (1 ft).

12.2.4.5* Close-Clearance Rotary Valves.

12.2.4.5.1* For nonmetal dusts, close-clearance rotary valves shall be designed with a clearance between vane and valve body less than or equal to 0.2 mm (0.008 in.).

12.2.4.5.2 For metal dusts, the ability of the device to prevent flame transmission shall be verified by testing by a third party demonstrating that the actual clearance is small enough to prevent the passage of flame between the rotor and valve housing.

N 12.2.4.5.3* When the valve is intended to operate at elevated temperatures, it shall be permitted to calculate the clearance between the vanes and the valve body at ambient conditions that will establish the specified 0.2 mm (0.008 in.) maximum clearance at the intended operating temperature.

N 12.2.4.5.4* When the valve is intended to operate at elevated temperatures, the rotary valve shall attain the intended operating temperature before the passage of combustible material through the rotary valve.

N 12.2.4.5.5 The clearance between the vanes and the valve body shall be permitted to exceed 0.2 mm (0.008 in.) if testing by a third party demonstrates that the actual clearance is small enough to prevent the passage of flame between the rotor and valve housing.

N 12.2.4.5.6* The specified clearance between the vanes and the valve body of the rotary valve shall be measured before installation.

12.2.4.5.7 The actual clearance between the vanes and the valve body of the rotary valve shall be monitored using a predictive maintenance program such that the required clearance is not exceeded due to wear. (See A.12.2.4.5.6.)

12.2.4.6 Rotary Valve Application Limits. Rotary valves shall not be permitted to be used as an isolation device for systems handling hybrid mixtures or gases.

N 12.2.4.7 Inspection. Rotary valves shall be inspected in accordance with Section 15.7.

12.2.5* Static Dry Flame Arresters.

12.2.5.1 General Application. This section shall not apply to the following equipment:

- (1) Devices that utilize a liquid-type flame arrester to prevent the passage of flame
- (2) Devices that rely on gas flow velocity to prevent upstream propagation of flame
- (3) Systems handling combustible dusts

12.2.5.2* Static Dry Flame Arrester Designs. For the purposes of this subsection, flame arresters shall be divided into the following groups:

- (1) In-line deflagration arrester
- (2) In-line stable detonation arrester
- (3) In-line unstable detonation arrester
- (4) End-of-line deflagration arrester
- (5) In-equipment deflagration arrester

12.2.5.3 Static Flame Arrester System Design Considerations. Static flame arrester system design considerations shall include the following:

- (1) Deflagration characteristics of the combustible material, including the maximum experimental safe gap (MESG)
- (2) Length, cross-sectional area, configuration, and strength of the piping on the unprotected side of the flame arrester (ignition source)
- (3) Turbulence-generating features in the piping on the unprotected side such as fittings, valves, elbows, and wall roughness
- (4) Location of probable ignition sources
- (5) Potential for continued burning
- (6) Arrester orientation

- (7) Process conditions during startup, normal operation, and shutdown

12.2.5.4* Static Dry Flame Arrester Design Criteria. Static dry flame arrester systems shall be designed according to the criteria in 12.2.5.4.1 through 12.2.5.4.15.

12.2.5.4.1 Flame arresters shall be placed in the potential flame path between the source of ignition and the system to be protected.

12.2.5.4.2 The maximum allowable distance from the ignition source shall be documented in an independent third-party approval and in the maintenance and instruction manuals.

12.2.5.4.3 Static dry flame arresters shall consist of a flame arrester element(s) in a housing.

12.2.5.4.4 Flame arresters shall be installed and maintained in accordance with the manufacturer's instructions.

12.2.5.4.5 In-line arresters that can experience continued burning for a time longer than that for which they were tested or that are installed in a different orientation than in the approval test (i.e., an arrester that has undergone continuous-burning test in a upright position with one end open to atmosphere, but that is actually installed horizontally in a closed piping system) shall meet the criteria in 12.2.5.4.5.1 through 12.2.5.4.5.4.

12.2.5.4.5.1 A means of detecting the burning shall be provided on both sides of the arrester along with an alarm or automatic device to interrupt flow prior to failure.

12.2.5.4.5.2* The response time for shutoff shall not extend beyond 1 minute.

12.2.5.4.5.3 The shutoff temperature selected shall be determined on a case-by-case basis by, but not limited to, the following criteria:

- (1) The normal operating temperature of the vapor stream
- (2) The maximum operating temperature of the vapor stream
- (3) The vapor with the lowest autoignition temperature in the vapor stream

12.2.5.4.5.4 If thermocouples are used, they shall not be placed in thermowells unless specifically tested in that configuration.

12.2.5.4.6 The pipe diameter on the unprotected side shall be no larger than the flame arrester inlet connection within 120 times the length-to-diameter ratio of the arrester inlet.

12.2.5.4.7 The pipe diameter on the protected side shall be no less than the pipe diameter on the unprotected side, unless tested with a restriction on the protected side.

12.2.5.4.8 Continuous monitoring of pressure drop shall be provided if the process is known to contain particulates or substances that could block the element and overpressurize the system.

12.2.5.4.9 Suitability of a flame arrester shall be checked if the process conditions or pipework configuration has been changed.

12.2.5.4.10 All parts of the flame arrester shall be constructed to resist the expected mechanical, thermal, and chemical loads for the intended use.

12.2.5.4.11 All joints shall be constructed and sealed in such a way that flame cannot bypass the flame arrester element and that flame is prevented from propagating to the outside of the flame arrester.

12.2.5.4.12 Coatings of components that could be exposed to flames during operation shall not be damaged in such a way that flame transmission is possible.

12.2.5.4.13 When a flame arrester element has no intrinsic stability, it shall be secured in a rigid housing that cannot be dismantled without destruction.

12.2.5.4.14 Inspection. See 15.7.2.

12.2.5.4.15* Flame arresters shall be designed such that when mounted the forces of the deflagration or detonation will be absorbed by the support structure.

12.2.5.5 System Verification.

12.2.5.5.1 Flame arresters shall be tested in accordance with internationally recognized standards for the identified application (e.g., FM Global and USCG standards; ISO 16852, *Flame arresters — Performance requirements, test methods and limits for use*) and an independent third-party approval shall be issued.

12.2.5.5.2 Evidence that the manufacturing process is controlled within tolerances shall be available to ensure reproducibility.

12.2.5.5.3 Light metal alloys shall not contain more than 6 percent magnesium.

12.2.5.6 Static Dry Flame Arrester Application Limits.

12.2.5.6.1 Use of these devices shall not apply to operational temperature outside the approved temperature range; special testing and approval shall be required if the operational temperature is exceeded.

12.2.5.6.2 Use of these devices shall not apply to operational pressure outside the approved pressure range; special testing and approval shall be required if the operational pressure is exceeded.

12.2.5.6.3 Use of these devices shall be limited to gas-air mixtures with an MESG equal to or greater than that tested; special testing and approval shall be required for use with elevated oxygen concentration or other oxidants.

12.2.5.6.4 For in-line deflagration arresters, at least 10 percent of the cross-sectional area of the pipe shall be open at the identified process ignition source.

12.2.5.6.5 For in-line deflagration arresters the ratio of pipe length (between the potential ignition source and the flame arrester) and pipe diameter shall not exceed the tested ratio of length to diameter.

12.2.5.6.6 Where field installation includes elbows, tees, and instrumentation between the ignition source and the arrester, the owner shall provide isometric drawings of the intended piping layout to the vendor for review.

12.2.5.6.7 Use of these devices shall not apply outside the tested application limits.

12.2.5.6.8 The choice of stable versus unstable detonation arresters shall be made by the owner or operator in consultation with the vendor, giving consideration to piping configuration and location of probable ignition sources.

12.2.5.6.9 These devices shall not be used for self-decomposing mixtures, unless specifically tested for the application.

12.2.6* Hydraulic (Liquid Seal)–Type Deflagration Arresters. A liquid–type deflagration arrester shall be used for preventing the passage of flame by passing gas through a liquid.

12.2.6.1* Hydraulic (Liquid Seal)–Type Deflagration Arrester Designs. Hydraulic (liquid seal)–type deflagration arresters shall be either bubble screen or sparge tube type.

12.2.6.2 Hydraulic (Liquid Seal) Flame Arrester System Design Considerations. Hydraulic (liquid seal) flame arrester system design considerations shall include the following:

- (1) Deflagration characteristics of the combustible material, including MESG
- (2) Length, cross-sectional area, configuration, and strength of the piping on the unprotected side of the flame arrester (ignition source)
- (3) Turbulence-generating features in the piping on the unprotected side such as fittings, valves, elbows, and wall roughness
- (4) Location of probable ignition sources
- (5) Potential for continued burning
- (6) Arrester orientation
- (7) Process conditions during startup, normal operation, and shutdown
- (8) Tendency for foaming
- (9) Particulate load of the process vapors
- (10) Maximum process volumetric flow

12.2.6.3 Hydraulic (Liquid Seal) Flame Arrester Design Criteria. Hydraulic (liquid seal) flame arresters shall be designed according to the criteria in 12.2.6.3.1 through 12.2.6.3.25.

12.2.6.3.1 Hydraulic flame arresters shall be placed in the potential flame path between the source of ignition and the system to be protected.

12.2.6.3.2 The maximum allowable distance from the ignition source shall be documented in an independent third-party approval and in the maintenance and instruction manuals.

12.2.6.3.3 Hydraulic flame arresters shall be installed and maintained in accordance with the manufacturer's instructions.

12.2.6.3.4 Hydraulic flame arresters that can experience continued burning for a time longer than that for which they were tested or that are installed in a different orientation than in the approval test (e.g., an arrester that has undergone a continuous-burning test in an upright position with one end open to atmosphere but that is actually installed horizontally in a closed piping system) shall meet the criteria in 12.2.6.3.4.1 through 12.2.6.3.4.3.

12.2.6.3.4.1 A means of detecting the burning shall be provided on both sides of the arrester along with an alarm or automatic device to interrupt flow prior to failure.

12.2.6.3.4.2 The shutoff temperature selected shall be determined on a case-by-case basis by, but not limited to, the following criteria:

- (1) The normal operating temperature of the vapor stream
- (2) The maximum operating temperature of the vapor stream
- (3) The vapor with the lowest autoignition temperature in the vapor stream

12.2.6.3.4.3 If thermocouples are used, they shall not be placed in thermowells unless specifically tested with these.

12.2.6.3.5 Suitability of a hydraulic flame arrester shall be checked if the process conditions or pipe work configuration has been changed.

12.2.6.3.6 All parts of the hydraulic flame arrester shall be constructed to resist the expected mechanical, thermal, and chemical loads for the intended use.

12.2.6.3.7 All joints shall be constructed and sealed in such a way that flame cannot bypass the seal containment and also flame is prevented from propagating to the outside of the flame arrester.

12.2.6.3.8 Coatings of components that might be exposed to flames during operation shall not be damaged in such a way that flame transmission is possible.

12.2.6.3.9 Inspection. See 15.7.3.

12.2.6.3.10* Flame arresters shall be designed such that when mounted, the forces of the deflagration or detonation will be absorbed by the support structure.

12.2.6.3.11 The hydraulic flame arrester seal level shall be constantly monitored and automatically refilled.

12.2.6.3.12 The temperature of the seal medium shall have a safety margin of 40°C under the vaporization point and 10°C above the freezing point and be maintained by insulation, heating, or cooling as required.

12.2.6.3.13 Hydraulic flame arresters shall be mounted to absorb the forces exerted on the mounting arrangement caused by the deflagration entering the unit.

12.2.6.3.14 Hydraulic flame arresters shall be installed and maintained in accordance with the manufacturer's instructions.

12.2.6.3.15 Hydraulic flame arresters shall have inner design features that prevent sloshing effects and wave resonance in the seal.

12.2.6.3.16 The immersion depth at rest and the operational immersion depth shall not be less than the manufacturer's recommended safety margin.

12.2.6.3.17 The operational immersion depth shall be maintained by automatic control of the water supply to ensure the minimum operational immersion depth.

12.2.6.3.18 Design shall allow internal inspection of the vessel.

12.2.6.3.19 For corrosive media, the bubble-creating devices (e.g., sparge tube or bubble screen) shall be designed from corrosion-resistant material and shall allow for inspection.

12.2.6.3.20 The flow stream design shall ensure that a controlled volume flow passes through the hydraulic flame arrester, so that no zones can be generated in which flame and pressure fronts can pass the hydraulic flame arrester, in order to avoid bubble cascade ignition and compression wave ignition.

12.2.6.3.21 Fouling and clogging shall be avoided in the seal zone.

12.2.6.3.22 Hydraulic flame arrester design and support structures shall support a completely filled system.

12.2.6.3.23 Seal level detection and refilling shall be performed within 30 seconds.

12.2.6.3.24 Seal filling shall be fail-safe or redundant.

12.2.6.3.25* The seal volume and inner design shall be capable of withstanding three impacts of maximum intensity without refilling of the seal liquid.

12.2.6.4 System Verification.

12.2.6.4.1 Hydraulic-type flame arresters shall be tested in accordance with internationally recognized standards for the identified in-line application (e.g., ISO 16852), and an independent third-party approval shall be issued.

12.2.6.4.2 Evidence shall be available that the manufacturing process is controlled within tolerances to ensure reproducibility.

12.2.6.5 Hydraulic (Liquid Seal)–Type Deflagration Arrester Application Limits.

12.2.6.5.1 Hydraulic (liquid seal) arresters shall not apply outside the approved temperature range unless special testing is provided.

12.2.6.5.2 Hydraulic (liquid seal) arresters shall not apply outside the approved pressure range unless special testing is provided.

12.2.6.5.3 Use of hydraulic (liquid seal) arresters shall be limited to gas–air mixtures with an MESG equal to or greater than that tested.

12.2.6.5.4 Hydraulic (liquid seal) arresters shall not be applied with elevated oxygen concentration or other oxidants unless special testing is provided.

12.2.6.5.5 The location of the hydraulic flame arresters shall not exceed the ratio of pipe length (between the potential ignition source and the flame arrester) to pipe diameter, and shall not exceed the tested ratio of length to diameter unless tested for detonation.

12.2.6.5.6 Hydraulic flame arresters shall not be installed for volume flows above the maximum tested volume flow for which they are designed.

12.2.7* Liquid Product Flame Arrester. A liquid product flame arrester uses the product liquid to form a seal to prevent flame transmission of a deflagration.

12.2.7.1* Liquid-Type Flame Arrester Design. Liquid product flame arresters shall be divided, for purposes of this subsection, into the following groups:

- (1)* Liquid product flame arrester with siphon bypass for bidirectional transfer operation
- (2)* Liquid product flame arrester without siphon bypass for filling operations only
- (3)* Liquid product flame arrester with foot valve for emptying operations only

12.2.7.2 Liquid Product Flame Arrester System Design Considerations. Liquid product flame arrester system design considerations shall include the following:

- (1) Explosion characteristics of the combustible material, including MESG
- (2) Length, cross-sectional area, configuration, and strength of the piping on the unprotected side of the flame arrester (ignition source)
- (3) Arrester orientation
- (4) Process conditions during startup, normal operation, and shutdown
- (5) Maximum process volumetric flow

12.2.7.3 Liquid Product Flame Arrester Design Criteria. Liquid product flame arresters shall be designed according to the criteria in 12.2.7.3.1 through 12.2.7.3.10.

12.2.7.3.1 Liquid product flame arresters shall be placed in the potential flame path between the source of ignition and the system to be protected.

12.2.7.3.2 Liquid product flame arresters shall be installed and maintained in accordance with the manufacturer's instructions.

12.2.7.3.3 Suitability of a liquid product flame arrester shall be checked if the process conditions or piping configuration has been changed.

12.2.7.3.4 All parts of the liquid product flame arrester shall be constructed to resist the expected mechanical, thermal, and chemical loads for the intended use.

12.2.7.3.5 All joints shall be constructed and sealed in such a way that flame cannot bypass the seal containment and also flame is prevented from propagating to the outside of the liquid product flame arrester.

12.2.7.3.6 Coatings of components that might be exposed to flames during operation shall not be damaged in such a way that flame transmission is possible.

12.2.7.3.7 Inspection. See 15.7.4.

12.2.7.3.8 The temperature of the seal medium shall have a safety margin 40°C below the vaporization point and 10°C above the freezing point and be maintained by insulation, heating, or cooling, as required.

12.2.7.3.9 Liquid product flame arresters shall be mounted to absorb the forces exerted on the mounting arrangement.

12.2.7.3.10 Liquid product flame arresters shall be inspected after each incident in which they have been called on to function, to determine if the unit has been damaged by the deflagration.

12.2.7.4 System Verification.

12.2.7.4.1 Liquid product flame arresters shall be tested in accordance with internationally recognized standards for the identified in-line application and an independent third-party approval shall be issued.

12.2.7.4.2 Evidence shall be available that the manufacturing process is controlled within tolerances to ensure reproducibility.

12.2.7.5 Liquid Product Flame Arrester Application Limits.

12.2.7.5.1 These devices shall not be applied outside the approved temperature range unless special testing is provided.

12.2.7.5.2 These devices shall not be applied outside the approved pressure range unless special testing is provided.

12.2.7.5.3 Use of these devices shall be limited to gas-air mixtures with an MESG (vapor will result from liquid evaporation) equal to or greater than that tested.

12.2.7.5.4 These devices shall not be applied with elevated oxygen concentration or other oxidants unless special testing is provided.

12.2.7.5.5 These devices shall not be applied to self-decomposing mixtures, unless specifically tested.

12.2.7.5.6 These devices shall not be installed for volumetric flows above the maximum tested flow for which they are designed.

N 12.2.8* Dust Flame-Arresting Devices. A dust flame-arresting device shall be used only in air or filtered air applications of ductwork within the limits for which it has been certified.

N 12.2.8.1 Dust Flame-Arresting Device Design Considerations. Dust flame-arresting device design shall include the following considerations:

- (1) Deflagration characteristics of the combustible material
- (2) Volume, configuration, and operating characteristics of the equipment to be protected and the conveying system
- (3) Type of deflagration protection used on the enclosure
- (4) Dust loading in the air duct
- (5) Material physical properties (i.e. abrasiveness, adhesiveness, etc.)
- (6) Length, cross-sectional area, configuration, and strength of the piping
- (7) Turbulence-generating features in the piping such as fittings, elbows, and wall roughness
- (8) Velocity of the combustible dust/air mixture in the pipe
- (9) Location of potential ignition sources
- (10) Normal process flow velocity and direction at the device location
- (11) Orientation of the device
- (12) Maximum expected peak pressure at the device

N 12.2.8.2 Dust Flame-Arresting Device Design Criteria.

N 12.2.8.2.1 The normal process flow velocity at the device shall be less than the specified limit for the device in accordance with the device's testing.

N 12.2.8.2.2* Upon exposure to a deflagration, the system shall be instrumented to initiate an immediate, automatic shutdown of the protected process.

N 12.2.8.2.3 The ductwork upstream and downstream of the device shall be of sufficient strength to withstand the expected peak pressure.

N 12.2.8.2.4 Continuous monitoring of the pressure drop across the device shall be provided to evaluate the performance of the flame-arresting medium.

N 12.2.8.2.4.1 When a trouble signal indicating the pressure differential across the flame-arresting medium exceeds the tested value, the following shall occur:

- (1) An orderly shutdown of the protected process shall be initiated.
- (2) The medium shall be replaced or cleaned according to the manufacturer's instructions before the device is returned to service.

N 12.2.8.3 System Certification. The dust flame-arresting device design methodology and application range shall be supported by appropriate testing and certified by a recognized testing organization acceptable to the authority having jurisdiction (*See A.10.4.2.1*).

N 12.2.8.3.1 A performance demonstration shall determine the following:

- (1) Minimum and maximum location placement distances from the expected ignition source
- (2) Limiting values of K_{St} , P_{max} , MIE, and MIT (MESG) of the dust
- (3) Pressure resistance to both overpressure and vacuum conditions
- (4) Maximum allowable dust loading for the flame-arresting medium
- (5) Maximum allowable pressure differential across the flame-arresting medium
- (6) Maximum P_{rel} at the device
- (7) Maximum ductwork dimensions for effective flame arresting
- (8)* Dust material type

N 12.2.8.3.2 Upon request, the system manufacturer shall provide the owner or operator with documentation that supports the design being in compliance with the manufacturer's independent third-party approval, including application limitations, and suitable for the hazard to be protected.

N 12.2.8.3.2.1 Evidence that the manufacturing process is controlled within tolerances to ensure reproducibility shall be available.

N 12.2.8.4 Dust Flame-Arresting Device Application Limits. The device shall not be permitted to be used under the following circumstances:

- (1) As a means of pressure relief for an enclosure
- (2) In a stream containing flammable gases/vapors
- (3) In a stream containing chemically unstable material
- (4) Under conditions that are outside of the tested application limits

N 12.2.8.5 Inspection. See 15.7.5 for inspection requirements.

Chapter 13 Deflagration Control by Pressure Containment

13.1 Application.

13.1.1 The technique for deflagration pressure containment shall be permitted to be considered for specifying the design pressure of a vessel and its appurtenances so they are capable of withstanding the maximum pressures resulting from an internal deflagration.

13.1.2 This chapter shall provide the basis for determining the vessel design pressure required to withstand the pressures resulting from an internal deflagration.

13.1.3 This chapter shall be limited to systems in which the oxidant is air.

13.1.4 The design pressure specified by this chapter shall be based on the most severe set of system conditions that can occur.

13.1.5* Deflagration pressure containment shall be applied to a vessel with attached equipment to protect such equipment from imposed pressure loads that could equal or be greater than the pressure loads experienced by the protected vessel.

13.2 Design Limitations.

13.2.1* Deflagration pressure containment techniques shall not be applied to systems for the purpose of containing a detonation.

13.2.2* Deflagration pressure containment shall not be applied to systems where two or more vessels are connected by large-diameter pipes or ducts, unless one of the following conditions is met:

- (1) Deflagration pressure containment shall be permitted to be used where interconnected piping is provided with deflagration isolation.
- (2) Deflagration pressure containment shall be permitted to be used where venting is provided for interconnected piping.
- (3) Deflagration pressure containment shall be permitted to be used where interconnected vessels are designed to contain the increased pressures due to the effects of prepressurization. (See Annex G.)
- (4) Deflagration isolation or venting of one vessel shall be permitted to be used.
- (5)* Deflagration pressure containment shall be permitted to be used for initial gauge pressures exceeding 2 bar (30 psi) only when the maximum deflagration pressure ratio (R) is determined by test or calculations.

13.3 Design Bases.

13.3.1 Enclosures protected by design for deflagration pressure containment shall be designed and constructed according to the ASME *Boiler and Pressure Vessel Code*, or similar codes, where the maximum allowable working pressure, herein designated as P_{mawp} , shall be determined by calculation.

13.3.1.1 Such determinations shall include an allowable stress for the enclosure material of construction, which is less than the measured yield stress and the measured ultimate stress for the material of construction.

13.3.1.2 The design pressure shall be based on the wall thickness of the enclosure, subtracting any allowance for corrosion or erosion. For existing enclosures, the design pressure shall be

based on the actual measured minimum wall thickness, subtracting a corrosion allowance.

13.3.1.3 The enclosure design shall take into consideration the minimum operating temperature at which a deflagration could occur, which shall be compared with the temperature characteristics of the vessel's construction material to ensure that brittle fracture cannot result from a deflagration.

13.3.1.4 The user shall determine whether permanent deformation of the protected enclosure, as a result of a potential deflagration, can be accepted.

13.3.2 The design pressure of the enclosure, as calculated in 13.3.4, shall be based either on preventing rupture of the enclosure (the ultimate strength of the enclosure), but allowing permanent deformation (also called explosion-proof shock-resistant), or on preventing permanent deformation (the yield strength of the enclosure, also called explosion-pressure shock-resistant) from internal positive overpressure.

13.3.3 Due to the vacuum that could follow a deflagration, all enclosures whose deflagration pressure containment design is based on preventing deformation shall also be designed to withstand an absolute internal pressure of 68.95 kPa (10 psi) or they shall be provided with vacuum relief.

13.3.4* Given an initial pressure and dimensionless pressure ratio for the potential deflagration, P_{mawp} shall be selected based on the following conditions as defined by Equation 13.3.4a or Equation 13.3.4b:

- (1) Permanent deformation, but not rupture, of the enclosure can be accepted.

[13.3.4a]

$$P_{mawp} \geq \frac{[R(P_i + 14.7) - 14.7]}{\left[\left(\frac{2}{3}\right)F_u\right]}$$

- (2) Permanent deformation of the enclosure cannot be accepted.

[13.3.4b]

$$P_{mawp} \geq \frac{[R(P_i + 14.7) - 14.7]}{\left[\left(\frac{2}{3}\right)F_y\right]}$$

where:

P_{mawp} = enclosure design pressure (psig) according to ASME *Boiler and Pressure Vessel Code*

R = dimensionless pressure ratio

P_i = maximum initial pressure at which combustible atmosphere exists (psig)

F_u = ratio of ultimate stress of the enclosure to the allowable stress of the enclosure according to ASME *Boiler and Pressure Vessel Code*

F_y = ratio of the yield stress of the enclosure to the allowable stress of the materials of construction of the enclosure according to ASME *Boiler and Pressure Vessel Code*

13.3.4.1* The dimensionless ratio, R , is the ratio of the maximum deflagration pressure, in absolute pressure units, to the initial pressure at which the deflagration pressure was tested, in consistent absolute pressure units.

13.3.4.2 For use as a practical design basis (since optimum conditions seldom exist in industrial equipment), the value of R shall be as follows:

- (1) For most gas and air mixtures, the value of R shall be 9.
- (2) For St-1 and St-2 dust-air mixtures, the value of R shall be 11.
- (3) For St-3 dust-air mixtures, the value of R shall be 13.

13.3.4.3 A value for R other than the values specified in 13.3.4.2 shall be permitted to be used if such value can be substantiated by test data or calculations.

13.3.4.4 For operating temperatures below 25°C (77°F), the value of $\dot{R}$ shall be calculated for use in Equation 13.3.4a and Equation 13.3.4b:

[13.3.4.4]

$$\dot{R} = R \left(\frac{298}{273 + T_i} \right)$$

where:

$\dot{R}$ = deflagration ratio adjusted for operating temperature

R = maximum deflagration ratio for the mixture measured at 25°C (77°F)

T_i = operating temperature (°C)

13.3.5 The presence of any pressure relief device on the system shall not cause the design pressure calculated by the methods of 13.3.4 to be reduced.

13.3.6* The maximum initial pressure for positive pressure systems shall be as follows:

- (1) For positive pressure systems that handle gases and liquids, the maximum initial pressure, P_i , shall be the maximum initial pressure at which a combustible atmosphere is able to exist, but a pressure not higher than the setting of the pressure relief device plus its accumulation.
- (2) For positive pressure systems that handle dusts, the maximum initial pressure shall be the greater of the following two pressure values:
 - (a) Maximum possible discharge pressure of the compressor or blower that is suspending or transporting the material
 - (b) Setting of the pressure relief device on the vessel being protected plus its accumulation
- (3) For gravity discharge of dusts, the maximum initial pressure shall be the atmospheric pressure (0.0 bar-gauge or 0.0 psig).

13.3.7 For systems operating under vacuum, the maximum initial pressure shall not be less than atmospheric pressure (0.0 bar-gauge or 0.0 psig).

13.3.8 Auxiliary equipment such as vent systems, manways, fittings, and other openings into the enclosure, which could also experience deflagration pressures, shall be designed to ensure integrity of the total system and shall be inspected periodically.

▲ 13.4 Maintenance.

N 13.4.1 Any enclosure designed according to the methods of this chapter shall be inspected and maintained in accordance with local jurisdictional practices for registered pressure vessels.

N 13.4.2 In particular, relief devices shall be inspected periodically to ensure that they are not plugged, frozen, or corroded.

N 13.4.3 Inspection. See 15.7.6 for inspection requirements.

Chapter 14 Passive Explosion Suppression Using Expanded Metal Mesh or Polymer Foams

14.1* Applications.

14.1.1 The use of expanded metal mesh or reticulated polymer foams manufactured, tested, and installed in accordance with the requirements of this chapter shall be permitted for explosion suppression in unoccupied enclosures containing flammable gas or vapor.

14.1.2 These enclosures shall include, but not be limited to, fuel tanks, flammable liquid storage tanks, portable containers, and flammable liquid cargo tanks.

14.2 Foam and Mesh Requirements.

14.2.1 Expanded metal mesh shall meet the requirements in 14.2.4.

14.2.2 Polymer foams shall meet the requirements in 14.2.5.

14.2.3 Both types of suppression materials described in this chapter shall satisfy the explosion suppression test requirements in Section 14.3.

14.2.4 Expanded Metal Mesh Requirements.

14.2.4.1* Expanded aluminum or other metal mesh shall have a density of 24 to 51 kg/m³ (1.5 to 3.2 lb/ft³) as determined by the average of three samples from the same manufacturing run as the samples used for the other tests in Sections 14.2 and 14.3.

14.2.4.2 The expanded metal mesh shall have sufficient surface area to absorb the heat generated in an incipient deflagration of a flammable gas-air mixture as demonstrated by the tests described in Section 14.3.

14.2.4.2.1 The expanded metal mesh surface area per unit volume shall be measured or calculated for three samples.

14.2.4.2.2 The measurements and associated calculations shall be documented and made available to the authority having jurisdiction.

14.2.4.2.3* Expanded metal mesh intended for the protection of alkane-air mixtures and other flammable vapors with fundamental burning velocities within 15 percent of the fundamental burning velocity of a near-stoichiometric propane-air mixture shall have a surface area-to-volume ratio of at least 0.25 mm⁻¹ (0.1 in.⁻¹).

14.2.4.2.4 Expanded metal mesh intended for the protection of flammable gases or vapors with faster burning velocities shall have a minimum area-to-volume ratio determined from explosion suppression tests described in Section 14.3 with that particular flammable gas or vapor.

14.2.4.3* Pore Size.

14.2.4.3.1 Expanded metal mesh shall have a pore (cell) size that is smaller than the quenching distance for the flammable gas or vapor expected in the protected enclosure.

14.2.4.3.2 In the case of alkanes or flammable gases and vapors with fundamental burning velocities within 15 percent of the near-stoichiometric propane-air burning velocity, the maximum pore size shall be 2 mm (0.079 in.).

14.2.4.4* The metal alloy composition and the composition and thickness of any coating shall be reported in accordance with the most applicable ASTM, military, or industry standard.

14.2.5* Polymer Foam Requirements. Polyurethane or other polymer foam shall have a density of 19 to 32 kg/m³ (1.2 to 2.0 lb/ft³) as determined by the density test described in ASTM D3574, *Standard Test Methods for Flexible Cellular Materials — Slab, Bonded, and Molded Urethane Foams*.

14.2.5.1* The polymer foam number of pores per inch, as determined from the air flow test shown in Figure 1 in MIL-DTL-83054C, *Baffle and Inerting Material, Aircraft Fuel Tank*, and in MIL-PRF-87260B, *Foam Material, Explosion Suppression, Inherently Electrostatically Conductive, for Aircraft Fuel Tanks*, and the corresponding air flow versus pore size correlation in Figure 2 and paragraph 4.6.4 of MIL-DTL-83054C or in MIL-PRF-87260B for conductive polymer foam, shall be a minimum of 6 pores/cm (15 pores/in.) for foams with a density of 19 to 24 kg/m³ (1.2 to 1.5 lb/ft³), and at least 4 pores/cm (10 pores/in.) for foams with a density of 26 to 32 kg/m³ (1.6 to 2.0 lb/ft³).

14.2.5.2 For applications with liquids or gases with fundamental burning velocities greater than 0.5 m/sec (1.6 ft/sec) the minimum number of pores per inch shall be determined by test as described in 14.3.2.

14.2.5.3 The polymer foam shall have a maximum of 30 percent deflection when tested in accordance with the constant deflection compression test described in paragraph 4.6.7 of MIL-DTL-83054C and method B of ASTM D3574.

14.2.5.4 Tensile Strength Specifications.

14.2.5.4.1 The polymer foam shall have a minimum tensile strength of 103 kPa (15 psi) when tested in accordance with ASTM D3574 and paragraph 4.6.5 of MIL-DTL-83054C.

14.2.5.4.2 In addition, the foam shall not experience a loss of tensile strength greater than 50 percent when tested at the maximum expected application temperature.

14.2.5.5 Electrical Resistivity.

▲ **14.2.5.5.1** The polymer electrical resistivity shall be measured at 24°C (75°F) or other temperature representative of the protected process using the procedure described in ASTM D257, *Standard Test Methods for DC Resistance or Conductance of Insulating Materials*, and in MIL-PRF-87260B (USAF), *Foam Material, Explosion Suppression, Inherently Electrostatically Conductive, for Aircraft Fuel Tanks*.

14.2.5.5.2* The polymer resistivity shall be less than 1×10^{11} ohm-cm at 24°C (75°F) or other temperature representative of the protected process and at 55 percent ± 5 percent relative humidity.

14.2.5.6 The polymer ignitibility and fire heat release rate shall be measured using an oxygen consumption calorimeter per ASTM E1354, *Standard Test Method for Heat and Visible Smoke Release Rates for Materials and Products Using an Oxygen Consumption Calorimeter*, at an imposed radiant heat flux of 75 kW/m².

14.2.5.6.1 The polymer time-to-piloted-ignition at this heat flux shall be longer than 5 seconds.

14.2.5.6.2 The heat release rate per unit area shall be documented and made available to the authority having jurisdiction upon request.

14.2.5.7 The polymer foam shall demonstrate the resistance as shown in 14.2.5.7.1 and 14.2.5.7.2 to deterioration after being submerged in the container liquid for a period of 4 weeks.

14.2.5.7.1 After drying the foam, the tensile strength test referenced in 14.2.5.4.1 shall be repeated with no more than a 40 percent reduction in measured strength.

14.2.5.7.2 The electrical resistivity test shall also be repeated, and the measured resistivity shall be less than 1×10^{11} ohm-cm at 24°C (75°F) or other temperature representative of the protected process and at 55 percent ± 5 percent relative humidity.

14.2.6 The foam shall be sufficiently flexible to be inserted into and fill up the protected enclosure, using blocks of foam no smaller than 1 ft (0.3 m) in length or the smallest dimension of the enclosure, whichever is smallest.

14.2.7 The minimum foam block width and height shall be determined from the double void explosion suppression tests described in 14.3.6 and 14.3.7 and the installation requirements in Section 14.4.

14.2.8 Foam packages and shipping documents shall contain the foam make and type, the foam density, the area-to-volume ratio, and the pore size.

14.3 Expanded Metal Mesh and Polymer Foam Explosion Suppression Testing.

14.3.1 Expanded metal mesh and polymer foams shall be subjected to explosion suppression performance testing as described in 14.3.2 through 14.3.5.2.

14.3.2 Test results shall be as specified in 14.3.6 and 14.3.7.

14.3.3* Explosion suppression tests shall be conducted with dry mesh or foam firmly inserted in closed test vessels of at least 140 L (5 ft³) volume, and with a cross-sectional area of at least 64,500 mm² (100 in.²).

14.3.3.1 The first test shall be conducted with the vessel 80 percent filled with mesh or foam of documented area-to-volume ratio or pore size and percent liquid displacement, and the remaining 20 percent of the volume empty except for the gas-air mixture described in 14.3.4.

14.3.3.2 The second test shall be conducted with the vessel 90 percent filled with mesh or foam, with a 10 percent void volume.

14.3.4 The tests shall be conducted with a flammable gas-air mixture with a fundamental burning velocity representative of the burning velocities of flammable vapors expected in the intended applications.

14.3.4.1 Propane at a concentration in the range 4.4 to 4.8 volume percent shall be used for applications in which the flammable gas has a fundamental burning velocity in the range 350 to 500 mm/sec (1.15 to 1.64 ft/sec).

14.3.4.2 Suppression tests for applications involving other flammable gases or vapors shall be conducted with a representative gas-air mixture at a concentration in the range 1.1 to 1.2 times the stoichiometric concentration.

14.3.4.3 After the gas mixture has been established uniformly throughout the test vessel, the gas concentration shall be verified by a calibrated gas analyzer or by sampling and subsequent chemical analysis.

14.3.4.4 The pressure in the test vessel prior to ignition shall be representative of the normal operating pressure of the intended application.

14.3.5 The flammable gas-air mixture shall be ignited with an ignition source of at least 10 joule energy triggered in the void volume, and the resulting reduced explosion pressure, P_{red} , shall be measured and reported.

14.3.5.1 After conducting the second test (with the 10 percent void volume), all the mesh or foam shall be removed and the explosion test repeated with the same gas mixture in the gas-filled closed vessel, or in another test vessel of similar volume.

14.3.5.2 The value of P_{max} measured without the mesh or foam shall be measured and reported.

14.3.6 Single Void Explosion Suppression Tests.

14.3.6.1 A particular composition and porosity of expanded metal mesh or polymer foam shall be permitted for explosion suppression applications if the value of P_{red} measured in the 10 percent void volume test at initially atmospheric pressure is no greater than 34 kPa (5 psi), and if the pressure measured in the test with the 20 percent void volume is no greater than 83 kPa (12 psi).

14.3.6.2 If the tests and intended application has a pre-ignition pressure, P_0 , of some other value, the maximum allowable values of P_{red} shall be determined from the values of $(P_{red} - P_0)/(P_{max} - P_0)$ per Table 14.3.6.2.

14.3.7* Double Void Explosion Suppression Tests.

14.3.7.1 Double void explosion suppression tests shall be conducted with the same vessel, gas mixture, and ignition source as described in 14.3.3 through 14.3.6, but now with two voids separated by varying thicknesses of dry expanded metal mesh or polymer foam.

14.3.7.2 Starting with 5 cm (2 in.), the thickness of mesh or foam shall be increased in 2.5 cm (1 in.) increments until the tests demonstrate that the flame does not propagate across the mesh or foam from the ignition void to the second void, as

determined from measured temperature increase or visual records, as well as pressure rise.

14.3.8 The minimum thickness of mesh or foam required to achieve suppression in the double void tests shall be no greater than 127 mm (5 in.).

14.4 Expanded Metal Mesh or Polymer Foam Installations.

14.4.1* Explosion suppression mesh or foams shall be installed only in enclosures with ultimate strengths or yield strengths, as determined by the owner or operator, equal to at least 1.5 times the value of P_{red} determined from the 20 percent single void volume explosion suppression tests described in 14.3.3 through 14.3.6.

14.4.2* The mesh or foam shall fill at least 90 percent of the entire enclosure volume as verified by visual inspection during and following the installation.

14.4.2.1 The minimum thickness of any one block of mesh or foam used in the installation shall be the value determined in the double void volume tests described in 14.3.7.

14.4.2.2 Documentation of the installed fill fraction and minimum thicknesses of mesh or foam, as well as the explosion suppression test results, shall be made available to the authority having jurisdiction upon request.

14.5 Expanded Metal Mesh or Polymer Foam Maintenance and Replacement.

14.5.1 Inspection. See 15.7.7.

Chapter 15 Installation, Inspection, and Maintenance of Explosion Prevention Systems

15.1 General.

15.1.1 This chapter covers the installation, inspection, and maintenance procedures necessary for proper function and operation of explosion prevention and control systems.

15.1.2 Sections 15.7 through 15.11 shall be applied retroactively.

15.1.3 Design considerations shall follow the requirements listed in the applicable chapter of NFPA 69.

15.2 Installation.

15.2.1 Design and Submittal Documentation.

15.2.1.1 A design record file including data sheets, installation details, and design calculations shall be assembled following the requirements of this document's technique chapters and maintained for each application, suitable for use in validating the system design including, as applicable, the following criteria:

- (1) Manufacturer's data sheets and instruction manuals
- (2) Design calculations including final reduced (P_{red}) pressures
- (3) General specifications
- (4) Explosion prevention system equipment list
- (5) Sequence of operation for each system
- (6) End user inspection and maintenance forms
- (7) User documentation of conformity with applicable standards and the appropriate chapter of this standard
- (8) Combustible material properties and source of data

Table 14.3.6.2 Allowable Results of Single Void Explosion Suppression Tests

Void Volume Fraction	Maximum Value of $(P_{red} - P_0)/(P_{max} - P_0)$
0.10	0.043
0.20	0.10

- (9) Process hazard review
- (10) Process plan view including protected process, placement location of all explosion prevention devices, and personnel work locations
- (11) Process elevation view
- (12) Electrical wiring diagram, including process interlock connection details
- (13) Mechanical installation drawings and details
- (14) Electrical installation drawings and details
- (15) Process interlocks identifying each equipment interlock and function (P&ID)
- (16) Employee training requirements

15.2.1.2 All design and installation parameters shall be field verified prior to installation of explosion prevention systems.

15.2.2 As-built drawings, system user instruction manuals, and service maintenance requirements shall be presented to the owner or operator at project completion.

15.3 Mechanical Installation.

15.3.1 Mounting locations shall follow the manufacturer's requirements, since explosion prevention systems are location-sensitive.

15.3.1.1 Location changes shall be made only with the approval of the explosion prevention system manufacturer.

15.3.1.2 Mounting locations shall be chosen so as not to exceed maximum operating temperatures of system components.

15.3.1.3 Mounting locations shall include safe access for installation, service, inspection, and maintenance, up to and including work platforms as required by local workplace safety regulations.

15.3.2 Detectors shall be mounted according to manufacturer instructions to protect them from shock, vibration, accumulation of foreign material, and clogging or obscuration of the sensing area.

15.3.3 Discharge nozzles shall be located and oriented so that they will not be obstructed by structural elements in the discharge pattern or by solid particle accumulation.

15.3.4 Mechanical installation and system components shall be made from material that will be protected from corrosion and other contaminants.

15.3.5 Detectors shall be mounted such that a means for inspecting and removing obstructions to the sensing pathway is provided.

15.3.6 Detector mounting shall incorporate means to minimize unwanted system actuation due to vibration or shock, where applicable.

15.4 Agent, Agent Storage Containers, Automatic Fast-Acting Valves, Flame Arresters, and Flame Front Diverters.

15.4.1* The adapting mounting hardware and the mounting surfaces for all protection system components shall be able to withstand the static and dynamic load, including the thrust or impulse pressure requirements of the original equipment manufacturer and temperature requirements of the application.

15.4.2 Agent storage containers installed externally to the protected process shall be mounted such that a means for

inspecting the agent discharge pathway for obstructions is provided.

15.4.3 Agent storage containers shall be mounted so that the process or environmental temperature attained at the location of electrically fired actuators shall not exceed the maximum temperature for which they are rated.

15.5 Electrical Installation.

15.5.1 All electrical equipment and installations shall comply with the requirements of *NFPA 70*.

15.5.2 Terminals and connections shall be protected from moisture and other contaminants.

15.5.3 Hazardous (classified) areas that are identified in accordance with 15.5.1 shall be documented, and such documentation shall be permanently maintained on file for the life of the facility.

15.5.4 Wiring for input and output control circuits shall be isolated and shielded and protected from other wiring to prevent possible induced currents.

15.5.5 Instrumentation included as part of an explosion prevention or protection system shall meet the requirements of 15.5.5.1 through 15.5.5.4.

Δ 15.5.5.1* Safety Instrumented Systems (SIS). Explosion prevention system controls shall be implemented as SIS per 15.5.5.1 where required as part of a documented risk assessment.

N 15.5.5.1.1* SIS for explosion prevention service shall be designed to achieve safety integrity level 2 (SIL-2) or greater in accordance with ANSI/ISA 61511, *Functional Safety: Safety Instrumented Systems for the Process Industry Sector*, or equivalent, unless a documented risk evaluation acceptable to the authority having jurisdiction has determined that a different level of protection is acceptable or required.

N 15.5.5.1.2* A safety requirements specification document, in accordance with ANSI/ISA 61511, *Functional Safety: Safety Instrumented Systems for the Process Industry Sector*, or equivalent, shall be developed and retained for the life of the installation.

N 15.5.5.1.3 Installation and maintenance of SIS for explosion prevention service shall be as follows:

- (1)* Where SIS are listed for explosion prevention service, the system shall be installed and maintained in accordance with listing requirements and manufacturer's instructions.
- (2) Where SIS are not listed for explosion prevention service, the system consisting of a safety logic solver, sensors, and final elements used to perform safety functions shall be installed and maintained in accordance with the safety requirements specification document.

15.5.5.1.3.1 Software Security. Access to the system logic shall be restricted to authorized personnel.

15.5.5.1.3.2 Software Documentation. Software documentation shall provide the following:

- (1) Identify elements or a group of elements containing safety software
- (2) Describe the function of each element containing safety software

- (3) Be sufficient for users to perform periodic functional testing

15.5.5.1.4 Non-SIL-rated instrumentation shall be permitted to be used for implementation of Chapter 7 and Chapter 8, except when the safety requirements specification does not allow or when applying 8.3.1(1) or 7.7.2.5.

15.5.5.1.5 Minimum functional testing requirements shall be consistent with maintaining the reliability in accordance with this chapter and with safety requirements specification documentation.

15.5.5.1.6 When supported by a documented hazard analysis, the functional testing requirements shall be permitted to be reduced for routine inspections and documented in the safety requirements specification document.

15.5.5.2* Class A or Class B circuits as described in *NFPA 72* shall be employed when the following components are connected to the control panel:

- (1) Concentration measurement devices, explosion detection devices, and other initiating devices
- (2) Concentration controlling valves
- (3) Releasing devices, solenoids, or actuators
- (4) Supervisory devices that monitor critical elements or functions such as low pressure switches
- (5) Notification appliances
- (6) Signaling line circuits

15.5.5.3 A signaling line circuit used as part of an explosion protection or suppression system shall not be shared by other operating systems.

15.5.5.4 A signaling line circuit shall not be used by more than one explosion prevention system unless certified by the original manufacturer.

15.5.6 Wiring.

15.5.6.1 Wiring for explosion prevention systems shall be isolated from other facility wiring.

15.5.6.2 Wiring for multiple explosion prevention systems shall be isolated from each other, unless shielded or shielded and operating as an intrinsically safe circuit.

15.5.7 Sealed fittings shall be installed at all sensor and suppressor/valve actuator connection boxes to provide protection from moisture and contaminants.

15.5.8 Connections and boxes shall meet the National Electrical Manufacturer's Association (NEMA) rating appropriate to the operating environment.

15.5.9 A reliable source of electrical energy shall be used that meets the requirements of the manufacturer.

15.6 System Acceptance.

15.6.1 Prior to use, factory authorized personnel shall check out the explosion prevention system, including the following steps, as applicable:

- (1) Conduct a walkthrough and general visual inspection of location, size, type, and mounting of all system components.
- (2) Physically inspect system components, including mechanical and electrical component integrity.
- (3) Conduct control unit functional testing.

- (4) Make point-to-point wiring checks of all circuits.
- (5) Verify the continuity and condition of all field wiring.
- (6) Inspect sensing pathway and calibrate initiating devices.
- (7) Verify that installation of system components, including sensing devices, fast-acting valves, suppressant storage containers, nozzles, spreader hoses, protective blowoff caps, plugs, and stoppers, is in accordance with the manufacturer's specifications.
- (8) Verify system sequence of operations by simulated activation to verify system inputs and outputs.
- (9) Conduct automatic fast-acting valve stroke test.
- (10) Conduct prevalidation testing, verify system interlocks, and shutdown circuits.
- (11) Identify and fix discrepancies before arming and handing off to user or operator.
- (12) Recalibrate detection sensing devices to final set points.
- (13) Complete record of system acceptance, including hardware serial numbers, detector pressure calibrations, and suppressor and valve actuator charging pressures, as appropriate.
- (14) Conduct end user training as required in Section 15.10.
- (15) Conduct final validation testing for authority having jurisdiction.
- (16) Arm the explosion prevention system.

15.7 Inspection and Testing.

Δ 15.7.1 General.

N 15.7.1.1 Systems with active components shall be initially inspected and tested at 3-month intervals.

N 15.7.1.2* Passive devices shall be initially inspected at 3-month intervals and tested in accordance with manufacturers' requirements.

15.7.1.3 Systems designed by the owner or operator shall be inspected by personnel authorized by the owner or operator.

15.7.1.4 Systems designed by the manufacturer shall be inspected by personnel trained and authorized by the system manufacturer.

15.7.1.5* The frequency of inspection described in 15.7.1 shall be permitted to be increased or decreased based on documented operating experience or a documented hazard analysis, and only with approval of both the explosion prevention system designer and the AHJ.

15.7.1.6 Maximum inspection and test interval shall not exceed 2 years.

N 15.7.1.7 Other explosion prevention systems not otherwise specified in Section 15.7 shall be inspected according to the requirements of the manufacturer or according to the requirements of the owner/operator who designed the system.

15.7.1.8 Disarming and OSHA lockout/tagout procedures (29 CFR 1910.147) and confined space entry procedures (29 CFR 1910.146), or local country equivalent, shall be followed prior to entering or performing maintenance operations on the protected equipment or performing maintenance on the explosion prevention system.

15.7.1.8.1* Inspection and maintenance procedures shall comply with the manufacturer's instructions.

15.7.1.8.2 Operation of the protected equipment shall be interlocked through the explosion prevention systems control panel so that operation cannot be resumed until OSHA lock-out/tagout procedures are reversed and the explosion prevention system is rearmed.

15.7.1.9* An inspection of explosion prevention systems shall be conducted in accordance with the system designer's requirements and project specifications and shall include the following conditions, where applicable:

- (1) The process and processed material have not changed since the last inspection.
- (2) The explosion prevention system has been installed in accordance with this standard and the manufacturer's instructions.
- (3) System components, including mounting arrangements, are not corroded or mechanically damaged.
- (4) User operation instructions are provided near the control unit.
- (5) System components are clearly identified as an explosion prevention device.
- (6) System components have no damage from the process, acts of nature, or debris.
- (7) System components have not been painted or coated without prior approval from the original equipment manufacturer.
- (8) System components are not blocked by process material.
- (9) System components have not been tampered with.
- (10) The system has not discharged or released.
- (11) System seals, tamper indicators, or discharge indicators, if provided, are in place and functioning.
- (12) The control unit functions according to design requirements, circuits are supervising the system, and status is "normal condition" when armed.
- (13) The system wiring is free from ground conditions and faults.
- (14) System suppressors and valve actuators are pressurized and operational.
- (15) System interlocks are verified for sequence and functioning in accordance with the relevant specifications.
- (16) Mechanical isolation (such as rotary valves), if used, is maintained within the requirements of this standard and design tolerances.
- (17) Plant fire notification is verified.
- (18) System sequence of operation is verified by simulated activation.
- (19) System component serial numbers are verified as the same as those recorded during the last inspection.
- (20) System component service life and manufacturer's replacement requirements are met.

15.7.1.10 A container having a pressure (corrected for temperature) that is less than the minimum value specified by the manufacturer shall be reconditioned or replaced.

15.7.1.11 Suppressant agent pressurized cylinders shall be verified to be compliant with DOT and/or ASME requirements.

15.7.1.12 The owner or operator shall verify by signature on the inspection form that the production process material has not changed from that identified in the design record file.

15.7.1.13 The explosion prevention system design record file shall be maintained and made available for management of

change review, employee training information, and inspection purposes.

15.7.1.14 Deficiencies found during inspections shall be reported to the owner or operator along with recommended remedial actions.

N 15.7.2 Static Dry Flame Arrester Systems. Arrester systems shall be designed to allow inspection for product buildup on a frequency established by facility experience.

N 15.7.2.1 Initially, until experience has determined otherwise, the unit shall be inspected based on manufacturer's recommendations.

N 15.7.2.2 Design shall allow internal inspection of flame filter elements.

N 15.7.2.3 If exposed to corrosive media, filter elements shall be designed so that they can be removed for inspection.

N 15.7.3 Hydraulic (Liquid Seal) Flame Arresters.

N 15.7.3.1 Arrester systems shall be designed to allow inspection for product buildup on a frequency established by facility experience.

N 15.7.3.2 Initially, until experience has determined otherwise, the unit shall be inspected based upon manufacturer's recommendations.

N 15.7.3.3 Arrester filter elements shall be replaced if any damage is detected or if a continuous burning flame was present on the arrester elements.

N 15.7.3.4 Hydraulic flame arresters shall be inspected after each incident in which they have been called upon to function, to determine if the unit has been damaged by the deflagration or detonation.

N 15.7.4 Liquid Product Flame Arresters.

N 15.7.4.1 Arrester systems shall be designed to allow inspection for product buildup on a frequency established by facility experience.

N 15.7.4.2 Initially, until experience has determined otherwise, the unit shall be inspected based on manufacturer's recommendations.

N 15.7.4.3 Design shall allow internal inspection of seal containment.

N 15.7.4.4 If a siphon bypass device is included, design shall allow internal inspection of the flame arrester element of the siphon bypass device.

N 15.7.4.5 If filter elements are included and these are exposed to corrosive media, filter elements shall be designed such that they can be removed for inspection.

N 15.7.5 Dust Flame-Arresting Devices.

N 15.7.5.1 The dust flame-arresting device shall have a means to allow periodic inspection of the flame-arresting medium.

N 15.7.5.2 The means of inspection shall have a pressure rating at least as great as the dust flame-arresting device.

N 15.7.5.3 Initially, until experience has determined otherwise, the unit shall be inspected based on manufacturer's recommendations.

N 15.7.6 Deflagration Control by Pressure Containment.

N 15.7.6.1 Inspection and maintenance shall be in accordance with API 510, *Pressure Vessel Inspection Code: In-Service Inspection, Rating, Repair, and Alteration*.

N 15.7.6.2 Repairs and modifications to the enclosure shall be made consistent with the original design code.

N 15.7.6.3 Threaded Fasteners. Threaded fasteners on enclosure appurtenances shall be inspected to ensure that design pressure ratings are maintained.

N 15.7.6.4 Inspection After a Deflagration. Any enclosure designed to contain a deflagration that experiences a deflagration shall be inspected to verify that the vessel is still serviceable for its intended use.

N 15.7.7 Passive Explosion Suppression Using Expanded Metal Mesh or Polymer Foams.

N 15.7.7.1 Mesh or foam passive element containment installations shall be inspected for any evidence of deterioration.

N 15.7.7.2 When there is visual evidence of deterioration, the passive element mesh or foam shall be replaced, in accordance with the installation requirements in Section 14.4.

N 15.7.7.3 Mesh or foam installations shall be inspected following any deflagration, explosion, or fire exposure.

N 15.7.7.4 Disposal of used, liquid-contaminated mesh or foam shall be in accordance with local environmental regulations.

15.8 Procedures Following System Actuation.

15.8.1* In the event of explosion prevention system actuation, inspection and testing, as specified in Section 15.7, shall be performed before the system is placed back into service.

15.8.2* An investigation and review of the cause of the explosion prevention system actuation shall be made.

15.9 Recordkeeping.

15.9.1 A record shall be maintained that indicates the date and the results of each inspection and the date and description of each maintenance activity.

15.9.2 System inspection reports shall be kept or accessible at the site for at least 3 years. The report shall include test and calibration data on all system components.

15.9.3 The records of inspections shall be retained by the owner or operator for the life of the protected process.

15.9.4 A copy of the records of inspection shall be made available to the explosion prevention system manufacturer, if requested.

15.10 Personnel Safety and Training

15.10.1 Operating and maintenance procedures and emergency plans shall be developed. The plans and procedures shall be revalidated annually and as required by management of change procedures.

15.10.2 Initial and, at a minimum, annual refresher training shall be provided to personnel who operate, maintain, supervise, or are exposed to equipment and processes protected by explosion prevention systems. Training shall include the following issues:

- (1) Hazards of the workplace
- (2) General orientation, including plant safety rules
- (3) Process description
- (4) Equipment operation, safe startup, shutdown, and response to upset conditions
- (5) The necessity for fire and explosion protection systems
- (6) Maintenance requirements and practices
- (7) Explosion prevention system arming and disarming procedures
- (8) Process lockout/tagout procedures
- (9) Housekeeping requirements
- (10) Emergency response and egress plans
- (11) Management of change procedures
- (12) System impairment reporting procedures

15.10.3 Disarming and lockout/tagout procedures shall be followed prior to entering equipment protected by explosion prevention systems.

15.10.3.1 The explosion prevention system shall be disarmed and the process shall be shut down prior to performing maintenance operations on the protected equipment or the explosion prevention system.

15.10.3.2 Operation of the protected equipment shall be interlocked through the explosion prevention system controls so that operation cannot be resumed until the prevention system is armed.

15.11 Management of Change.

15.11.1 Management shall implement and maintain written procedures to evaluate proposed changes to facility and processes, both physical and human, for the impact on safety, explosion prevention, and control.

15.11.2 Management of change procedures shall be followed for any change to process, materials, technology, equipment, process flow, exposure, or procedures affecting equipment protected by requirements in this document.

15.11.3* Management of change documentation shall be available for review by the relevant authority having jurisdiction and the manufacturer or designer of explosion prevention equipment.

15.11.4 The management of change procedures shall ensure that the following issues have been addressed prior to any change:

- (1) The technical basis for the proposed change
- (2) Process material changes
- (3) Safety and health implications
- (4) Fire and explosion prevention systems review
- (5) Whether the change is permanent or temporary
- (6) Personnel exposure changes
- (7) Modifications to operating maintenance procedures
- (8) Employee training requirements
- (9) Authorization requirements for the proposed change

15.11.5 Explosion prevention system documentation as required by Chapter 15 shall be updated to incorporate the change.

15.11.6 Implementation of the management of change procedures shall not be required for replacements-in-kind or refurbishment of explosion prevention systems.

15.11.7 An annual statement declaring no change shall be created and maintained for the life of the process.

15.12 Maintenance.

15.12.1 Maintenance shall be performed after any condition that could impair the protection system, in accordance with the manufacturer's requirements.

15.12.2 A visual inspection shall be performed in accordance with Section 15.7 after every process maintenance turnaround.

15.12.3 If process material has a tendency to adhere to the system components, the affected components shall be cleaned periodically to maintain system efficiency.

15.12.4 Process interlocks shall be verified.

15.12.5 Inspection for potential ignition sources shall be conducted and, where practical, eliminated or maintained within permissible limits.

15.12.6 Records shall be kept for a minimum of 10 years of any maintenance and repairs performed.

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

Δ A.1.2.3 Some jurisdictions, industries, and companies require system reliability to meet a target measure of failure on demand for hardware. These targets can be stated as a level of safety integrity. Establishing safety integrity levels is covered by ISA and other organizations. The requirements of this standard and the review and approval processes stated are intended to establish an acceptable level of reliability. Nothing in this standard is intended to prevent the use of safety integrity levels used by other organizations. (See also [A.15.5.5.1](#).)

Δ A.1.3 The need for such methods can be established by a dust hazard analysis, by a flammable gas hazard analysis, or by recognized and generally accepted good engineering practice (RAGAGEP) codes or standards (e.g., NFPA 1, NFPA 2, NFPA 30, NFPA 30B, NFPA 33, NFPA 35, NFPA 52, NFPA 61, NFPA 400, NFPA 484, NFPA 652, NFPA 654, NFPA 655, NFPA 664, and NFPA 5000).

A.1.3.1.1 Where ignition is deemed a significant risk in either interconnected enclosure, each such enclosure should also be protected using a method for explosion prevention. For such a case, deflagration isolation is usually needed between the interconnected vessels in addition to a method for explosion prevention on each interconnected vessel. The use of explosion venting alone for the interconnected enclosures, without deflagration isolation, is limited due to the potential for increased explosion severity, as explained in NFPA 68. The use of containment or foam alone for the interconnected enclosures, without deflagration isolation, is limited also by the potential for transition to a detonation, as explained in the relevant chapters.

A.1.3.2(2) For information on deflagration venting, see NFPA 68.

A.1.3.2(8) For information on cutting and welding practices, see NFPA 51B. For information on preparation of tanks, piping, or other enclosures for hot work, see NFPA 326.

Δ A.3.2.1 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials nor does it approve or evaluate testing laboratories. In determining the acceptability of installations **or** procedures, equipment, or materials, the "authority having jurisdiction" may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The "authority having jurisdiction" may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

A.3.2.2 Authority Having Jurisdiction (AHJ). The phrase "authority having jurisdiction," or its acronym AHJ, is used in NFPA standards in a broad manner because jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

A.3.2.4 Listed. The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

A.3.3.4 Combustible Dust. For purposes of this standard, a combustible particulate solid exhibiting only a fire hazard under normal, abnormal, and upset process conditions is excluded. Materials that cannot burn at ambient conditions can become combustible or explosible at elevated temperature, at elevated pressure, or when fuel vapors are present.

Both NFPA 69 and NFPA 68 use the term *combustible dust* in its explosion hazard context. In other words, the term *combustible dust* in both NFPA 69 and NFPA 68 is synonymous with the term *explosible dust* used in the test standards.

Dusts traditionally have been defined as a material 420 µm or smaller (capable of passing through a US No. 40 standard sieve). For consistency with other standards, 500 µm (capable of passing through a US No. 35 standard sieve) is now considered an appropriate size criterion. The ratio of particle surface area to volume is a key factor in determining the rate of combustion. Combustible particulate solids with a minimum dimension more than 500 µm generally have a surface-to-volume ratio that is too small to pose a deflagration hazard. Flat platelet-shaped particles, flakes, or fibers with lengths that are large compared with their diameter usually do not pass through a 500 µm sieve yet could still pose a deflagration hazard. Many particulates accumulate electrostatic charge in handling, causing them to attract each other and form agglomerates. Often agglomerates behave as if they were larger particles, yet when they are dispersed they present a significant hazard. Consequently, it can be inferred that any particle that

has a minimum dimension of 500 microns or less could behave as a combustible dust if suspended in air or the process specific oxidizer.

If the minimum dimension of the particulate is greater than 500 μm , it is unlikely that the material would be a combustible dust, as determined by test. The determination of whether a sample of combustible material presents a flash fire or explosion hazard could be based on a screening test methodology such as provided in ASTM E1226, *Standard Test Method for Explosibility of Dust Clouds*. Alternatively, a standardized test method such as ASTM E1515, *Standard Test Method for Minimum Explosible Concentration of Combustible Dusts*, could be used to determine dust explosibility.

There is some possibility that a sample will result in a false positive in the 20 L (5.3 gal) sphere when tested by the ASTM E1226 screening test or the ASTM E1515 test, due to the high-energy ignition source over-driving the test. When the lowest ignition energy allowed by either method still results in a positive result, the owner/operator can elect to determine whether the sample is a combustible dust with screening tests performed on a larger-scale [$=1 \text{ m}^3$ (35.3 ft^3)] enclosure, which is less susceptible to overdriving and will provide more realistic results.

The possibility for false positives has been known for quite some time and is attributed to “overdriven” conditions that exist in the 20 L (5.3 gal) chamber due to the use of strong pyrotechnic igniters. For that reason, the reference method for explosibility testing is based on a 1 m^3 (35.3 ft^3) chamber, and the 20 L (5.3 gal) chamber test method is calibrated to produce results comparable to those from a 1 m^3 (35.3 ft^3) chamber for most dusts. In fact, the US standard for 20 L (5.3 gal) testing (ASTM E1226) states, “The objective of this test method is to develop data that can be correlated to those from the 1 m^3 (35.3 ft^3) chamber (described in ISO 6184-1 and VDI 3673).” ASTM E1226 further states, “Because a number of factors (concentration, uniformity of dispersion, turbulence of ignition, sample age, etc.) can affect the test results, the test vessel to be used for routine work must be standardized using dust samples whose K_{st} and P_{max} parameters are known in the 1 m^3 (35.3 ft^3) chamber.”

NFPA 68 also recognizes this problem and addresses it, stating:

“The 20 L (5.3 gal) test apparatus is designed to simulate results of the 1 m^3 (35.3 ft^3) chamber; however, the igniter discharge makes it problematic to determine K_{st} values less than 50 bar-m/sec. Where the material is expected to yield K_{st} values less than 50 bar-m/sec, testing in a 1 m^3 (35.3 ft^3) chamber might yield lower values.”

The term *combustible dust* is not exclusive to dusts, but also includes fibers, fines, chips, chunks, flakes, and mixtures thereof. A definition of this breadth is necessary because it is crucial to address the fact that there is attrition of the material as it is conveyed. Pieces and particles rub against each other and collide with the walls of the duct as they travel through the system. The rubbing and collision break down the material and produce a mixture of pieces and much finer particles called *dusts*. Consequently, it is expected that every conveying system produces dusts, regardless of the starting size of the material, as an inherent by-product of the conveying process.

Most commercial test laboratories offer a screening (“go” or “no go”) test to establish whether a dust sample is combustible. The test method commonly uses the test apparatus described in ASTM E1226, *Standard Test Method for Explosibility of Dust Clouds*.

Any time a combustible dust is processed or handled, a potential for deflagration exists. The degree of deflagration hazard varies, depending on the type of combustible dust and the processing methods used.

A dust deflagration has the following four components:

- (1) Combustible dust
- (2) Dust dispersion in air or other oxidant
- (3) Sufficient concentration at or exceeding the minimum explosible concentration (MEC)
- (4) Sufficiently powerful ignition source such as an electrostatic discharge, an electric current arc, a glowing ember, a hot surface, welding slag, frictional heat, or a flame

If the deflagration is confined and produces a pressure sufficient to rupture the confining enclosure, the event is, by definition, an *explosion*.

Evaluation of the hazard of a combustible dust should be determined by the means of actual test data. Each situation should be evaluated, and applicable tests should be performed under conditions that will be a conservative representation of the operations under normal, abnormal, and upset conditions. The following factors are sometimes used in determining the deflagration hazard of a dust:

- (1) MEC as defined in ASTM E1515, *Standard Test Method for Minimum Explosible Concentration of Combustible Dusts*
- (2) Minimum ignition energy (MIE) as defined in ASTM E2019, *Standard Test Method for Minimum Ignition Energy of a Dust Cloud in Air*
- (3) Particle size distribution
- (4) Moisture content as received and as tested
- (5) Maximum explosion pressure at optimum concentration
- (6) Maximum rate of pressure rise at optimum concentration
- (7) K_{st} (normalized rate of pressure rise) as defined in ASTM E1226
- (8) Layer ignition temperature as defined in ASTM E2021, *Standard Test Method for Hot-Surface Ignition Temperature of Dust Layers*
- (9) Dust cloud ignition temperature as defined in ASTM E1491, *Standard Test Method for Minimum Autoignition Temperature of Dust Clouds*
- (10) Limiting oxidant concentration (LOC) to prevent ignition
- (11) Electrical volume resistivity
- (12) Charge relaxation time
- (13) Chargeability

It is important to keep in mind that as particulate is processed, handled, or transported the particle size generally decreases due to particle attrition. Consequently, it is often necessary to evaluate the explosibility of the particulate at multiple points along the process. Where process conditions dictate the use of oxidizing media other than air (nominally taken as 21 percent oxygen and 79 percent nitrogen), certain of the tests should be conducted in the appropriate process-specific medium.

A.3.3.5 Combustible Particulate Solid. Combustible particulate solids include dusts, fibers, fines, chips, chunks, flakes, and mixtures of these. A definition of this breadth is necessary because it is crucial to address the fact that there is attrition of the material as it is conveyed. Pieces and particles rub against each other and collide with the walls of the duct as they travel through the system. The rubbing and collision break down the material and produce a mixture of pieces and much finer particles, called dusts. Consequently, it is expected that every conveying system produces dusts, regardless of the starting size of the material, as an inherent by-product of the conveying process.

A.3.3.12 Dust Flame-Arresting Device. Dust flame-arresting devices are not intended to be the means of particulate retention or to regularly filter the airstream. They may see dust during process upsets.

A.3.3.17 Flame Arrester. The emerging gases are sufficiently cooled to prevent ignition on the protected side.

A.3.3.20 Flammable Limits. Flammable limits for gases and vapors are typically defined as volume percentages, whereas flammable limits for dusts are defined as mass concentrations (mass per unit volume). When expressed in mass concentration units, the lower flammability limit is referred to as the minimum explosible concentration (MEC).

See NFPA's *Fire Protection Guide to Hazardous Materials* for information on fire hazard properties of flammable liquids, gases, and volatile solids.

A.3.3.23 Hybrid Mixture. In certain processes, flammable gases can desorb from solid materials. If the solid is combustible and is dispersed in the gas-oxidant mixture, as can be the case in a fluidized bed dryer, a hybrid mixture can also result.

A.3.3.24 Immediate, Automatic Shutdown. For example, in an immediate, automatic shutdown, motors are turned off and valves move to their predetermined fail-safe positions. As opposed to an *orderly shutdown*, the transition to the safe condition of all such actuated components is initiated simultaneously, rather than in a sequential fashion.

A.3.3.26 Isolation. Stream properties include deflagration, mass flow, and ignition capability.

A.3.3.28 Limiting Oxidant Concentration (LOC). Materials other than oxygen can act as oxidants. The LOC depends upon the temperature, pressure, and fuel concentration as well as the type of diluent. Preliminary results of the ASTM E2079, *Standard Test Methods for Limiting Oxygen (Oxidant) Concentration in Gases and Vapors*, round robin tests for gases and vapors revealed that the LOC data that were obtained using different test methods and that are listed in a majority of reference publications are nonconservative. The old Bureau of Mines data were obtained mostly in a 50 mm (1.97 in) diameter flammability tube. This diameter might be too small to mitigate the flame-quenching influence, thereby impeding accurate determination of the LOC of most fuels. The 4 L (1.06 gal) minimum volume specified in ASTM E2079 would correspond to a diameter of at least 200 mm (7.9 in.). As a result, some LOC values determined using this standard are approximately 1 percent by volume oxygen lower than the previous values measured in the flammability tube, and a few are even up to 1.5 percent by volume lower. The lower LOC values obtained in larger chambers are more appropriate for use in fire and

explosion hazard assessment studies. A data comparison can be found in Table A.3.3.28.

Generally, LOC decreases as the pressure or temperature prior to ignition increases. Best practice is to test the LOC at the appropriate temperature and pressure. Deviations from the test fuel composition and temperature might possibly be accounted for by using appropriate techniques. For dusts, an appropriate test apparatus should be used in conjunction with a strong ignition source, such as that described in standard ASTM E2931, *Standard Test Method for Limiting Oxygen (Oxidant) Concentration of Combustible Dust Clouds*, or in CEN EN 14034-4, *Determination of Explosion Characteristics of Dust Clouds, Part 4: Determination of the Limiting Oxygen Concentration LOC of Dust Clouds*.

A.3.3.32 Minimum Ignition Energy (MIE). The lowest value of the minimum ignition energy is found at a certain optimum mixture. The lowest value, at the optimum mixture, is usually quoted as the minimum ignition energy. [68, 2023]

A.3.3.34 Orderly Shutdown. For example, in an orderly shutdown, product would be removed from any affected components or equipment, and temperatures and pressures would be returned to their shutdown state. An orderly shutdown allows the process to be placed in a state that would permit process restart without undue complications. It should be remembered that the orderly shutdown has been initiated in response to an indication that the protection system has been compromised and might not be capable of providing the intended protection. This places the process at an abnormal level of risk. Consequently, the shutdown should be implemented in a prompt, timely fashion.

Table A.3.3.28 Effect of Test Enclosure on LOC Values When Using Nitrogen as Diluent

Gas or Vapor	LOC Values	
	Flammability Tube 5 cm Diameter* (% by Volume)	120 L Sphere 60 cm Diameter† (% by Volume)
Hydrogen (H ₂)	5.0	4.6
Carbon monoxide (CO) (at high humidity)	5.5	5.1
Methane (CH ₄)	12.0	11.1
Ethylene (C ₂ H ₄)	10.0	8.5
Propane (C ₃ H ₈)	11.5	10.7

*Data from US Bureau of Mines Bulletin 680, "Investigation of Fire and Explosion Accidents in the Chemical, Mining, and Fuel-Related Industries — A Manual," 1985.

†Zlochower, I. A., and G. M. Green, "The Limiting Oxygen Concentration and Flammability of Gases and Gas Mixtures," 2009.

Note: The data were obtained in accordance with ASTM E2079, at 1 atm and at 20°C–23°C (68°F–73°F) on N₂-air-fuel mixtures. Electric spark was created by the discharge of a 54°C (130°F) capacitor, initially charged to 300 V, through a 15 kV transformer. The standard criterion [i.e., minimum 6.9 kPa (1 psi) or 7 percent absolute pressure rise] was used to detect ignition.

A.3.3.39 Reduced Pressure (P_{red}). P_{red} is the maximum reduced pressure that a deflagration will produce when a protection system such as venting, suppression, or heat removal functions. P_{red} can be calculated or measured during testing. The calculated value will normally be higher than what is actually achieved.

A.3.3.42 Safety Integrity Level (SIL). A safety integrity level (SIL) is a relative level of risk reduction provided by a safety instrumented function (SIF). In simple terms, a SIL is a measure of the required reliability of a SIF. SIL levels are typically calculated for a SIF using reliability data for the components and its operational history ("proven in use"). International standards such as ANSI/ISA 61511, *Functional Safety: Safety Instrumented Systems for the Process Industry Sector*; IEC 61508, *Functional safety of electrical/electronic/programmable electronic safety-related systems*; and IEC 61511, *Functional safety: Safety instrumented systems for the process industry sector*, provide the method(s) used to establish the reliability.

A.3.3.43 Self-Decomposing Mixtures. Chemicals such as acetylene or ethylene oxide are self-decomposing mixtures.

A.4.2.3.1 For information on the hazards associated with flammable gas and vapor explosions, see Chapter 69, Flammable Gas and Vapor Explosions, in the *SFPE Handbook of Fire Protection Engineering*.

For information on the hazards associated with dusts explosions, see Chapter 70, Dust Explosions, in the *SFPE Handbook of Fire Protection Engineering*.

A.5.1 See Chapter 6 of NFPA 652 for additional information on performance-based design.

A.6.1 It should be recognized that there are other methods for preventing combustion. These include changing the process to eliminate combustible material either used or generated in the process. (Deflagration venting is not addressed in this standard; see NFPA 68.)

A.6.6 Inspection, maintenance, and operator training are necessary requirements of any explosion prevention system. Reliability of the system and its instrumentation is only as good as the inspection and periodic preventive maintenance they receive. Operator response and action to correct adverse conditions, as indicated by instrumentation or other means, are only as good as the frequency and thoroughness of training provided.

A.6.6.1 Analyzers and other system instrumentation can require more frequent periodic inspection than that required for other components of the system. Inspections should be made according to the manufacturer's recommendations or as required by operating conditions and inspection history.

A.7.1.1 Operation of a system with an oxidant concentration low enough to prevent a deflagration does not mean that incipient fires are prevented. Smoldering can occur in fibrous materials or dust layers at very low oxidant concentrations, which can ultimately result in a fire or explosion when exposed to higher oxidant concentrations. Caution should be exercised when such systems are opened to the air. (See Annex B for a discussion of the control of combustible gas mixtures. Also see Annex C for LOCs.)

A.7.1.3 Combustible dusts that need passivation layers to prevent ignition are one example of a fire or explosion hazard

associated with a material leaving the low oxygen environment. The processing in such an environment can prevent the formation of the oxide layer needed for passivation.

Another example is flammable gases that are normally processed in inerted glove boxes to prevent ignition where the process piping passes through other processing areas that rely on controls such as oxidant exclusion via double jacket piping.

Reviews of these potential low oxygen applications should consider these effects.

A.7.2.1 Purge gases generated by any of the acceptable methods described in this standard might not necessarily be compatible for all applications. In general, the physical and chemical properties of the combustible materials involved govern the type and required purity of the purge gas needed. Chlorinated and fluorinated hydrocarbons are sometimes used. Although these gases are more costly than carbon dioxide or nitrogen, the allowable oxygen concentration might be higher. The user is cautioned, however, that some halogenated hydrocarbons, carbon dioxide, and even nitrogen at elevated temperatures might react violently with certain dusts. Also, such gases might not be effective in providing explosion protection for certain combustible metal dusts, such as aluminum, magnesium, titanium, zirconium, thorium, and uranium. Argon, helium, and other rare gases might have to be used for inerting certain systems.

In general, personnel should not enter enclosures where the atmosphere is oxygen deficient. If it is necessary to enter such an enclosure, personnel should use self-contained breathing apparatus, preferably the positive-pressure type. Canister-type gas masks should not be used; they do not supply oxygen and do not offer any protection. The toxicity of certain purge gases should be recognized. The potential for accidental release of purge gases into normally occupied areas should be recognized and the necessary precautions taken.

A.7.2.1(9) This requirement is based upon incidents discussed in "Loss of Inerting Due to Multiple Exhaust Vents." This paper discusses one potential cause.

A.7.2.2.1 The process analysis generally includes, but is not limited to, review of the general scope of work, process design criteria, process description, material flow diagrams, basis for deflagration protection, basis for the physical and chemical properties of the process material(s), equipment layouts, detailed mechanical drawings and specifications, supporting engineering calculations, and process and instrumentation diagrams. One method by which this requirement can be satisfied is with a process hazard analysis conducted in accordance with the methods outlined by the AIChE Center for Chemical Process Safety in *Guidelines for Hazard Evaluation Procedures*.

A.7.2.3.1 The values were obtained under the conditions specified in the tables found in Annex C. Higher energy ignition sources, higher temperatures, or higher pressures could reduce the LOC values shown. LOC values for dusts of a particular chemical composition could also differ with variations of physical properties such as particle size, shape, and surface characteristics. A particular dust could have combustion properties that differ from those shown in the tables in Annex C. Tabular data for combustion characteristics are provided as examples only.

A.7.2.4.4 Under certain conditions of reducing atmospheres in the presence of sulfur compounds, pyrophoric iron sulfides could form in air-starved atmospheres. When air is admitted into such an atmosphere, the iron sulfides could ignite. A typical procedure for controlling such ignition is to thoroughly wet the iron sulfide deposits with water and maintain a wetted surface until all deposits are removed and disposed of safely and properly. Another method is to maintain an inert atmosphere in the tank or vessel containing pyrophoric iron sulfides. API RP 2016, *Guidelines and Procedures for Entering and Cleaning Petroleum Storage Tanks*, provides information covering the control and removal of pyrophoric iron sulfide deposits.

Rapid oxidation tends to occur when the deposits dry out. Thus, even though air is admitted slowly, nothing happens until the deposits dry out, a process that could take more time than used to admit air. A common practice in industries that deal with such deposits is to keep them wet until they can be removed to a safe location.

Iron sulfide deposits are often thick or are shielded from air by layers of nonreactive materials. When the layers are subsequently disturbed, the deposits could ignite. Furthermore, although procedures are often used to neutralize or remove such deposits before admitting air, it is often difficult to remove all traces of pyrophoric material.

A.7.3.2(4) The rate of application for steam inerting should be sufficient to maintain a steam concentration of at least $1.13 \text{ kg/min} \cdot 2.83 \text{ m}^3$ ($2.5 \text{ lb/min} \cdot 100 \text{ ft}^3$).

A.7.5.5 This requirement is intended to provide for a sufficient number of isolation points to facilitate maintenance, while holding the number of isolation valves to a manageable number so that accidental shutoff is minimized.

A.7.5.7 Consideration should be given to providing a positive means of preventing the backflow of purge gas into other systems where such flow would present a hazard.

A.7.7.1 The objective is to maintain operation outside of the flammable region. This can be achieved by adding either enrichment gas (natural gas or methane) or an inert gas such as nitrogen. In either case, a safety factor should be maintained between the operating condition and the closest point of the flammable region. Instrumentation should have redundancy, depending on the criticality of the operation.

A.7.7.2.1 As shown in Annex B, any system of fuel plus oxidant plus inert gas requires a certain minimum concentration of oxidant for combustion. For oxidant concentrations less than the LOC, no combination of fuel plus diluent can result in a flammable mixture.

A.7.7.2.4 Calculation of the LOC can result in an overestimation of up to at least 2 volume percent oxygen relative to measured values, and this potential error should be taken into account when applying the safety margin.

A.7.7.2.5 See A.7.7.2.8.

A.7.7.2.8 Figure A.7.7.2.8 illustrates the oxidant control limits as a function of LOC with and without continuous monitoring.

A.7.7.2.8.1.1 Products with relatively high vapor pressures can, by themselves, maintain an atmosphere above the upper flammability limit of the vapor. Where flammable atmospheres are predicted, it is common practice to use a padding gas to maintain the oxygen content at less than the LOC. Because such

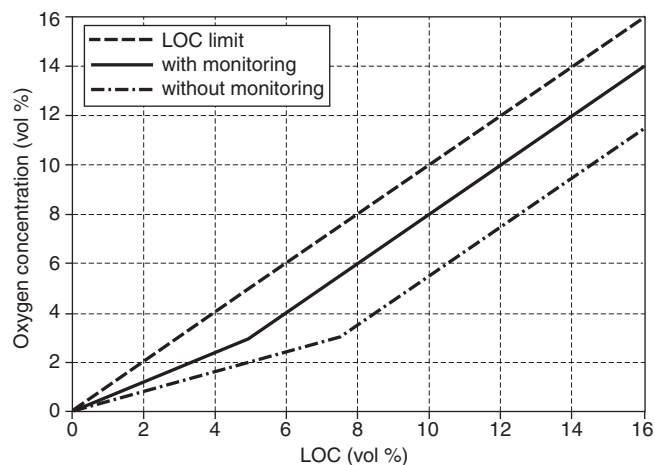


FIGURE A.7.7.2.8 Oxidant Control Limits as a Function of LOC.

maintenance typically involves almost complete replacement of air, oxygen analysis of the vapor space is not generally needed. It should be ensured that padding gas capacity maintains padding under adverse conditions, such as simultaneous pump-out of several tanks connected to the same padding supply, possibly with a contraction of vapor volume caused by a sudden summer rainstorm. Such conditions might cause air to be drawn into a container to avoid underpressure damage. Also, some monomer tanks need several percent of oxygen to activate dissolved inhibitors. Such tanks might need oxygen monitoring.

A.7.7.3.1 The use of enrichment gas (methane or natural gas) serves the following three purposes:

- (1) It elevates the total fuel concentration and can raise it to above the upper flammable limit (UFL).
- (2) It decreases the oxidant concentration in proportion to the concentration of enrichment gas.
- (3) It elevates the LOC due to the better diluent qualities of enrichment gas relative to nitrogen in the air.

Where header systems continuously convey vapors to a combustion device such as a flare, operation above the UFL can greatly reduce the quantity of enrichment gas relative to operation below the LOC.

Marine vent collecting header operation is regulated by 33 CFR 154.

Nonmarine vent collection headers operated near atmospheric pressure and not containing any vapor with a UFL greater than 75 percent in air, or oxygen in concentrations greater than can be derived from ambient air, can be rendered nonflammable by the addition of 25 volume percent or more of natural gas or methane. The use of oxygen analyzers to control enrichment gas flow is practical only in cases where the nitrogen-to-oxygen ratio is the same as in the air. Where a container has been partly inerted with a diluent such as nitrogen, enrichment gas should be added using flow control, since control via oxygen analyzers would otherwise add insufficient enrichment gas to provide nonflammability. The flow control system can be augmented with gas analyzers to verify correct operation during installation and for periodic performance checks.

No specific recommendations can be provided, and testing is necessary to develop an enrichment method under the following conditions:

- (1) Where system temperatures and pressures significantly exceed atmospheric conditions
- (2) Where gases with UFL above 75 percent in air are involved
- (3) Where oxygen enrichment might occur

The UFL generally increases with increased temperature and pressure; it can be sensitive to the precise gas composition and test conditions. Special procedures are needed for decomposable gases, and such procedures can involve inerting, enrichment, or deflagration isolation systems as described in Chapter 11.

The UFL is a continuous function of oxygen concentration. The greatest UFL corresponds to pure oxygen as the oxidant, and the smallest corresponds to the LOC concentration of oxidant (see Figure B.1). Systems containing high concentrations of fuel might be safely operated above the LOC, provided that they are nonflammable with respect to the actual UFL envelope. If the oxygen concentration in a system is constrained below a value whose corresponding UFL is U, a safety factor should be applied such that the fuel concentration in the system is maintained at not less than 1.7 U. This is consistent with the method in 33 CFR 154 for enrichment of marine vapor collection headers with air as the oxidant. Realistic testing is required to develop the UFL locus as a function of oxygen concentration under worst credible case operating conditions.

A.8.1 Chapter 8 applies to both flammable vapors and combustible dusts. References to basic design considerations and control at a fraction of LFL are also applicable to MEC.

Combustible concentration reduction is one of multiple methods of deflagration prevention or control for enclosures not intended for occupancy, such as electrical enclosures or process equipment. For occupiable enclosures, combustible concentration reduction is often the only feasible approach. Where the enclosure is a room or building where flammable or combustible liquids are handled, a user should not assume that a nominal 1 cfm/ft² ventilation rate, per NFPA 30, is sufficient for deflagration prevention. The foreseeable maximum release quantity and release rate should be considered in the determination of the necessary ventilation rate. If it is foreseeable that the average enclosure concentration could reach 25 percent of the LFL without mechanical ventilation, then ventilation should be provided and combustible concentration should be controlled in accordance with the requirements of this chapter.

See Annex B for a discussion of the control of flammable gas mixtures. Also, see Annex D for information on calculating the time required for ventilation.

A.8.2.2 See NFPA's *Fire Protection Guide to Hazardous Materials* for information on fire hazard properties of flammable liquids, gases, and volatile solids.

A.8.2.3.1 See A.7.2.2.1.

A.8.3.1 The combustible concentration limits for both gases and dusts are based on the total volume of the protected enclosure and assume a uniform concentration throughout. The ability to maintain uniform concentration throughout the

enclosure over time should be considered when applying this protection method.

Calculated average combustible gas/vapor concentration in enclosures should account for a credible event that could occur during startup, shutdown, or operational upset, such as spillage of the largest single container. Where the resulting average concentration would exceed 25 percent of the LFL, additional instrumentation and safety interlocks should be considered. Design for such an episodic spill could include an interlocked supplemental emergency exhaust or other means to reduce the combustible gas/vapor concentration.

Calculated combustible dust concentrations in enclosed equipment should account for the potential suspension of accumulated and stored dust in all stages of normal operation and foreseeable upset conditions. These concentrations should be compared to 25 percent of the measured minimum explosive concentrations (MECs) for the dust material with the particle size distribution present in the enclosed equipment, or to MEC values for smaller particle sizes.

The combustible concentration limits in 8.3.1 do not necessarily preclude structural failure of the enclosure during a partial volume deflagration involving a near-optimum or near-stoichiometric concentration of combustible mixture in a fraction of the enclosure volume. Calculation procedures to account for partial volume flammable gas or dust deflagrations are described in NFPA 68. (See also Ogle 1999 and Jo 2004.)

Minimum combustible dust quantities, M_{dust} , capable of producing partial volume dust deflagrations with pressures exceeding the maximum acceptable enclosure pressure, P_{red} , can be estimated from the following equation, which is based on the partial volume equations in Chapter 8 of NFPA 68.

[A.8.3.1]

$$M_{dust} = \frac{c_w V P_{es}}{P_{max}}$$

where:

M_{dust} = minimum combustible dust quantity [kg]

V = enclosed equipment volume [m³]

P_{es} = enclosure strength (2/3 ultimate strength per 3.3.14) [Pa]

c_w = worst-case dust concentration (concentration that produces the largest pressure in a closed vessel deflagration) [kg/m³]

P_{max} = maximum full volume deflagration pressure measured using the ASTM E1226 or equivalent test method [Pa]

Therefore, suspendable dust quantities should be maintained below the calculated value of M_{dust} to preclude possible structural failure during a partial volume dust deflagration.

A.8.3.2 The combustible concentration can be reduced by recirculating the atmosphere in which it is contained through a catalytic oxidation unit where the combustible material and oxidant undergo catalytic oxidation at concentrations below the lower flammable limit (LFL).

A.8.4.1 Reserved.

A.9.1 Predeflagration detection and control systems are typically used where a specific ignition source has been identified as the most probable means of ignition. The detection method is often limited to detect the identified ignition source. Possible means of detection include choosing the frequency range of an optical detector or detecting specific gases indicative of smoldering combustion or the onset of thermal degradation. Such systems are not designed to detect all possible ignition sources and therefore might not provide the same level of protection as other explosion prevention systems.

A.9.5.1.1 See A.7.2.2.1.

A.9.6.1 The design basis generally includes, but is not limited to, the general scope of work, design criteria, process description, material flow diagrams, basis for deflagration protection, and the basis for and the physical and chemical properties of the process materials. The design generally includes, but is not limited to, equipment layouts, detailed mechanical drawings, specifications supporting engineering calculations, and process and instrumentation diagrams.

A.10.1 Explosion suppression systems mitigate the hazardous effects of a deflagration within a protected enclosure by detecting the deflagration in the early stages of formation (incipient) and extinguishing the fireball before the pressure exceeds the pressure resistance of the enclosure. An explosion suppression system typically consists of explosion detectors, high rate discharge (HRD) suppressors with appropriate dispersion nozzles, and a control panel. Explosion isolation is often used in conjunction with these systems to minimize the potential for flame propagation from the protected enclosure. Explosion suppression systems can be used when the combustible products are toxic and can be used irrespective of the location of the protected enclosure.

Explosion suppression systems typically use dry chemicals (sodium bicarbonate or monoammonium phosphate) or water as suppressants. Injection of a suppressant into the propagating flame front of the incipient explosion reduces the temperature of the combustible material below a level necessary to sustain combustion. Thermal quenching (heat absorption) is the principal mechanism utilized by explosion suppressants.

Explosion suppression systems often utilize methods such as paired detectors, detector voting, and vibration isolation devices to reduce the possibility of inadvertent activations. To aid in the investigation of a system activation, an indicating device denoting the actuating detector is sometimes used.

Explosion suppression systems have been applied in volumes from 0.2 m³ to 1500 m³ (7.1 ft³ to 52,972 ft³) and against a wide variety of combustible materials.

Figure A.10.1 shows a schematic of a typical suppression system.

A.10.1.3 The effectiveness of a suppression system is dependent on the ability of the system to deliver sufficient quantities of suppressant into the incipient deflagration flame front to extinguish the combustion before destructive pressure levels are developed in the protected enclosure. Rapid detection and rapid response are essential for the success of a suppression and isolation system. In fact, an improperly designed or maintained suppression system could increase the probability of failing dangerously.

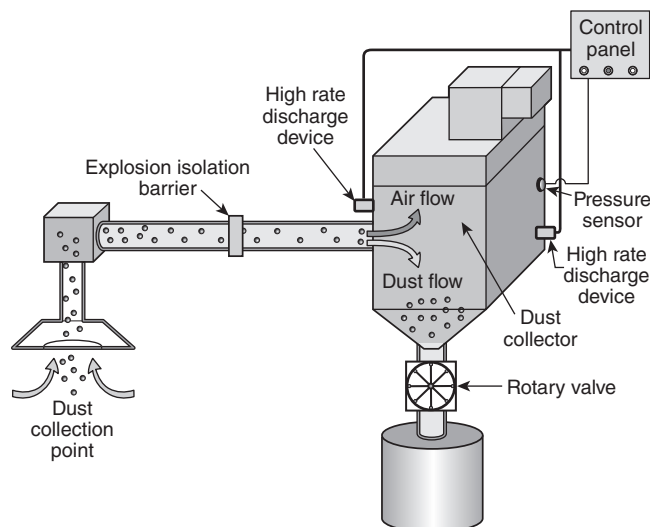


FIGURE A.10.1 Typical Suppression System Schematic.

Detection is most often based on the system reaching a preset pressure or a pressure rate of rise. This requires a finite and not insignificant amount of time. The time required for detection is dependent primarily upon the preset conditions, the vessel volume, and the K_{St} or K_G . The detection time will increase as the volume increases and will decrease as the K_{St} (K_G) increases. A dust with a low K_{St} in a large volume will take considerably longer for detection than a high K_{St} dust in a small volume. The effect of delayed detection will allow the pressure to continue to increase within the protected enclosure. In order to maintain an equivalent maximum suppressed pressure the quantity of discharge points or size of discharge orifice would need to be increased.

Suppressant discharge pattern is a limiting factor when determining the viability of protecting large-scale enclosures with a particular suppressor. The suppressor discharge orifice, suppressor driving pressure, and the efficiency of the discharge nozzle determine the suppressant concentration delivery as a function of time. The explosibility characteristics of the material and the physical characteristics of the enclosure are also critical in determining the number and location of detection devices and suppressors.

A.10.2.3 When the pressure resistance of vessel is not available from the manufacturer, the owner or operator should determine this pressure resistance by calculation based on condition of actual enclosure. If the owner or operator chooses to use generic values for typical construction, this could result in enclosure failure. FM Data Sheet 7.76, "Prevention and Mitigation of Combustible Dust Explosion and Fire," provides generic values for typical construction.

A.10.3.1 Experience has shown that performing maintenance operations without disarming a suppression system could result in inadvertent discharge of the suppression system.

A.10.4.2.1 The intent is to require that explosion protection systems be reviewed by an independent organization to verify that the system is adequate for the hazard present. Therefore, an owner or purchaser is required to obtain confirmation of that review.

In practice, this independent organization has been a specialized testing organization that listed or approved the protection system for specified hazards and within specified limits. This gives independent approval of the system, while the manufacturer retains proprietary details of their products and systems.

Currently, within the European Union (EU), the explosion suppression system manufacturers have their systems certified to CEN standards. This certification is a requirement under regulations within the EU.

The intent of this standard is that either of these approaches are acceptable.

A.10.4.3.1.1 The process analysis generally includes, but is not limited to, review of the general scope of work, process design criteria, process description, material flow diagrams, basis for deflagration protection, basis for the physical and chemical properties of the process material(s), equipment layouts, detailed mechanical drawings and specifications, supporting engineering calculations, and process and instrumentation diagrams. One method by which this requirement can be satisfied is with a process hazard analysis conducted in accordance with the methods outlined by the AIChE Center for Chemical Process Safety in *Guidelines for Hazard Evaluation Procedures*.

A.10.4.4.1 The design basis generally includes, but is not limited to, the general scope of work, design criteria, process description, material flow diagrams, basis for deflagration protection, and basis for and the physical and chemical properties of the process materials. The design generally includes, but is not limited to, equipment layouts, detailed mechanical drawings, specifications, supporting engineering calculations, and process and instrumentation diagrams.

A.10.5.2.3 Typical approaches include two out of three voting to reduce spurious failures. Another approach might be two detectors in an “and” configuration combined in an “or” configuration with an identical pair.

A.10.5.3 In addition to local visual and audible trouble signals, the control panel can provide an electrical output means to produce this function externally. When an external means is utilized, it should be implemented full time and confirmed at system acceptance.

A.10.6.1 Detection devices that respond to radiant energy might be used, provided that the application environment does not inhibit their proper operation. Airborne dust particles, dust coating of the detector viewing window, certain gases, and the distance to the ignition source might inhibit sufficiently rapid response to the hazard.

A.10.7.1 Examples of electrically operated actuating devices include detonators, gas generators, solenoids, linear actuators, or other devices that are activated to release suppressant into the protected vessel.

A.10.8 Halogenated hydrocarbons, such as bromochloromethane, or dry chemical agents might be used with most combustibles. The suitability of the suppressant should be determined if elevated temperatures or pressures are anticipated or if the oxidant is a material other than air.

Water might also be used as a suppressant if it can be demonstrated to be effective. If ambient or process temperatures below 0°C (32°F) are expected, freeze protection might be necessary.

A.10.8.1 The suppression agent and any escaping gases, contaminants, or parts can introduce contamination or chemical hazards when used in combination with certain process chemicals or materials of construction. The choice of agent should include an evaluation of all potential adverse interactions between the agent and process. A chemical interaction matrix (e.g., the *NOAA Reactivity Worksheet*) is an excellent tool to use as a part of this evaluation.

A.11.1.1 It is frequently impossible to design and operate equipment without interconnecting pipes or ducts. Uses for pipes or ducts include conveying, transferring, and ventilating. Where the pipes or ducts contain flammable or combustible materials plus an oxidant, ignition can result in flame spread throughout the interconnected equipment. Such flame spread can sometimes increase the violence of the deflagration, resulting in pressure piling and accelerated rates of pressure rise in the interconnected equipment from flame-jet ignition. Pressure piling can increase maximum pressure, P_{max} , in closed vessels, thus increasing the demands of deflagration pressure containment; and flame-jet ignition can increase deflagration venting requirements (see *NFPA 68*). In extreme cases, the accelerating effect of turbulent combustion through pipes or ducts plus any increased effects from pressure piling can result in detonations.

Other factors such as elevated operating pressure, elevated temperature, or oxygen concentration can be expected to intensify the combustion process.

A.11.1.2 Table A.11.1.2 provides a quick reference chart that highlights the various isolation techniques and their application as an isolation protection system.

A.11.1.5 The design of an active isolation system is based on the relative timing of the two key processes: the time required for the detection of an explosion and the creation of a barrier versus the time it takes for the propagating flame front to reach that barrier. This usually results in the determination of a minimum barrier placement, that is, the shortest distance at which the barrier will be in place before the flame front arrives. Both phenomena are complex, with multiple interrelated variables.

Additional critical complexities arise from the fact that exact fuel concentration at the time of ignition and the ignition location are unknown. The system design should consider the entire range of credible concentrations, and possible ignition locations. Some systems (e.g., active isolation systems and float valves) are particularly vulnerable to ignition near the pipe inlet, as well as non-optimal fuel-oxidant mixtures. Detection is most often based on the system reaching a preset pressure or a pressure rate of rise. This requires a finite and not insignificant amount of time. The time required for detection is dependent primarily on the preset conditions, the vessel volume and the K_{St} or K_G . The detection time will increase as the volume increases and will decrease as the K_{St} (K_G) increases. A dust with a low K_{St} in a large volume will take considerably longer for detection than a high K_{St} dust in a small volume. The effect of delayed detection can be to allow the flame to propagate farther and faster before isolation is initiated. This in turn can require longer minimum placements. Optical detection, normally located on the duct at the interconnection, is not affected in this manner. It does, however, require that the flame has entered the duct in order to be detected.

Table A.11.1.2 Isolation Features of Pipe and Duct Protection Systems

Isolation System	Type	Fuel Type	Deflagration Isolation	Ignition Source Isolation	Flow (Pressure) Isolation
Chemical barrier	Active	Dust, gas	Yes	Yes	No
Mechanical valve	Active	Dust, gas	Yes	Yes	Yes
Actuated float valve	Active	Gas	Yes	Yes	Yes
Actuated pinch valve	Active	Dust, gas	Yes	Yes	Yes
Rotary valves*	Passive	Dust	Yes	*	Yes
Flame arresters	Passive	Gas	Yes	Yes	No
Flame front diverters	Passive	Dust	No	No	Yes
Liquid seal	Passive	Gas	Yes	Yes	No
Float valve	Passive	Gas	Yes	Yes	Yes

*Rotary valves are capable of preventing flame front passage under certain conditions but do not always prevent the passage of burning embers.

The time required to create a barrier depends upon the type of isolation process. For chemical isolation, the time is determined by factors such as the time to initiate discharge, the discharge velocity, and duct diameter. The discharge velocity is affected by the gas pressure used to propel the agent as well as the length and diameter of the discharge piping. Mechanical isolation (fast-acting valves) is characterized by the time required for gate closure, which depends upon the closure energetics (see A.11.2.2.2) and the duct diameter. Float and pinch valves have similar dependencies.

The flame propagation characteristics (velocity, pressure) will determine the safe minimum and maximum locations of the isolation devices. It is well established that flames can accelerate in ducts so that flame speed or velocity increases with distance. Flame speed can be used to determine the flame arrival time at points away from the ignition. That time is balanced against the detection and barrier formation time mentioned earlier. Flame speed and acceleration are affected most strongly by fuel characteristic (K_{st} , K_{GC}), turbulence and bends, conveyance flow velocity, and vessel protection (venting, suppression, containment). Location of the ignition within the vessel affects the time when flame enters the duct as well.

The conveyance flow (Barton, 2002), with respect to the ignition location, can either oppose or enhance flame propagation. This is most commonly associated with a vessel and its inlet (opposed) and outlet (enhanced). The net effect could be to either increase (at the outlet) or decrease (at the inlet) the minimum placement, although decreasing the inlet minimum is not encouraged (recommended).

The principles of relating the flame propagation and arrival parameters with the isolation dynamics are given in Chatrathi, Going, and Grandestaff (2001), Siwek and Moore (1997), Roser, et al. (1999), Chatrathi and Going (1996), and Moore and Spring (2004).

Approaches to solving this problem are given in Moore and Spring (2004); Chatrathi, Going, and Grandestaff (2001); Chatrathi and Going (1996); and Siwek and Moore (1997).

A.11.2 Process equipment, such as mills, spray dryers, dust collectors, blowers, and vacuum pumps, is regularly connected together by piping, ducts, chutes, conveyors, and so forth. An

explosion beginning in one point in the process can propagate through these interconnections to other parts of the process, both upstream and downstream. Generally isolation techniques are necessary unless a qualified risk analysis is performed and a determination is made based on both probability and consequence that the risk is acceptable to the AHJ. Flame spread via propagation inside ducting or piping is somewhat unpredictable for dusts. Tests have shown that propagation is much less likely under certain conditions. Piping less than 100 mm (4 in.) diameter is far less likely to provide a conduit for flame spread than larger diameters. Dense phase pneumatic transfer (air velocities down near 183 m/min (600 fpm), and solids loading ratios greater than 30) is also much less likely to provide a conduit for flame spread propagation than for dilute phase pneumatic transfer (air velocities in the region of 672 m/min to 1098 m/min (2200 fpm to 3600 fpm), and solids loading ratios not greater than 15). It has been reported by Pineau that it is not uncommon for propagation to occur as few as one time in ten in controlled experiments for 150 mm piping even for dilute phase systems. However, recent testing has shown that propagation is more likely with dust concentrations in the lean region. Metal dusts are more likely to propagate deflagrations. For organic dusts, where small diameter pipes with dense phase transfer are utilized, the need for isolation techniques could be obviated if the hazard analysis is acceptable to the authority having jurisdiction. For interconnected vessels that are relatively close together, measures to reduce P_{rel} for each interconnected vessel, taking into account that propagation could occur, would eliminate the need for isolation techniques.

A.11.2.1.1 The process is similar to that of suppression in that the agent absorbs the heat of the flame and terminates propagation.

A.11.2.1.4.3 ASME *Boiler and Pressure Vessel Code*, Section XII, has been developed and published at the request of US Department of Transportation (DOT) to cover pressure vessels that are transportable containers. DOT requirements are anticipated to embrace ASME *Boiler and Pressure Vessel Code*, Section XII, at a future date.

A.11.2.2 See Figure A.11.2.2(a) and Figure A.11.2.2(b).

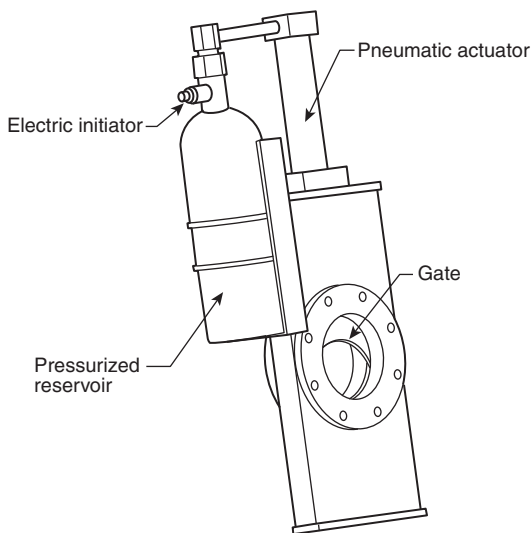


FIGURE A.11.2.2(a) Typical Fast-Acting Mechanical Valves Without Pressurized Reservoir.

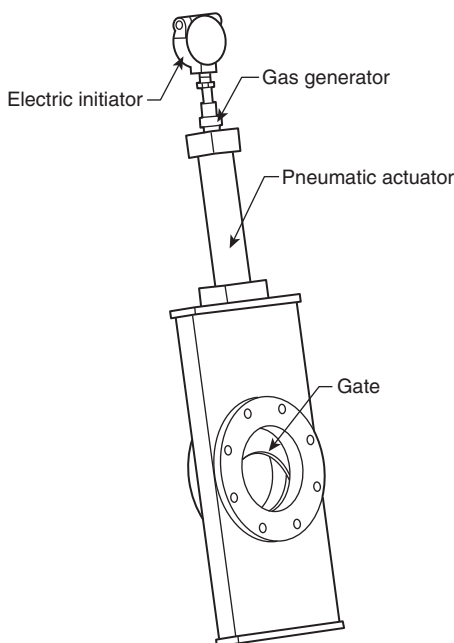


FIGURE A.11.2.2(b) Typical Fast-Acting Mechanical Valve with Pressurized Reservoir.

A.11.2.2.2 Automatic fast-acting mechanical valves are actuated (closed) upon a signal from a detector (sensor) in the pipeline between two items of interconnected process equipment. The detector sends a signal to a control device, and the signal is relayed to the valve closure mechanism. Originally this control device was a compressed gas cylinder, which then discharges the compressed gas to a piston-cylinder assembly at the top of the valve, thereby closing the gate. The propellant is generally nitrogen at 33 barg to 60 barg (479 psi to 870 psi). The valve separating the compressed gas and the piston must be rapidly opened. Mechanisms for this operation include rapid over-pressuring of a rupture disk by pyrotechnical (deto-

nator) devices. In some systems, gas generating devices have replaced the pyrotechnics. Alternatively, gas generators alone have been used to generate the pressure required to rapidly close the valve gate. Plant-air actuated valves are also available.

A fast-acting slide gate isolation valve is shown in Figure A.11.2.2(a) and Figure A.11.2.2(b) and can be mounted in vertical, horizontal, or inclined piping. With this type of valve, the pipe area is completely open and can be built without pockets and dead corners, so that dust will not settle out or accumulate. Special dampers absorb the substantial forces from the closing device and prevent the slide from springing back after closure. The damping elements are exchangeable.

A.11.2.2.5 Fast-acting mechanical valves might be subjected to detonation pressures if placed beyond the design maximum location. However, they are not expected to provide protection under these conditions.

A.11.2.3.1 An example of an externally actuated float valve is shown in Figure A.11.2.3.1.

A.11.2.3.2 Externally actuated float valves are used when low explosion overpressures are expected, and consequently flame propagation from equipment could occur if a self-actuated flow valve was used. These valves are operated by sensor-controlled gas flow [jets of gas from a high rate discharge (HRD) container or from a gas generator] through a hemispherical nozzle, which impinges upon the float (see Figure A.11.2.3.1). The externally actuated float valve functions only in one direction.

As with the self-actuated float valve, the valve plug (float) is pressed onto a valve seat on closing and held in place by a retaining device. In addition, the closed position can be indicated by an electrical signal from a limit switch. The float valve remains closed until the manual reset knob is operated from the outside.

A.11.2.3.4 The agent might introduce contamination or chemical hazards when used in combination with certain process chemicals or materials of construction. The choice of agent should include an evaluation of all potential adverse interactions between the agent and the process. A chemical interaction matrix, for example, the NOAA *Reactivity Worksheet*, is an excellent tool to use as a part of this evaluation.

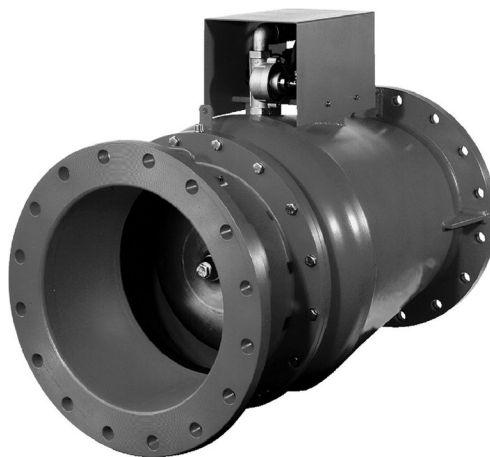


FIGURE A.11.2.3.1 Externally Actuated Float Valve.

A.11.2.3.5(7) Float valves should be used for clean service only, as particulate solids can build up on the valve trim or valve seat and prevent tight closure.

A.11.2.4.1 See Figure A.11.2.4.1.

A.11.2.4.2 The valve trim (internals) is an elastomer pinch surrounded by a gas chamber. In the event of a deflagration, an electrical signal is sent from a sensor, typically mounted on a deflagration relief device, to an air tank mounted integral to the valve. The gas tank discharges gas to the chamber surrounding the elastomer pinch and compresses it, which pinches off flow in the pipeline. Because the pinch has relatively little mass, it is both very fast acting and imparts low shock to the piping. The pinch, however, can be adversely affected by sustained high temperatures such as might be encountered in a fire.

A.11.2.4.4(7) Where high velocities and very abrasive dusts are being handled, the pinch could be subject to abrasion wear. Pinch valves are not the best choice in these conditions.

A.11.3.2 Experience has shown that performing maintenance operations without disarming an isolation system could result in inadvertent system actuation.

A.11.4.2.1 The process analysis generally includes, but is not limited to, review of the general scope of work, process design criteria, process description, material flow diagrams, basis for deflagration protection, basis for the physical and chemical properties of the process material(s), equipment layouts, detailed mechanical drawings and specifications, supporting engineering calculations, and process and instrumentation diagrams. This analysis should consider startup, normal operation, normal shutdown, temporary operations, and emergency shutdown. One method by which this requirement can be satisfied is with a process hazard analysis conducted in accordance with the methods outlined by the AIChE Center for Chemical Process Safety in *Guidelines for Hazard Evaluation Procedures*.

A.11.4.3 The design basis generally includes, but is not limited to, the general scope of work, design criteria, process description, material flow diagrams, basis for deflagration protection,

basis for fire protection systems, and the physical and chemical properties of the process materials. The design generally includes, but is not limited to, equipment layouts, detailed mechanical drawings, specifications, supporting engineering calculations, and process and instrumentation diagrams.

A.11.5.1 Detection devices that respond to radiant energy might be used, provided that the application environment does not inhibit their proper operation. Airborne dust particles, dust coating of the detector viewing window, certain gases, and the distance to the ignition source might inhibit sufficiently rapid response to the hazard.

A.11.6.1 Examples of electrically operated actuating devices include detonators, gas generators, solenoids, linear actuators, and other devices that actuate the isolation device.

A.11.7.3 In addition to local visual and audible trouble signals, the control panel can provide an electrical output means to produce this function externally. When an external means is utilized, it should be implemented full time and confirmed at system acceptance.

A.12.1 Isolation techniques can be active, which requires detection, control, and a pneumatic or electrical response that creates an isolating barrier; or passive, which responds to the deflagration pressure to create the isolating barrier. Active isolation systems are discussed in Chapter 11. See Table A.11.1.2 for isolation features of pipe and duct protection systems.

A.12.1.1 Process equipment, such as mills, spray dryers, dust collectors, and blowers, is commonly connected together by piping, ducts, chutes, conveyors, and so forth. An explosion beginning in one point in the process can propagate through these interconnections and start an explosion in other parts of the process, both upstream and downstream. Isolation methods can be used to interrupt or mitigate flame propagation, deflagration pressure, pressure piling, and flame-jet ignition between items of equipment. Each isolation technique has unique application limitations.

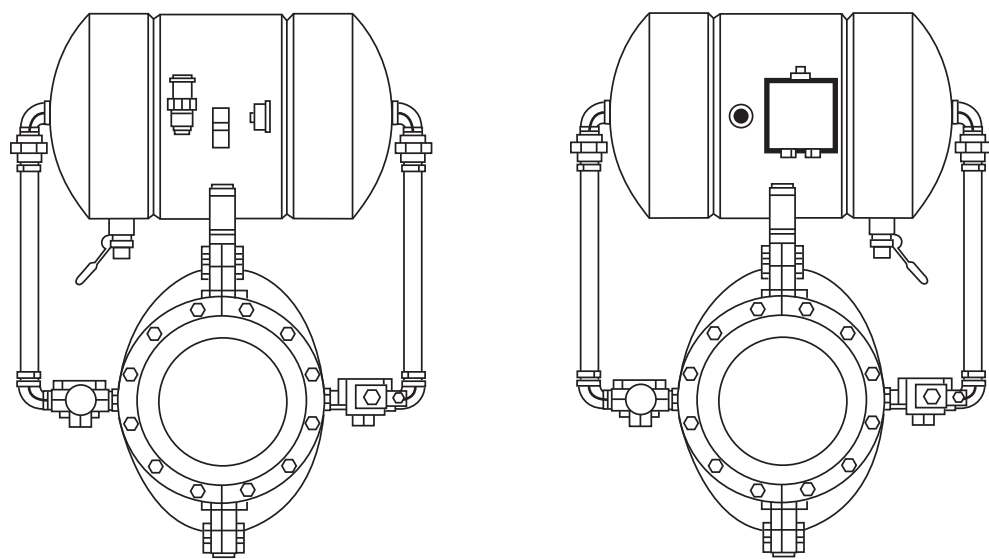


FIGURE A.11.2.4.1 Pinch Valve.

A.12.1.1.1 One potential application for end-of-line isolation applications would be where the exhaust from an air material separator is recycled into a building or other occupied area. When using an end-of-line isolation device in such an application, considerations should be made for pressure, toxicity, and smoke transmission. See NFPA 652 or the commodity-specific standard for additional requirements for air exhaust systems.

A.12.2.1 Pressure piling and flame-jet ignition through interconnecting piping can be controlled by means of a flame front diverter. The basic principle of operation of this device is that the deflagration is vented at a point where the flow direction is typically changed by 180 degrees. Due to the inertia of the fast flow caused by the deflagration, the flow will tend to maintain its direction upward rather than making a sharp turn, as it would when the velocity is low (at normal conditions). When the high-speed deflagration flame continues upward, it pushes open either a hinged cover or bursts a rupture disk located at the top of the diverter, allowing the flame to be released to the atmosphere.

Some flame front diverters have demonstrated the ability to prevent flame propagation. In most cases, tests have indicated that diverters were not completely effective in preventing flame propagation; however, where this has occurred, the deflagration severity was reduced, and pressure piling did not occur or was less severe. Figure A.12.2.1 shows the typical application of flame front diverters. Siwek (Europex 1996) discusses some design details concerning flame front diverters.

More information about flame front diverters is presented in books by Bartknecht (1989) and Eckhoff (2003). Bartknecht (1989) recommends not using a flame front diverter as the only means of isolation if it is intended to stop the flame propagation.

A.12.2.1.1 Figure A.12.2.1.1(a) through Figure A.12.2.1.1(c) provide examples of the three different types of flame front diverters addressed in this document.

A.12.2.1.4.1 The turbulence generated in the flame front diverter makes it difficult to predict the required design pressure. Therefore, testing is the only practical approach to ensure an adequate design. As a result, uncertified diverters could present a shrapnel hazard.

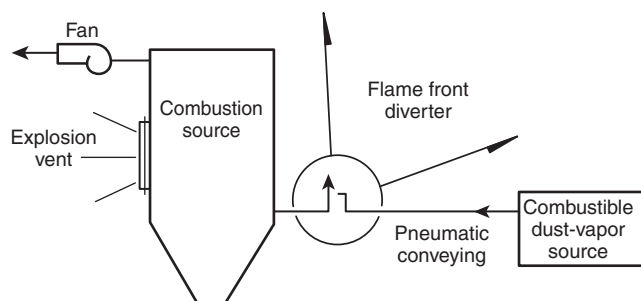


FIGURE A.12.2.1 Typical Application of Flame Front Diverters.

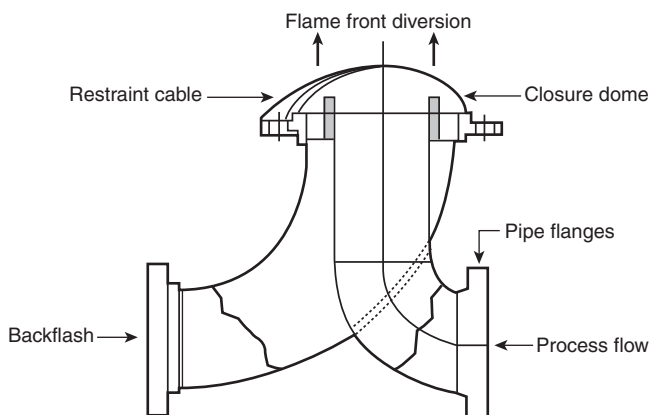


FIGURE A.12.2.1.1(a) Rupture Disc Diverter.

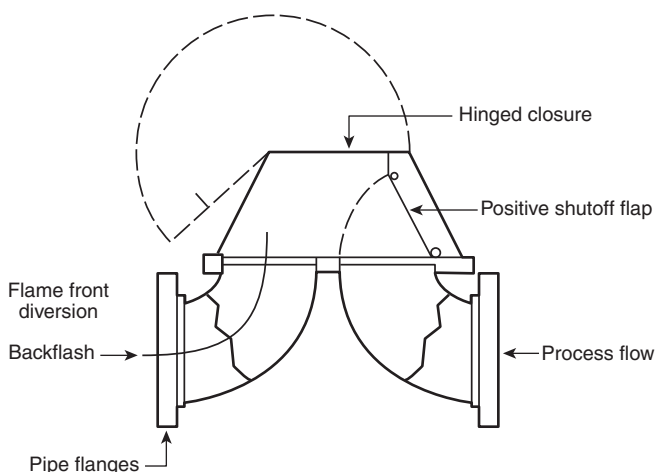


FIGURE A.12.2.1.1(b) Explosion Door Diverter.



FIGURE A.12.2.1.1(c) Self-Closing Explosion Door Diverter.

A.12.2.2 The valve is set to close at a rated pressure differential that results from the deflagration. Therefore, the deflagration must develop a minimum strength pressure wave in the upstream piping. The float valve engages a valve seat upon closing and is held in place by a retaining device. The float valve remains closed until manually reset. The float valve typically functions in both directions.

A potential problem with this valve is that an elastomeric seat, if used, could be adversely affected in high temperature environments. Another possible problem is that powder coating on the seal surfaces can prevent a tight seal, and flame breakthrough is then possible.

Since a certain minimum pressure differential is required to close the float valve, the propagation of an explosion through a pipe will not be stopped if its pressure is lower than the minimum actuation pressure of the float valve.

The placement of flow-actuated float valves requires a determination of the minimum and maximum distances from the origin of the explosion. Placement at the minimum distance ensures that the float valve closes before flame arrival. Placement at the maximum distance ensures that detonation does not develop in the vicinity of the float valve, and that the pressure does not exceed the design pressure of the float valve. These distances are usually recommended by the valve vendor and are affected by the explosibility of the fuel, the pipe diameter, and the expected minimum and maximum P_{red} in the upstream enclosure.

Table A.12.2.2 shows typical installation distances of a flow-actuated float valve, measured at the centerline.

A.12.2.2.1 A schematic drawing of a typical flow-actuated passive float valve and its internals is shown in Figure A.12.2.2.1.

A.12.2.2.4 The most challenging situation for a float valve is at the fuel-lean and fuel-rich conditions. This is due to the need for the closing forces to be generated by the deflagration itself.

Table A.12.2.2 Typical Installation Distances

Fuel Characteristics	Minimum Distance		Maximum Distance	
	m	ft	m	ft
Dust ($K \leq 300 \text{ bar/m} \cdot \text{sec}^{-1}$)	3	9.8	12	39
Hybrid ($K \leq 400 \text{ bar/m} \cdot \text{sec}^{-1}$)	3	9.8	5	16
Gas ($K \leq 100 \text{ bar/m} \cdot \text{sec}^{-1}$)	3	9.8	8	26

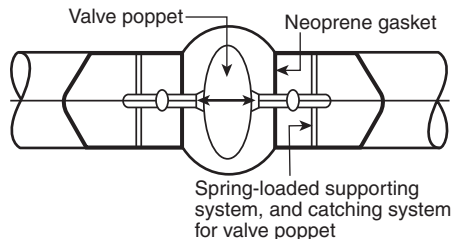


FIGURE A.12.2.2.1 Flow-Actuated Float Valve.

A.12.2.3.4.5 Signals are provided by utilizing a dust accumulation sensor located near the valve seat for the flap and/or sensors to monitor wear of the flap. Figure A.12.2.3.4.5 shows a typical dust accumulation sensor arrangement.

A.12.2.3.4.6 Flow-actuated flap valves can be susceptible to dust buildup on critical sealing surface areas. Dust accumulation sensors can provide an early warning for dust buildup. However, these sensors cannot be relied upon as the sole indicator of compromised conditions. Some products have a wear profile or create abrasion. A wear sensor can be added to indicate excessive wear. Additional inspection items to consider are the flap plate and flap seal. Inspection should include verifying the functionality of the locking mechanism.

A.12.2.3.4.7 The minimum design pressure for the ductwork is typically $2 \times P_{red}$ because the pressure wave reflects off the closed valve. Depending on the distance between the flap valve and the enclosure, pressure piling could further increase the expected peak pressure.

A.12.2.4.1 Figure A.12.2.4.1 shows a typical rotary valve.

If an explosion occurs, the rotary valve has to be automatically stopped to avoid transport of glowing or burning material to downstream equipment, where it could cause a secondary fire or act as an ignition source to ignite a dust cloud and cause a deflagration (Bartknecht 1989).

It is important that the hopper or vessel located upstream of the valve have a minimum inventory of solids to prevent flames passing through the solids due to the pressure wave from an explosion in the hopper or vessel. To maintain this minimum height of solids in the hopper upstream of the rotary valve, low level sensors are provided, which are interlocked to shut down the rotary valve before the hopper goes empty, thereby maintaining a level of solids above the rotary valve. This level of solids effectively acts as a seal to prevent flame and pressure transfer through the valve. A manual bypass should be provided for the low level sensor or interlock to allow emptying of the hopper when necessary.

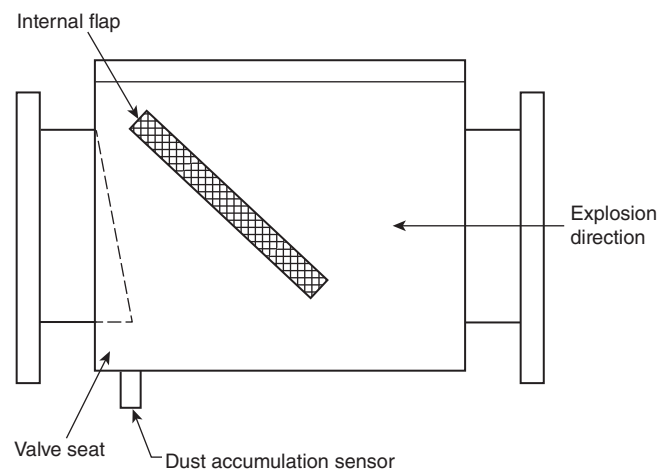


FIGURE A.12.2.3.4.5 Example of Dust Accumulation Sensor on a Flow-Actuated Flap Valve.

The rotary valve can still significantly mitigate explosion propagation, even if total isolation is not achieved, by significantly reducing transmission of pressure. Siwek (1989) presents more information on the use of rotary valves for preventing explosion propagation.

A.12.2.4.3 Faulty bearings or the presence of tramp metal can cause frictional heating, resulting in temperatures in excess of the autoignition temperature of the powder (cloud or layer). Prevention of ignition sources can be accomplished in a number of ways, including the following:

- (1) Providing a temperature switch on the bearings interlocked to stop the valve
- (2) Installing metal exclusion devices upstream of the valve (magnetic diverters, screens)
- (3) Operating the rotary valve at a low speed [tip speeds of 1 m/sec (200 fpm) or less]

A.12.2.4.4 The rotary valve with material blocking should be used with the understanding that its limitations have not been delineated to the same extent as other valves.

The material blocking method is more appropriate for deflagrations originating on the top side of the rotary valve. Where there is potential for deflagrations originating on the bottom side of a rotary valve using the material blocking method, the owner or operator should take into account the potential for material displacement and possible transmission of the deflagration.

A.12.2.4.4.1 The mass of bulk solids or powders contained in rotary valves provides a tortuous path through which the gas and flame have to pass and so acts as a “material choke” when certain design features are implemented. In previous editions of this standard, screw conveyors were included as material chokes; however, industry experience shows that these devices are not reliable as isolation devices.

A.12.2.4.5 Testing has shown that rotary valves can be effective in isolating explosion propagation if the following conditions are in place:

- (1) There are three vanes on each side of the valve that are diametrically opposed.
- (2) A close tolerance is maintained between the vanes and the valve body — that is, the gap between the rotor and housing is less than or equal to 0.2 mm (0.008 in.). For metal dusts, such as aluminum, the required gap between the tip of the rotor blades and the housing might be much smaller. Rotary air locks in metal dust service should comply with 12.2.4.5.2 or be used with a material block as described in 12.2.4.4.

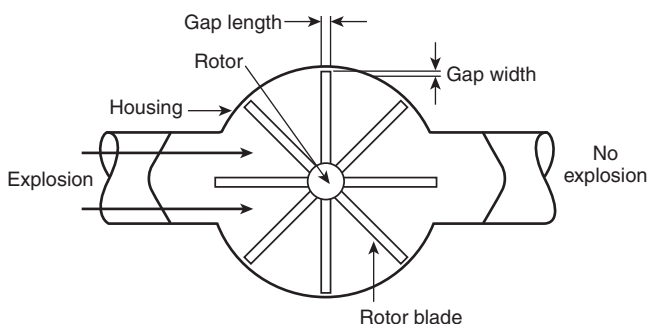


FIGURE A.12.2.4.1 Typical Rotary Valve.

- (3) Two vanes per side are always in contact with the housing.
- (4) The vanes or tips are made out of metal (no plastic vanes) and have a thickness of at least 3 mm (0.12 in.).
- (5) The effects of operating temperature on the vane and valve body clearance can negatively influence the efficacy of rotary valves as an explosion isolation device and should be jointly managed between the valve manufacturer and the system operator.

It is critical that this initial clearance be maintained in order for the explosion protection to function. Normal wear can cause these valves to become ineffective, allowing flame passage, and so preventive maintenance is necessary.

N A.12.2.4.5.1 See “New Knowledge About Rotary Air Locks in Preventing Dust Ignition Breakthrough” for information regarding required clearances to prevent propagation through rotary valves.

N A.12.2.4.5.3 At elevated temperatures, the clearance between the vanes and the valve body will be reduced by the expansion of the vanes. Depending upon ambient environmental conditions, the valve body might not reach the same temperature as the rotor and its vanes.

N A.12.2.4.5.4 Since the clearance between the vanes and the valve body will exceed 0.2 mm (0.008 in.) at ambient temperature, the rotary valve might not provide the required protection until the valve attains the intended operating temperature.

N A.12.2.4.5.6 When the valve is intended to operate at elevated temperatures, the clearance required when measured at ambient temperature is the clearance calculated in 12.2.4.5.3.

A.12.2.5 Flame arresters are specifically built for a variety of flame loads (deflagration, detonation, stabilized burning) and for substances of different reactivity (explosion groups), and they use different operating principles (quenching in gaps, gaseous counterflow, liquid seals).

A.12.2.5.2 Examples of flame arrester groups are shown in Figure A.12.2.5.2(a) through Figure A.12.2.5.2(c).

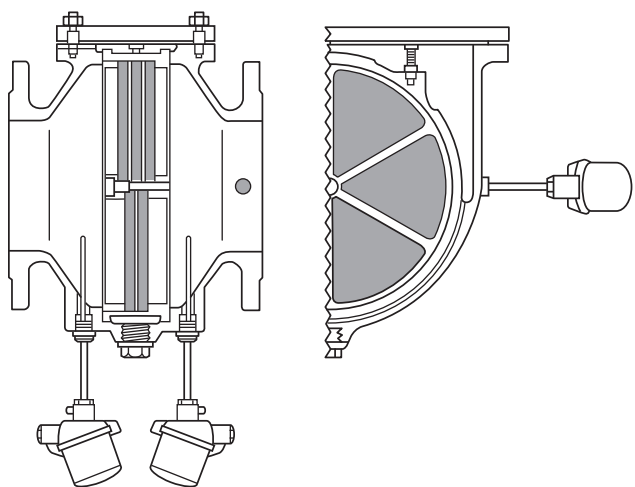


FIGURE A.12.2.5.2(a) In-Line Deflagration Arrester.

A.12.2.5.4 Flame arresters are frequently misapplied isolation devices, because of the lack of understanding of the test methods, limitations, and the number of types of flame arresting devices and applications. This material is intended to aid the user in identifying the process conditions that influence the choice of the appropriate flame arresting device. [See Figure A.12.2.5.4(a) and Figure A.12.2.5.4(b).]

A.12.2.5.4.5.2 The response time for shutoff must be limited, because simple shutoff also means that the filter elements are no longer cooled by convective heat transfer from flowing process vapors.

A.12.2.5.4.15 For explanation of what these forces might be, see Grossel, Section 6.5.

A.12.2.6 When an explosive mixture flows through a hydraulic arrester, it is separated into single isolated gas bubbles that rise

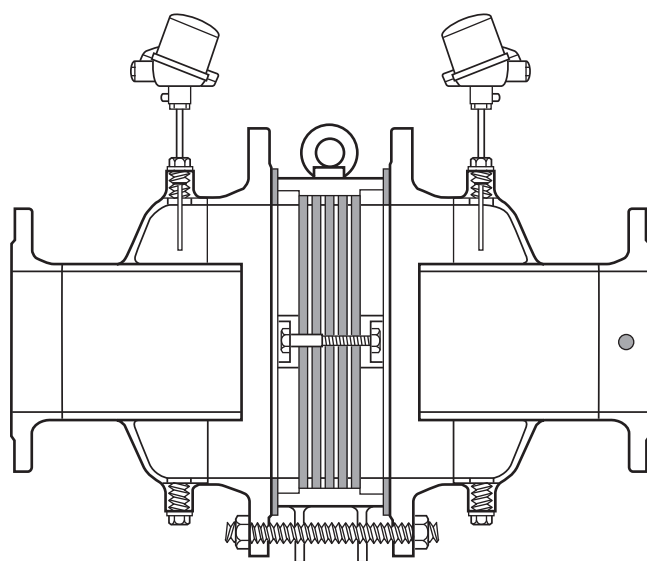


FIGURE A.12.2.5.2(b) In-Line Stable Detonation Arrester.

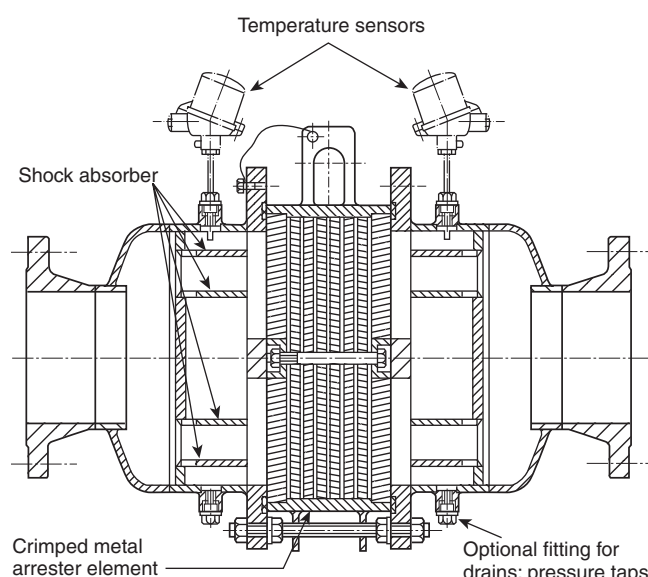


FIGURE A.12.2.5.2(c) In-Line Unstable Detonation Arrester.

due to buoyancy. Because of the formation of isolated bubbles, continuous channels for the passage of the igniting flame do not exist. If an ignition occurs on the side of the device where the single bubbles reach the surface of the liquid, flame propagation can be blocked. This is the usual direction when hydraulic arresters are applied. In the opposite case, that is, if ignition occurs at the upstream side, separation into single gas bubbles will still take place, but the efficiency of the protection will be low, since the combustion process can be transferred to the surface of the liquid. Whereas the action of a hydraulic arrester — the isolation of single gas volume elements — is clear, the mechanisms that enforce flame transmission under certain boundary conditions are considerably more difficult to understand. Up to now they have not been clarified in every detail. With the aid of extensive experiments Börger et al. determined the limits for the safe operation of hydraulic arresters in practice. Essential parameters here are the gas load (volume flow rate of gas per unit surface area of the liquid) and the depth of submersion (length of the bubble path). It was established that for a given reactivity of the mixture and a given depth, flame transmission always occurred beyond a critical volume flow rate per unit liquid surface area. This critical volume flow rate increases with increasing submersion depth of the device and decreasing reactivity of the explosible mixture. The mechanism of combustion propagation was investigated more thoroughly by Opholl. According to these investigations it seems to be important that the exploding single bubbles perform a sequence of damped vibrations, which lead on the formation of a gas jet, which can impinge on neighboring bubbles. This jet drags hot gases along and thus produces connections between the bubbles. The range of this effect increases with increasing reactivity of the gas. On the basis of the available investigations it cannot be excluded that direct ignition is also caused by the compression of neighboring bubbles.

There are some generic designs in common practice. Detailed design information is not available, and testing is recommended.

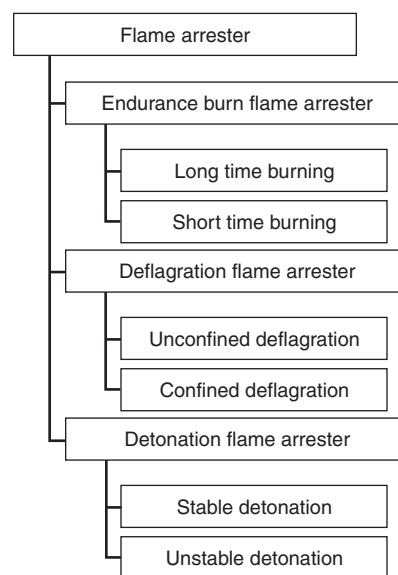


FIGURE A.12.2.5.4(a) Differentiating the Combustion Process.

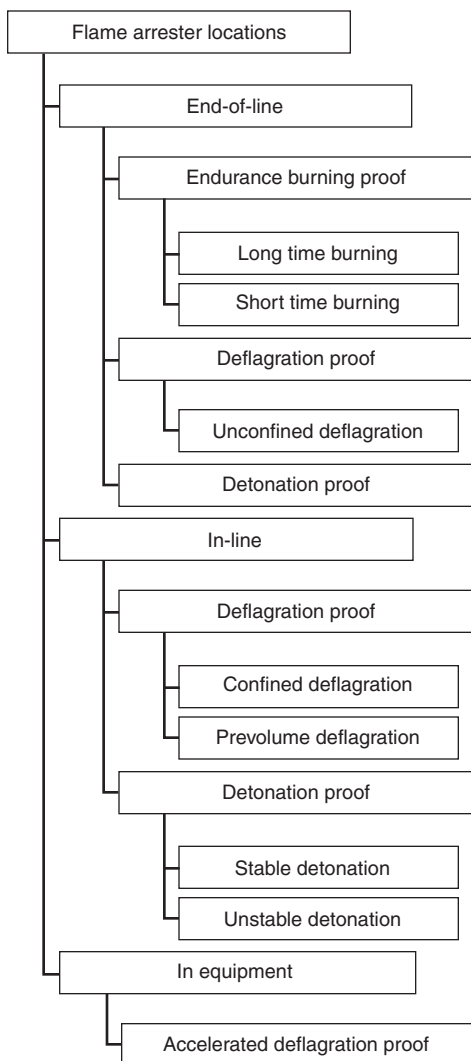


FIGURE A.12.2.5.4(b) Classification of Flame Arrester.

A.12.2.6.1 Typical hydraulic deflagration arrester designs are shown in Figure A.12.2.6.1(a) and Figure A.12.2.6.1(b).

A.12.2.6.3.10 For explanation of what these forces might be, see Grossel, Section 6.5.

A.12.2.6.3.25 It has to be ensured that enough liquid remains in the liquid seal so that the third explosion impact is prevented from transmission to the protected side.

A.12.2.7 Where flammable liquid transfer lines interconnect vessels, an empty line can present a path for flame propagation between the vessels, similar to manifolded vapor connections. With manifolded filling or emptying lines, often the main line remains liquid full, providing a seal against flame propagation. However, the location of this liquid seal could be some distance from the vessel, allowing a deflagration in a vessel to transition to detonation with increased damage potential. Liquid product detonation arresters can be located so as to limit affected piping.

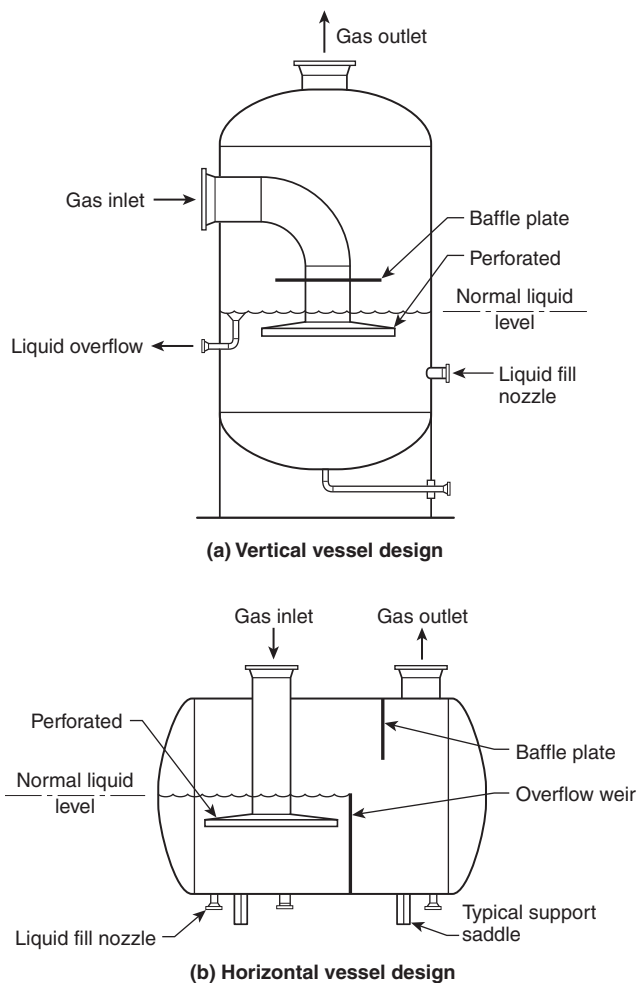


FIGURE A.12.2.6.1(a) Bubble Screen Hydraulic Flame Arrester.

In situations where the suction for a flammable liquid transfer pump is located below the pump, lowering liquid level in the suction vessel can result in vapors entering the pump, with a subsequent potential ignition. Often low level interlocks are provided to stop pumping before loss of sufficient level. A liquid product detonation arrester can be used to isolate a pump ignition source from the vessel.

A.12.2.7.1 Liquid product detonation flame arresters are installed within piping, which is filled with liquid (e.g., gasoline) during normal operation, or installed inside storage tanks. Typically they are applied to filling and emptying lines of interconnected storage tanks where there is a risk of the pipe line running empty and the liquid being replaced with potentially combustible product-air mixture. If ignited, a deflagration or detonation might develop, which can be stopped with this type of device. [See Figure A.12.2.7.1(a) through Figure A.12.2.7.1(c).]

A.12.2.7.1(1) Figure A.12.2.7.1(a) shows a liquid product arrester that can be applied to filling and emptying lines because it includes a siphon bypass to avoid liquid being sucked out of the detonation arrester.

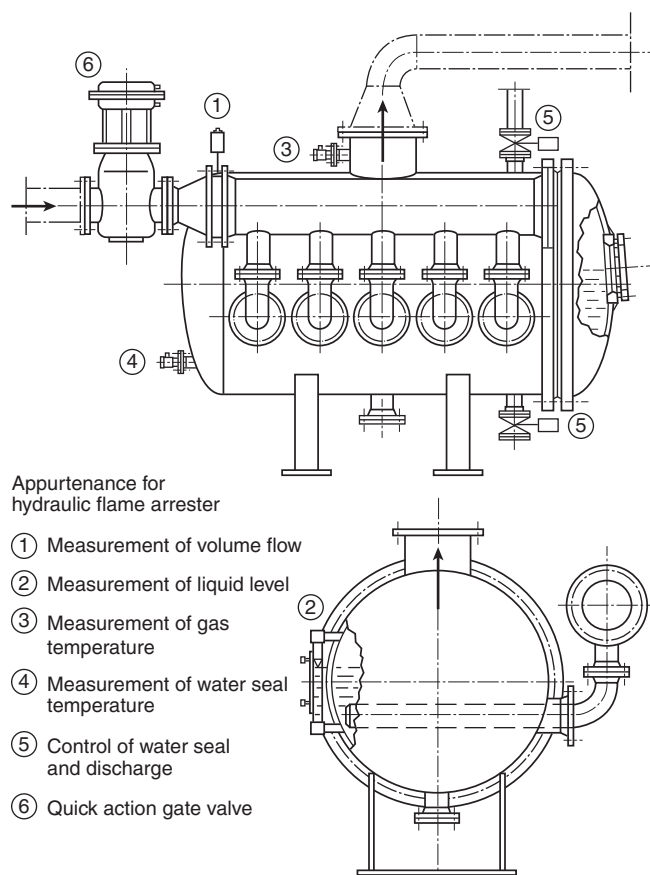


FIGURE A.12.2.6.1(b) Sparge Tube Hydraulic Arrester.

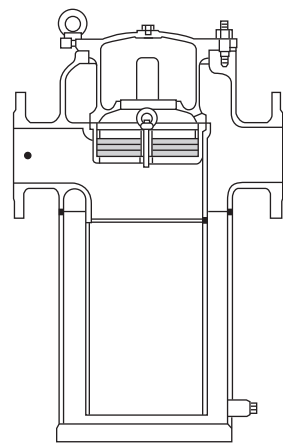


FIGURE A.12.2.7.1(a) Liquid Product Detonation Arrester with Siphon Bypass (Emptying and Filling Lines).

A.12.2.7.1(2) Figure A.12.2.7.1(b) shows a liquid product arrester that can only be applied to the filling line of a tank or vessel. Liquid can be pumped in only one direction through this device, because it does not have a bypass system installed.

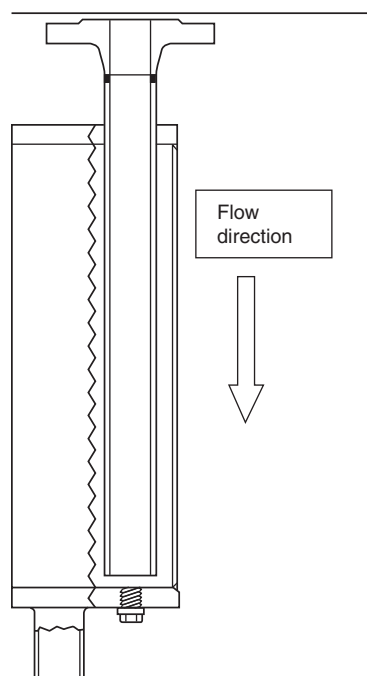


FIGURE A.12.2.7.1(b) Liquid Product Detonation Arrester Without Siphon Bypass (Filling Line Only).


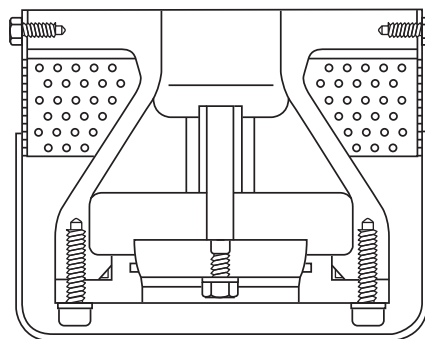



FIGURE A.12.2.7.1(c) Liquid Product Detonation Arrester with Foot Valve (Emptying Lines Only).

A.12.2.7.1(3) Figure A.12.2.7.1(c) shows a liquid product arrester with a foot valve, which is applied to suction lines. This device will also function if the valve pallet is in an open position due to the minimum height of liquid level in the suction basket. These valves are installed inside the tank above the tank bottom. In addition to stopping flame propagation, foot valves provide protection against backflow and maintain a suction seal for pump startup.


A.12.2.8 Dust flame-arresting devices are typically used in ductwork that is considered to be clean air or free of dust. Examples include, but are not limited to, recycled air lines from air material separators where combustible particulate solids are not present in concentrations above applicable industrial hygiene exposure limits or 1 percent of the minimum explosible concentration (MEC). Figure A.12.2.8(a) through Figure A.12.2.8(d) provide examples of dust flame-arresting devices.

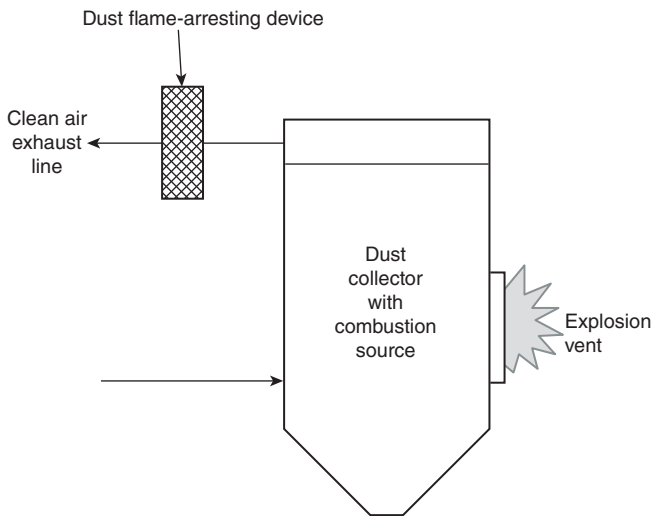


N FIGURE A.12.2.8(a) Typical Application of Dust Flame-Arresting Device.

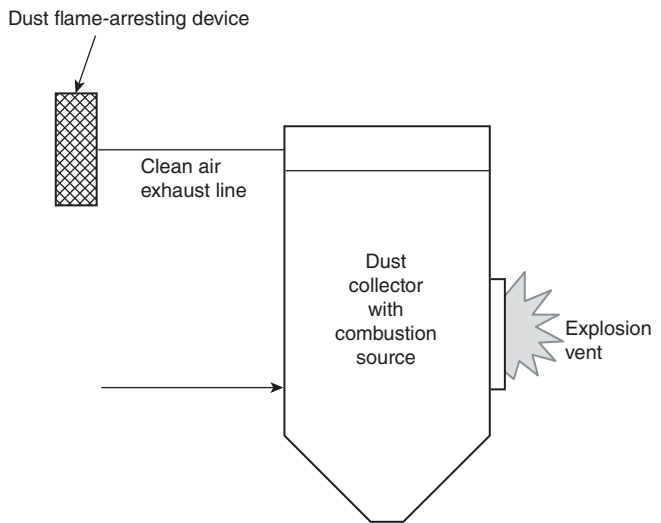

N FIGURE A.12.2.8(c) Typical End-of-Line Application of Dust Flame-Arresting Device.

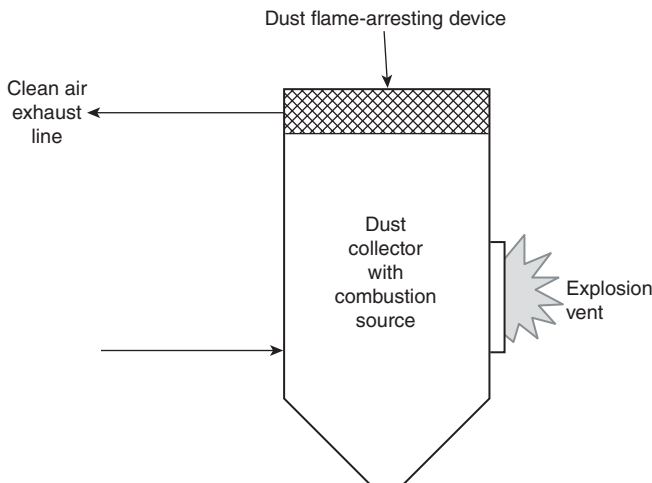

N FIGURE A.12.2.8(b) Typical Application of Dust Flame-Arresting Device Integrated into Clean Air Plenum.

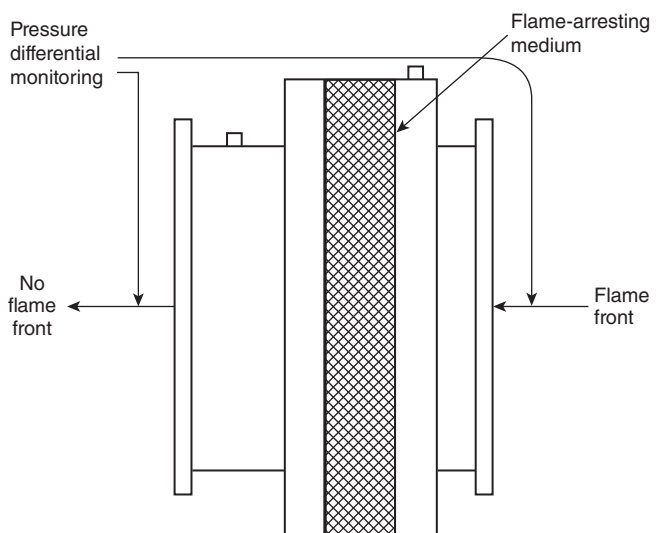

N FIGURE A.12.2.8(d) Dust Flame-Arresting Device.

N A.12.2.8.2.2 Signaling can be triggered by means such as pressure detection, radiant energy detection, temperature monitoring, explosion vent opening sensors, or inlet isolation device activation sensors.

N A.12.2.8.3.1(8) Certification should consider the type of dust, for example organic, melting, metal, or fibrous dusts. Different dust characteristics have an influence on the effectiveness of the flame-arresting medium.

A.13.1.5 Pressure piling and flame-jet ignition can significantly increase deflagration pressures in attached equipment. Techniques such as isolation or venting should be considered.

A.13.2.1 Deflagration pressure containment is not adequate for detonable systems because the maximum pressure rise is much greater than the factors established in 13.3.4.1 through 13.3.4.4. It should be recognized that some systems might be

capable of deflagration or detonation. For example, systems containing a substantial proportion of hydrogen are prone to detonation, as are systems containing acetylene or acetylenic compounds. Saturated organic compounds such as propane, ethane, and alcohols generally do not detonate in vessels but might do so in pipework. Internals in equipment can promote the transition from deflagration to detonation.

A.13.2.2 When two vessels connected by a large-diameter pipe both contain a combustible mixture, a deflagration in one vessel can precompress the unburned mixture in the other vessel. The maximum deflagration pressure that can be developed in the second vessel might be substantially greater than would normally happen in a single vessel. (See *Bartknecht*.) Guidance on explosion containment in linked vessels is given in Barton.

A.13.2.2(5) Only limited information is available for deflagration containment of systems with initial gauge pressures exceeding 2 bar (30 psi). Increased initial pressure might increase the potential for detonation. For this reason it is recommended that, for systems that might operate at an initial gauge pressure of 2 bar (30 psi) or higher, deflagration pressure containment should be used only where applicable test data are available. The testing should be carefully designed because the detonation potential of a system is affected by vessel dimensions.

A.13.3.4 When determining the P_{max} to contain the deflagration, the calculated minimum design value for P_{max} will be less than the actual peak pressure expected during the deflagration. Deflagration is a short-term pressure excursion, and this method is recognized in ASME *Boiler and Pressure Vessel Code*. The formulas are based on a paper by Noronha et al. See NFPA 68 for a more detailed description of the forces imposed during a deflagration.

A.13.3.4.1 The maximum deflagration pressures for several dusts can be found in Annex F of NFPA 68.

A.13.3.6 The maximum initial pressure depends on the origin of the pressure. In some cases, the maximum initial pressure is determined by the setting of a relief device on the system. In such cases, the maximum initial pressure is the sum of the relief device set pressure and the relief device accumulation pressure. Overpressure due to boiling of the vessel contents (for example, from external fire exposure) might raise the concentration of fuel in the vapor phase above its upper flammable limit and does not constitute a deflagration hazard.

A.14.1 The expanded metal mesh and polymer foams described in this chapter are intended for protection against internal deflagrations and are not intended for boiling liquid expanding vapor explosion (BLEVE) protection of liquefied gas storage tanks nor for emergency relief venting of flammable liquid storage tanks.

A.14.2.4.1 These requirements are taken from the range of densities in Table 1 of MIL-B-87162A (USAF), *Military Specification: Baffle Material, Explosion Suppression, Expanded Aluminum Mesh, for Aircraft Fuel Tanks*.

A.14.2.4.2.3 Where the application range is based on the fundamental burning velocity of the protected mixture, the same test method should be used to compare the burning velocity of the subject mixture to that of near-stoichiometric propane-air. In the case of a metal mesh made by expanding slit foil and then fan-folding the expanded metal into batts, the surface area per unit expanded foam volume is equal to

[A.14.2.4.2.3]

$$2 \left(\frac{w_s \cdot n \cdot l_s}{W \cdot H \cdot l_f} \right) = 2 \left(\frac{w_s \cdot L_0}{W \cdot l_f \cdot H} \right)$$

where:

w_s = slit foil width

n = number of layers in a batt of height H

l_s = length of unexpanded slit foil required to produce an expanded length l_f between folds

W = expanded foil width

H = height

l_f = expanded length between folds

L_0 = unexpanded length of foil in a batt

(from Szego, A., Premji, K., and Appleyard, R., *Evaluation of Explosafe Explosion Suppression System for Aircraft Fuel Tank Protection*.)

A.14.2.4.3 In the case of metal mesh made from expanded slit foil, the pore size is approximately equal to the foil spacing between slits.

A.14.2.4.4 In the case of aluminum foil mesh, the alloy composition should be specified per Aluminum Association standards (for example, composition designations 3003 or 3010). In the case of chromate coatings, MIL-C-5541, *Chemical Conversion Coatings on Aluminum and Aluminum Alloys*, would be applicable.

A.14.2.5 This material is taken from the reference for required densities found in Table 1 of MIL-DTL-83054C, *Detailed Specification Baffle and Inerting Material, Aircraft Fuel Tank*.

A.14.2.5.1 The specifications for the minimum numbers of pores are for applications involving alkanes or flammable gases and vapors with fundamental burning velocities within 15 percent of the near-stoichiometric propane-air burning velocity.

A.14.2.5.5.2 The maximum resistivity value required in 14.2.5.5.2 has been achieved and surpassed using conductive reticulated polyurethane foams described in SAE AIR 4170A, "Reticulated Polyurethane Foam Explosion Suppression Material for Fuel Systems and Dry Bays." This reference also describes the advantages of the conductive foam in eliminating electrostatic ignitions that the US Air Force was experiencing in certain aircraft equipped with higher resistivity polymer foams. If electrostatic charge generation mechanisms, such as direct fuel impingement onto the foam, can be avoided, the conductive foams might not be necessary.

A.14.3.3 Figure A.14.3.3 shows a diagram of a test vessel with a void volume, V_c , and mesh- or foam-filled (arrestor) volume, V_a .

A.14.3.7 A diagram of the double void explosion suppression test setup is shown in Figure A.14.3.7. The ignition void fraction, $V_c / (V_c + V_a + V_v)$, is typically 0.20.

A.14.4.1 For example, the value of P_{red} shown in SAE AIR4170A for fine pore blue polyether foam at an initial pressure of 3 psia (21 kPa) is about 11 psia (76 kPa) for propane-air explosion testing with a 20 percent single void volume. This foam can be installed only in enclosures with either an ultimate strength or yield pressure of at least 17 psia (117 kPa).

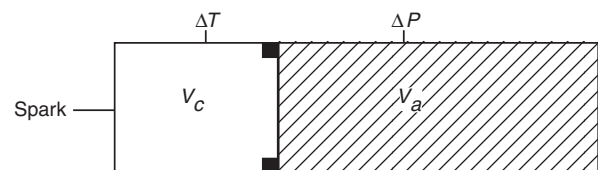


FIGURE A.14.3.3 Single Void Explosion Suppression Test Setup (MIL-PRF-87260B).



FIGURE A.14.3.7 Double Void Explosion Suppression Test Setup (MIL-PRF-87260B).

A.14.4.2 The number of mesh or foam blocks used during installation should be minimized. Voids between mesh or foam blocks should not be co-linear in order to avoid the potential for direct line flame propagation between multiple blocks. Compression of the mesh or foam during installation should also be minimized.

Installation guidelines for mesh or foam in aircraft fuel tanks and dry bays are given in SAE AIR4170A, "Reticulated Polyurethane Foam Explosion Suppression Material for Fuel Systems and Dry Bays."

A.15.4.1 Suppressant storage containers, automatic fast-acting valves, flame front diverters, or flame arresters should be supported by other than the protected process, ductwork, or piping as determined by engineering review. Reinforcing pads, external mounts, or other means to redistribute the reaction forces of the explosion prevention device should be implemented. It is not intended or expected that the protection equipment be supported by the process equipment. External support might be required in order for the explosion prevention system to operate properly. Detection devices should be mounted such that product impingement will be minimized. Suppressant containers should be located such that discharge is not directed toward process openings where employees might be present.

■ A.15.5.5.1 The capability of the explosion prevention or protection system to produce the desired result is addressed by the documentation and certification requirements in the relevant design chapters of this standard.

■ A.15.5.5.1.1 For equivalence outside of the United States, see IEC 61508, *Functional safety of electrical/electronic/programmable electronic safety-related systems*; IEC 61511, *Functional safety: Safety instrumented systems for the process industry sector*; or country-specific equivalent. The default requirement for SIL-2 is consistent with the minimum reliability expectation of many currently manufactured systems and components, based upon the typical design capability of the SIS or components. The requirement also represents a minimum reliability expectation of at least some users of explosion prevention systems. However, some situations can require greater or lesser protection than a SIL-2 design. The risk evaluation is the means of establishing the minimum required reliability for a specific application of an explosion prevention or protection system.

■ A.15.5.5.1.2 The requirements for SIL capability pertain only to the safety logic solver, sensors, and final elements that are included in the scope of the safety requirements specification (SRS) document (see ANSI/ISA 61511, *Functional Safety: Safety Instrumented Systems for the Process Industry Sector*). The purpose of the SIL capability requirement is to provide control reliability.

■ A.15.5.5.1.3(1) Compliance with the manufacturer's safety manual would achieve actions such as, but not limited to, the SIS detecting the following:

- (1) Failure to execute any program or task containing safety logic
- (2) Failure to communicate with any safety I/O
- (3) Changes in software set points of safety functions
- (4) Failure of outputs related to safety functions
- (5) Failure of timing effects related to safety functions

A.15.5.5.2 Initiating device circuits, notification appliance circuits, and signaling line circuits shall be permitted to be designated as either Class A or Class B, depending on their performance during non-simultaneous single circuit fault conditions as specified by the following conditions:

- (1) Initiating device circuits and signaling line circuits that transmit an alarm or supervisor signal, or notification appliance circuits that allow all connected devices to operate during a single open or a non-simultaneous single ground fault on any circuit conductor, should be designated as Class A.
- (2) Initiating device circuits and signaling line circuits that do not transmit an alarm or supervisory signal, or notification appliance circuits that do not allow connected devices to operate beyond the location of a single open or a non-simultaneous single ground fault on any circuit conductor, should be designated as Class B.

■ A.15.7.1.2 Some passive devices will only require inspection, and depending on the process-specific conditions, the inspection intervals can be extended beyond the 3 months.

A.15.7.1.5 The frequency depends on the environmental and service conditions to which the devices are to be exposed. Process or occupancy changes that can introduce significant changes in condition, such as changes in the severity of corrosive conditions or increases in the accumulation of deposits or debris, can necessitate more frequent inspection. It is recommended that an inspection be conducted after a process maintenance turnaround. Inspections should also be conducted following any natural event that can adversely affect the operation (e.g., hurricanes or snow and ice accumulations).

A.15.7.1.8.1 Before starting maintenance, always make sure that any process environmental conditions such as gas-air mixtures or vapor-air mixtures are not dangerous to health.

A.15.7.1.9 See Figure A.15.7.1.9.

A.15.8.1 Corrective process and protection system actions by the owner or operator, and refurbishment of the explosion prevention system, should be completed by personnel authorized by the manufacturer. Corrective actions should be implemented before the process is returned to service.

NFPA 69 EXPLOSION PREVENTION SYSTEMS QUARTERLY INSPECTION FORM

User Contact Information

Company name _____

Date inspected _____ Start time _____

Address _____

City _____ State _____ Zip code _____ Telephone _____

Inspector's name _____

Inspection company _____

Address _____

City _____ State _____ Zip code _____ Telephone _____

Explosion prevention system protecting _____

Explosion prevention system ID # _____

Explosion prevention system location _____

Explosion prevention system manufacturer _____

Follow the manufacturer's recommendations and the following:

Regarding the explosion prevention system:

- | | |
|--|--|
| <p>(1) Has the process and processed material changed since last inspection? ☐ Yes ☐ No</p> <p>(2) Has the system been properly installed in accordance with this document and manufacturer's instructions? ☐ Yes ☐ No</p> <p>(3) Have the system components corroded or mechanically damaged? ☐ Yes ☐ No</p> <p>(4) Are the user operation instructions provided near the control unit? ☐ Yes ☐ No</p> <p>(5) Are the system components clearly labeled as an explosion prevention device? ☐ Yes ☐ No</p> <p>(6) Are the system components protected from the process and acts of nature? ☐ Yes ☐ No</p> <p>(7) Are the system components painted or coated other than by the original equipment manufacturer? ☐ Yes ☐ No</p> <p>(8) Do the system components have buildup of deposits on the inside surfaces of discharge nozzles or detection surfaces? ☐ Yes ☐ No</p> <p>(9) Have the system components been changed, altered, or tampered with? ☐ Yes ☐ No</p> <p>(10) Is the system component mounting condition deteriorating (e.g., cracked welds, missing bolts)? ☐ Yes ☐ No</p> <p>(11) Has the system discharged/actuated? ☐ Yes ☐ No</p> | <p>(12) Are the system seals, tamper indicators, or discharge indicators, if provided, in place and functioning? ☐ Yes ☐ No</p> <p>(13) Does the control unit function according to design requirements and are all circuits properly supervised? ☐ Yes ☐ No</p> <p>(14) Is the system control unit indicating any faults? ☐ Yes ☐ No</p> <p>(15) Are the system sensing devices calibrated and functioning according to design requirements? ☐ Yes ☐ No</p> <p>(16) Are the system suppressors and valve actuators pressurized to specifications? ☐ Yes ☐ No</p> <p>(17) Are the system interlocks verified for proper sequence and functioning? ☐ Yes ☐ No</p> <p>(18) Is the plant fire notification verified? ☐ Yes ☐ No</p> <p>(19) Is the system sequence of operation verified? ☐ Yes ☐ No</p> <p>(20) Are the components correctly located as the system drawings indicate? ☐ Yes ☐ No</p> <p>(21) Are the components clear of obstructions and accessible? ☐ Yes ☐ No</p> <p>(22) Is the system clearly tagged or labeled with manufacturer's information? ☐ Yes ☐ No</p> <p>(23) Is the system showing process material buildup or deposits? ☐ Yes ☐ No</p> <p>(24) Are the fasteners and mounting hardware in place? ☐ Yes ☐ No</p> |
|--|--|

NFPA 69 (p. 1 of 4)

▲ FIGURE A.15.7.1.9 Explosion Prevention Systems Quarterly Inspection Form.

Note: Visual inspection includes check for dents, abrasion, corrosion, leaks, and obstruction.

[illegible]

Δ FIGURE A.15.7.1.9 *Continued*

Note: Visual inspection includes check for dents, abrasion, corrosion, leaks, and obstruction.

[illegible]

Δ FIGURE A.15.7.1.9 *Continued*

NFPA 69 (p. 4 of 4)

Δ FIGURE A.15.7.1.9 *Continued*

A.15.8.2 The causes of explosion prevention system actuations are often difficult to determine. The cause might be traced to a deflagration or might have resulted from an inadvertent effect. Assistance of factory-trained personnel from the explosion prevention system manufacturer is recommended. The investigation might include duplicating process pressure conditions and the effects of process changes such as fan speeds, valve actions, etc. Particular attention should be paid to any service or maintenance work or programming changes on the process control software. Best practice for such an investigation and review might include any or all of the following elements:

- (1) Recording all process operating data at the time of the actuation and noting if any process upsets had recently occurred
- (2) Recording the status of the explosion prevention control systems
- (3) Recording the status and condition of the process safety interlocks
- (4) Capturing history data from the explosion prevention control system if available
- (5) Recording statements and observations from personnel in the area of the event
- (6) Photographing the area in and around the event location and collecting samples of the material in process at the time of actuation for analysis if the actuation cause cannot be determined
- (7) Recording weather conditions at the time of actuation
- (8) Posting discharge communication with management and the explosion prevention system supplier or maintainer, to coordinate refurbishment and inspection of the explosion prevention system

A.15.11.3 It is recommended that changes be reviewed with life safety system and equipment suppliers.

Annex B Control of Flammable Gas Mixtures by Oxidant Concentration Reduction and Combustible Concentration Reduction

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

B.1 General. As covered in Chapters 7 and 8, a flammable gas-oxidant mixture might be controlled by reducing the concentration of oxidant or by adding an inert constituent to the mixture. Both processes can be explained most easily by referring to a flammability diagram. Figure B.1 shows a typical flammability diagram that represents a mixture of a combustible gas; an inert gas, nitrogen; and an oxidant, oxygen, at a given temperature and pressure.

A mixture of air (79 percent N_2 and 21 percent O_2 , by volume) and combustible gas is represented by the line formed by points *DABE*. A given mixture of the combustible gas and air, whether ignitable or not, is specified by a point on this line. Point *A* indicates the upper flammable limit of this mixture, and point *B* represents its lower flammable limit.

Any point within the area bounded by *FBCAGF* is in the flammable range and can be ignited. Any point outside this area represents a mixture that cannot be ignited. Point *C* represents the limiting oxidant concentration to prevent ignition; any mixture containing less oxygen cannot be ignited. (See Annex C.)

Any mixture of oxygen and combustible gas alone (i.e., without nitrogen) is represented by the left side of the triangle. Any mixture of nitrogen and combustible gas alone (i.e., without oxygen) is represented by the right side of the triangle.

B.2 Effect of Pressure and Temperature. As shown in Figure B.2, pressure and temperature can have an effect on the flammability diagram. An increase in pressure results in an increase in the upper flammable limit and a decrease in the limiting oxidant concentration points *C*, *C'*, and *C''*, to prevent ignition. There is a slight decrease on the lower flammable limit, but the effect is not as pronounced as that of the upper limit.

An increase in temperature has a similar effect on the flammability diagram.

The exact effects on a system produced by changes in pressure or temperature should be determined for each system.

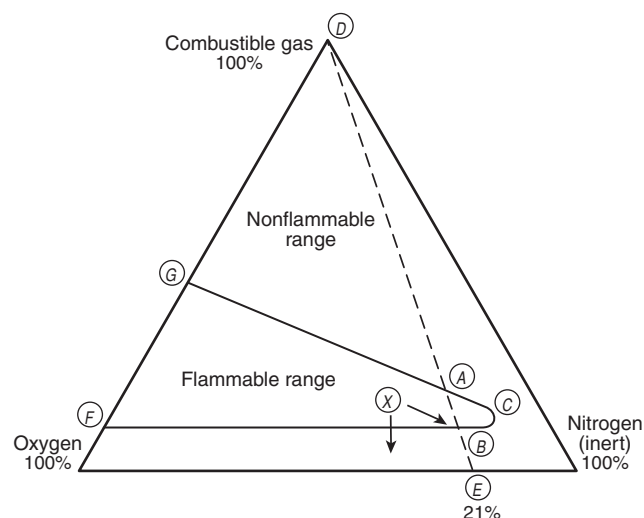


FIGURE B.1 Typical Flammability Diagram.

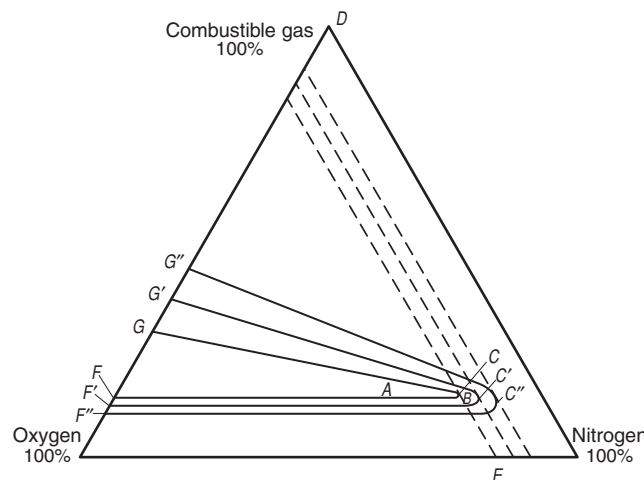


FIGURE B.2 Effect of Pressure on Flammability Diagram.

B.3 Effect of Inert Diluents. The addition of an inert diluent to a mixture of combustible material and oxidant affects the lower and upper flammable limits and the limiting oxidant concentration. Figure B.3 illustrates the effect of some typical diluents on the flammability limits of methane. Figure B.3 shows that nitrogen is more effective than helium and that carbon dioxide is more effective than nitrogen.

B.4 Oxidant Concentration Reduction. In Figure B.1, point X represents an arbitrary mixture of flammable gas, oxygen, and nitrogen that lies well within the flammable range. If the composition of the mixture is to be changed so that it lies outside the flammable range, one method that can be used is to reduce the concentration of oxidant. As the concentration of oxygen decreases, the concentration of nitrogen increases. Point X, in effect, moves toward the inert gas apex.

B.5 Combustible Concentration Reduction. In Figure B.1, with point X in the flammable range, the composition of the mixture might be altered by reducing the concentration of flammable gas. In simpler terms, point X moves away from the flammable gas apex and eventually drops below the lower flammability line *FBC*.

B.6 Mixtures of Gases. Where mixtures of two or more flammable gases are encountered, the limits of flammability of the mixture can often be reliably predicted by using the following formulas suggested by Le Chatelier:

[B.6a]

$$\text{LFL} = \frac{P_1 + P_2 + \dots + P_n}{\frac{P_1}{\text{LFL}_1} + \frac{P_2}{\text{LFL}_2} + \dots + \frac{P_n}{\text{LFL}_n}}$$

[B.6b]

$$\text{UFL} = \frac{P_1 + P_2 + \dots + P_n}{\frac{P_1}{\text{UFL}_1} + \frac{P_2}{\text{UFL}_2} + \dots + \frac{P_n}{\text{UFL}_n}}$$

where:

LFL = lower flammable limit

$P_1 \dots P_n$ = volume fractions of components 1, 2, 3, ..., n of the mixture

$\text{LFL}_1 \dots \text{LFL}_n$ = lower flammable limits of components 1, 2, 3, ..., n of the mixture

UFL = upper flammable limit

$\text{UFL}_1 \dots \text{UFL}_n$ = upper flammable limits of components 1, 2, 3, ..., n of the mixture

B.7 Flammable Limits of Fuel/Diluent Mixtures. A number of estimation methods have been proposed for diluted mixtures with varying success. None of these methods should be considered appropriate for unstable materials or oxygen-enriched atmospheres. Where flammable limits of the fuel components are known by test, the thermal balance method of Ma (2011) first derives a heating factor, H_p , and a quenching factor, Q_p , from the flammable limits for each component and then uses a molar average of these two factors to estimate the flammable limits of the mixture. For fuel-only mixtures, this method is equivalent to Le Chatelier's method and has the same limitations with respect to mixtures having widely varying adiabatic flame temperatures (ADTs). Diluents are treated as fuels without a heating factor using a molar ratio, R , of diluent

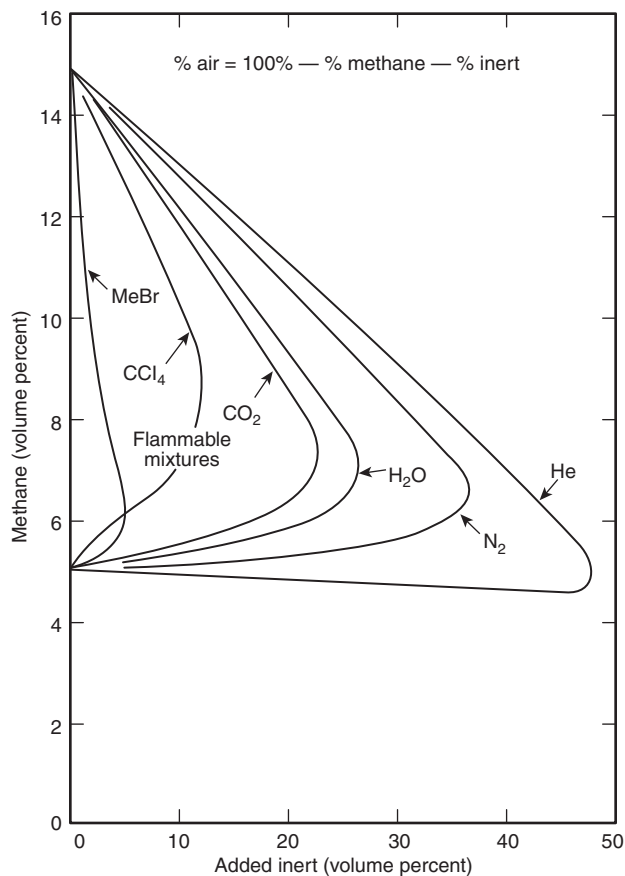


FIGURE B.3 Limits of Flammability of Methane-Inert Gas-Air Mixtures at 25°C (77°F) and Atmospheric Pressure. (Source: US Bureau of Mines Bulletin 503, "Limits of Flammability of Gases and Vapors.")

to fuel. The estimated flammable limits, X_L and X_U , apply to the diluted mixture.

B.7.1 Derivation of Heating and Quenching Factors for a Fuel Component. A thermal balance of heating and quenching potentials is established for a fuel component, according to the following two equations where the heating factor, H_p , is equal to the stoichiometric amount of oxygen consumed by combustion, C_o , multiplied by the heat of oxidation specific to the fuel, H_o . Q_F is the fuel quenching factor relative to air. The first equation is at the lower flammable limit where the amount of fuel controls the limit, and the second equation is at the upper flammable limit where the amount of oxygen controls the limit. In both equations the second term on the left-hand side is the quenching effect of heating the combustion air. The factor 4.773 is the inverse of 0.2095, the mole fraction of oxygen in air.

[B.7.1a]

$$x_L Q_F + (1 - x_L) = x_L H_F = x_L C_o H_o$$

[B.7.1b]

$$x_U Q_f + (1 - x_U) = \frac{(1 - x_U)}{4.773} H_o$$

A simultaneous solution of Equations B.7.1a and B.7.1b, for fuel components with known LFL and UFL, results in heating factors and quenching factors, as in Equations B.7.1c and B.7.1d.

[B.7.1c]

$$H_o = \frac{x_U - x_L}{C_o x_U x_L - \frac{(1 - x_U) x_L}{4.773}}$$

[B.7.1d]

$$Q_f = 1 - \frac{1}{x_L} + C_o H_o$$

B.7.2 Derivation of LFL and UFL for a Fuel-Only Mixture.

For fuel-only mixtures, the component concentrations are identified as $z_{F,i}$. More typically these would be indicated as y_i , since the materials are in gas phase. Fuel mixture heating and quenching factors are determined as molar averages of the fuel components, as in Equations B.7.2a through B.7.2d.

[B.7.2a]

$$C_{O,mix} = \frac{\sum_i (z_{F,i} C_{O,i})}{\sum_i z_{F,i}}$$

[B.7.2b]

$$H_{F,mix} = \frac{\sum_i (z_{F,i} H_{F,i})}{\sum_i z_{F,i}} = \frac{\sum_i (z_{F,i} C_{O,i} H_{O,i})}{\sum_i z_{F,i}}$$

[B.7.2c]

$$H_{O,mix} = \frac{H_{F,mix}}{C_{O,mix}}$$

[B.7.2d]

$$Q_{F,mix} = \frac{\sum_i (z_{F,i} Q_{F,i})}{\sum_i z_{F,i}}$$

For a fuel-only mix, the upper and lower flammability limits are as in Equations B.7.2e and B.7.2f:

[B.7.2e]

$$x_{L, fuel mix} = \frac{1}{1 + H_{F,mix} - Q_{F,mix}}$$

[B.7.2f]

$$x_{u, fuel mix} = \frac{(H_{o,mix}/4.773) - 1}{(H_{o,mix}/4.773 - 1 + Q_{F,mix})}$$

B.7.2.1 Example of the Estimation of a Fuel Mixture LFL and UFL. For a mixture of three fuel components, as in Table B.7.2.1, the flammable limits are estimated using both Le Chatelier's method as in B.6 and the thermal balance method of Ma. LFL and UFL data are from NFPA 497. The calculations are shown following the table with more than appropriate significant digits to illustrate the minor differences.

For Le Chatelier's method:

[B.7.2.1a]

$$\begin{aligned} LFL &= \frac{0.635}{\frac{0.635}{2.0} + \frac{0.208}{3.3} + \frac{0.157}{1.1}} \\ &= 1.9111 \text{ vol\%} \end{aligned}$$

[B.7.2.1b]

$$\begin{aligned} UFL &= \frac{0.635}{\frac{0.635}{11.5} + \frac{0.208}{19.0} + \frac{0.157}{7.1}} \\ &= 11.328 \text{ vol\%} \end{aligned}$$

For Ma's method, illustrating the evaluation of H_o and Q_f for ethyl acetate:

[B.7.2.1c]

$$\begin{aligned} H_o &= \frac{0.115 - 0.020}{(5)(0.115)(0.020) - \frac{(1 - 0.115)(0.020)}{4.773}} \\ &= 12.1926 \end{aligned}$$

[B.7.2.1d]

$$\begin{aligned} Q_f &= 1 - \frac{1}{0.020} + (5)(12.1926) \\ &= 11.9628 \end{aligned}$$

For Ma's method, illustrating the evaluation of the mixture stoichiometric ratio, heating factor, heat of oxidation, and quenching factor:

$$C_{O,mix} = \frac{0.635(5) + 0.208(3) + 0.157(9)}{0.635 + 0.208 + 0.157} = 5.212 \quad [\text{B.7.2.1e}]$$

$$H_{F,mix} = \frac{0.635(60.9628) + 0.208(35.6555) + 0.157(110.4747)}{0.635 + 0.208 + 0.157} = 63.4722 \quad [\text{B.7.2.1f}]$$

$$H_{O,mix} = \frac{63.4722}{5.212} = 12.1781 \quad [\text{B.7.2.1g}]$$

$$Q_{F,mix} = \frac{0.635(11.9628) + 0.208(6.3525) + 0.157(20.5656)}{0.635 + 0.208 + 0.157} = 12.1465 \quad [\text{B.7.2.1h}]$$

Finally, for Ma's method:

$$x_{L,fuel\ mix} = \frac{1}{1 + 63.4722 - 12.1465} = 0.019111 = 1.9111\ vol\% \quad [\text{B.7.2.1i}]$$

$$x_{U,fuel\ mix} = \frac{(12.1781/4.773) - 1}{(12.1781/4.773) - 1 + 12.1465} = 0.11326 = 11.326\ vol\% \quad [\text{B.7.2.1j}]$$

B.7.3 Derivation of LFL and UFL for a Single Fuel–Single Diluent Mixture. For a single fuel and single diluent, the fuel is Z_F and the diluent is Z_D . At the lower limit, these are $Z_{F,L}$ and $Z_{D,L}$ and at the upper limit $Z_{F,U}$ and $Z_{D,U}$. The fuel-only thermal balance equations are modified as in Equations B.7.3a and B.7.3b. The third term on the left-hand side is again the quenching effect of heating the combustion air.

$$z_{F,L}Q_F + z_{D,L}Q_D + (1 - z_{F,L} - z_{D,L}) = z_{F,L}H_F \quad [\text{B.7.3a}]$$

$$z_{F,U}Q_F + z_{D,U}Q_D + (1 - z_{F,U} - z_{D,U}) = \frac{(1 - z_{F,U} - z_{D,U})}{4.773}H_O \quad [\text{B.7.3b}]$$

The quenching factor for the diluent, Q_D , is the ratio of the enthalpy change for the diluent, divided by that for air, over the range from ambient to the AFT at the corresponding lower or upper flammable limit. The AFTs at the LFL and UFL are lower than that at the stoichiometric concentration. Depending on the chosen flame temperature, the quenching factor can vary. Table B.7.3 shows quenching factors for a number of common diluents as well as air and CCl_4 . The factors are slightly different than those in Ma (2011) and were developed based on the enthalpy change associated with increasing the temperature from 298 K to the listed AFT, using a Peng-Robinson equation of state.

In the table, one gas (CO_2) is listed with a quenching factor somewhat larger than determined by the enthalpy ratio. Senecal (2005) determined in suppression tests that CO_2 was on the order of 9 percent more effective than anticipated, and the quenching potentials for CO_2 are modified to be 9 percent larger, thus 1.75 at AFT of 1600 K. For hydrocarbon fuel mixtures, assuming an AFT of 1600 K is appropriate.

Equations B.7.3a and B.7.3b are more readily solved if the mole fraction of diluent is replaced with a ratio, R , to the fuel and the sum of z_F and z_D is recognized to be the total concentration of the diluted fuel mixture at the flammable limits.

Table B.7.2.1 Estimation of Flammable Limits of a Fuel Mixture

Fuel	$Z_{F,i}$	LFL vol %	UFL vol %	C_o	H_o	H_F	Q_F
Ethyl Acetate	0.635	2.0	11.5	5	12.1926	60.9628	11.9628
Ethanol	0.208	3.3	19.0	3	11.8852	35.6555	6.3525
Toluene	0.157	1.1	7.1	9	12.2750	110.4747	20.5656
Mixture Molar Averages				5.212	12.1781	63.4722	12.1465
Mixture Flammability Limits		Le Chatelier		Ma			
LFL vol%		1.9111		1.9111			
UFL vol%		11.328		11.326			

$$R = \frac{z_{D,L}}{z_{F,L}} = \frac{z_{D,U}}{z_{F,U}} \quad [\text{B.7.3c}]$$

$$z_{F,L} + z_{D,L} = x_L \text{ and } z_{F,U} + z_{D,U} = x_U \quad [\text{B.7.3d}]$$

This leads to relations for z_F and z_D , shown below at the lower limit:

$$z_{F,L} = \frac{x_L}{1+R} \quad [\text{B.7.3e}]$$

$$z_{D,L} = \frac{Rx_L}{1+R} \quad [\text{B.7.3f}]$$

The fuel mole fractions are summed, as are the diluent mole fractions:

$$z_F = \sum_i z_{F,i} \quad [\text{B.7.3g}]$$

$$z_D = \sum_i z_{D,i} \quad [\text{B.7.3h}]$$

Where there is more than a single fuel component, the fuel-mixture properties are first evaluated based on molar averages, as in B.7.2. Similarly where there is more than a single diluent, the quenching factor for multiple diluents is first evaluated based on molar averages, as in Equation B.7.3i.

$$Q_{D,mix} = \frac{\sum_i (z_{D,i} Q_{D,i})}{\sum_i z_{D,i}} \quad [\text{B.7.3i}]$$

Substituting the above relations into Equations B.7.3a and B.7.3b gives the diluted mixture LFL and UFL in Equations B.7.3j and B.7.3k.

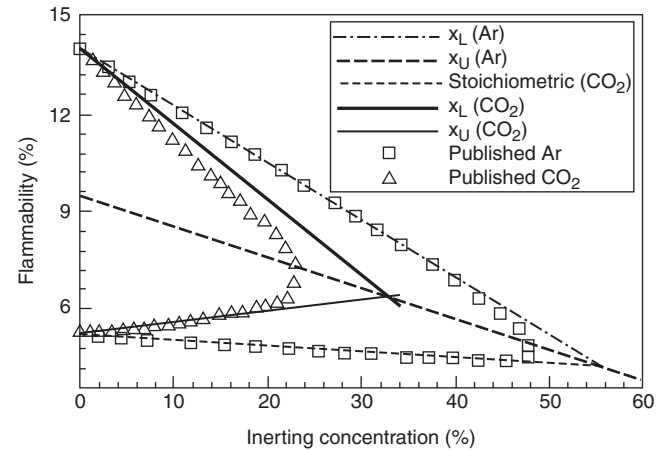


FIGURE B.7.3 Methane with Argon or CO₂ Diluent [Ma (2011), Figure 5(a)].

$$x_{L,diluted\ mix} = \frac{1}{1 + \left(\frac{H_{F,mix}}{1+R}\right) - \left(\frac{Q_{F,mix}}{1+R}\right) - \left(\frac{RQ_{D,mix}}{1+R}\right)} \quad [\text{B.7.3j}]$$

$$x_{U,diluted\ mix} = \frac{(H_{O,mix}/4.773 - 1)}{(H_{O,mix}/4.773 - 1) + \left(\frac{Q_{F,mix}}{1+R}\right) + \left(\frac{RQ_{D,mix}}{1+R}\right)} \quad [\text{B.7.3k}]$$

This method does not predict the typical nose of a flammability curve, but instead models two straight lines intersecting at the stoichiometric oxidant concentration, as in Figure B.7.3 for methane with argon or CO₂ diluent. Ma (2011) provides options to refine the estimation of limits near the nose.

Evaluating the two limits separately can result in predicted UFL less than predicted LFL. When the predicted LFL and UFL are equal, this is the limit of the calculation, as seen in Figure B.7.3, and the mixture can conservatively be considered noncombustible.

Table B.7.3 Quenching Factors for Some Gaseous Diluents

AFT (K)	Air	He	Ar	N ₂	O ₂	CO ₂	H ₂ O	CCl ₄
1300	1.000	0.658	0.658	0.995	1.053	1.726	1.233	3.200
1600	1.000	0.643	0.643	0.996	1.052	1.751	1.259	3.166
1850	1.000	0.633	0.633	0.996	1.050	1.765	1.282	3.138

B.7.3.1 Example of the Estimation of a Diluted Methane Mixture LFL and UFL. For a mixture of methane with various single diluents, Table B.7.3.1 lists the diluent ratio and the concentration of methane and diluents at the mixture LFL and UFL. Only the pure fuel limits and the intersection of the LFL curve with the UFL curve are necessary to construct the straight-line diagram.

B.7.3.2 Comparison to Figure B.3. The methodology of Ma can be used to develop a comparison to the data of Bureau of Mines Bulletin 503, shown in Figure B.3. With the above recommended quench factors, the method follows the trend of Figure B.3, as in Figure B.7.3.2, and is generally conservative with predicted LFL lower and UFL higher than the data.

B.7.4 Other methods have been proposed by Kondo (2006) and Kondo (2008).

B.8 Limiting Oxygen Concentration for Fuel Mixtures. See Britton et al., (2016) [1] for additional information.

The limiting oxidant concentration (LOC) for a fuel mixture can be estimated based on the relationship that the LOC is approximately equal to the LFL multiplied by the stoichiometric oxygen ratio, S . This approximation is usually conservative because it assumes the LOC occurs at the LFL concentration of the fuel.

Two types of calculations can be performed to estimate the LOC for fuel mixtures. If only LFL data are available, the LOC of the mixture can be calculated from the mixture LFL. If LOC data are available for the mixture components, a calculation can be performed for the LOC of the mixture. When performing the second type of calculation manually, as opposed to using a spreadsheet, it is better to do it in parts to avoid errors.

The LOC estimation method is not applicable for diluents other than nitrogen because the diluent must have a very simi-

lar heat capacity to the oxygen and nitrogen components present at the LFL.

Similar to the considerations in 7.7.3 with regard to methane enrichment of vent collection headers, the LOC estimation method is not recommended for mixtures containing components with a UFL greater than 75 mole percent in air. Such gases typically have UFLs in oxygen greater than 90 mole percent, and in some cases the “upper LOC” value might be less than the “lower LOC” value [2]. Furthermore, this method is not recommended for mixtures containing a decomposable gas or a gas that might be decomposable at elevated temperature and pressure.

B.8.1 Method 1 — Estimating Mixture LOC from Known Component LFLs. (The CHETAH program provides a method to perform this calculation.)

This method starts with known component LFLs (either determined by experiment or by using a reliable method) and uses Le Chatelier’s method to estimate the LFL for the mixture. The stoichiometric oxygen ratio for the mixture is calculated. The results of both calculations are used to estimate the LOC for the mixture.

Step 1: Calculate the LFL of the mixture using the following equation (Le Chatelier’s method):

[B.8.1a]

$$LFL_{mix} = \left[\sum_i \frac{x_i}{L_i} \right]^{-1}$$

where:

x_i = mole fraction of component i

L_i = LFL of component i (mol%) in mixture

Table B.7.3.1 Estimation of Flammable Limits of Methane Diluted with CO₂

	Pure Fuel	75% Fuel	50% Fuel	25% Fuel	Intersection
Total Fuel Molar Flow (or Fraction)	1	0.75	0.5	0.25	0.1563
Total Diluent Molar Flow (or Fraction)	0	0.25	0.5	0.75	0.8437
Total Stream Molar Flow (or Fraction)	1	1	1	1	1
Fuel-Only Mixture Parameters					
Mixture Stoichiometric Oxygen Ratio, $C_{o, mix}$	2	2	2	2	2
Mixture Heating Factor, $H_{f, mix}$	32.810	32.810	32.810	32.810	32.810
Mixture Heat of Oxidation, $H_{o, mix}$	16.405	16.405	16.405	16.405	16.405
Mixture Quenching Factor, $Q_{f, mix}$	13.810	13.810	13.810	13.810	13.810
Diluent Mixture Parameters					
Dilution Ratio = Molar Diluent/Molar Fuel	0	0.3333	1.0000	3.0000	5.3992
Diluent Mixture Quenching Factor, $Q_{D, mix}$	0	1.7510	1.7510	1.7510	1.7510
Diluted Mixture LFL					
Fuel Mole Fraction at Diluted Mixture LFL	0.05	0.0675	0.1039	0.2254	0.4013
Diluent Mole Fraction at Diluted Mixture LFL	0.05	0.0506	0.0520	0.0563	0.0627
	0	0.0169	0.0520	0.1690	0.3386
Diluted Mixture UFL					
Fuel Mole Fraction at Diluted Mixture UFL	0.15	0.1842	0.2385	0.3383	0.4013
Diluent Mole Fraction at Diluted Mixture UFL	0.15	0.1381	0.1193	0.0846	0.0627
	0	0.0460	0.1193	0.2538	0.3386


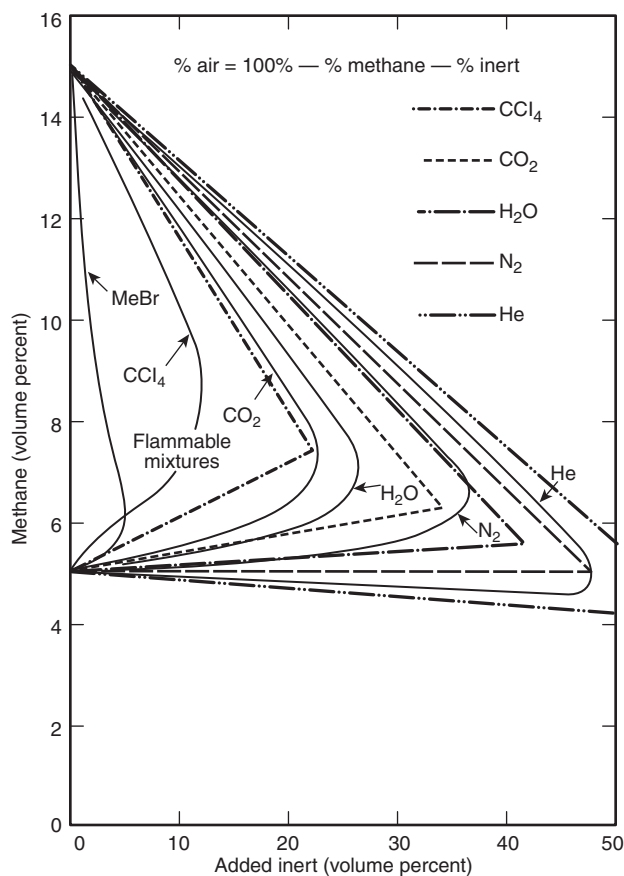


FIGURE B.7.3.2 Comparison of Predicted Flammability Limits to Data for Methane-Inert Gas-Air Mixtures.

Step 2: Calculate the stoichiometric oxygen, S_b , needed for each mixture component, i .

Let $C_cH_hO_oN_nX_x$ represent a gas [where X represents chlorine (Cl) or other halogen]. Equating coefficients in the stoichiometric combustion equation provides the following:



where:

c = number of carbon atoms in the gas molecule
 h = number of hydrogen atoms in the gas molecule
 o = number of oxygen atoms in the gas molecule
 n = number of nitrogen atoms in the gas molecule
 x = number of halogen atoms in the gas molecule

Then, S equals the moles of oxygen needed for stoichiometric combustion; hence, the following equation applies:

$$S = c + \frac{(h-x-2o)}{4} \quad [B.8.1c]$$

Step 3: Calculate stoichiometric oxygen, S_{mix} . The mathematical expression for this calculation is as follows:

$$S_{mix} = \sum_i x_i \times S_i = \sum_i c_i \times x_i + \frac{1}{4} \left[\sum_i h_i \times x_i - \sum_i x_i \times x_i - 2 \times \sum_i o_i \times x_i \right] \quad [B.8.1d]$$

Step 4: Calculate the LOC of the mixture, LOC_{mix} . Assume the LOC is equal to the minimum concentration of oxygen needed to completely combust the LFL concentration of fuel:

$$LOC_{mix} = LFL_{mix} \times S_{mix} \quad [B.8.1e]$$

Example 1

Calculate LFL for a mixture containing 0.20 mole methane, 0.40 mole methanol, 0.30 mole methylamine, and 0.10 mole methyl chloride. Table B.8.1(a) shows the calculation using "reported" LFL data from Britton and Frurip [3].

Table B.8.1(a) Fuel Mixture for Example 1

Component	Mole Fraction (x_i)	LFL L_i (mol %)	$\frac{x_i}{L_i}$
Methane	0.20	5.0	0.040
Methanol	0.40	6.0	0.066
Methylamine	0.30	4.9	0.061
Methyl chloride	0.10	8.1	0.012

$$\sum_i \frac{x_i}{L_i} = 0.179$$

The LFL of the mixture is calculated using Equation B.8.1a as follows:

$$LFL_{mix} = \left[\sum_i \frac{x_i}{L_i} \right]^{-1} = \frac{1}{0.179} = 5.59 \text{ mol\%} \quad [B.8.1f]$$

Calculate the stoichiometric ratio, S_{mix} , for the mixture as shown in Table B.8.1(b).

The S_{mix} of the mixture is calculated using Equation B.8.1d as follows:

$$S_{mix} = 1 + \frac{4.2 - 0.10 - 2 \times 0.40}{4} = 1.825 \quad [B.8.1g]$$

Following Steps 1 through 3, calculate LOC_{mix} using Equation B.8.1e as follows:

[B.8.1h]

$$LOC_{mix} = LFL_{mix} \times S_{mix} = 5.59 \times 1.825 = 10.2 \text{ mol\% O}_2$$

B.8.2 Method 2 — Estimating Mixture LOC from Known Component LOCs. This approach was presented by Zlochower and Green [4] and starts with known component LOC data and then assumes the LOC is equal to the stoichiometric ratio, S , multiplied by a derived fuel concentration (or pseudo-LFL) at LOC, L^*_i . The fuel mixture flammable limit is implicit in the solution, which results in a weighted average of the LOCs of the components. The pseudo-LFL at the LOC is as follows:

[B.8.2a]

$$L^*_i = \frac{LOC_i}{S_i}$$

where:
 L^*_i = pseudo-LFL at the LOC
 LOC_i = LOC of component i
 S_i = stoichiometric oxygen needed for component i

The mixture LOC is the product of the derived mixture fuel concentration and the mixture molar average stoichiometric ratio, as shown in the following equation:

[B.8.2b]

$$LOC_{mix} = S_{mix} \times L^*_{mix}$$

The derived mixture fuel concentration from Le Chatelier’s method is as follows:

[B.8.2c]

$$L^*_{mix} = \left[\sum_i \frac{x_i}{L^*_i} \right]^{-1} = \left[\sum_i x_i \frac{S_i}{LOC_i} \right]^{-1}$$

where:
 x_i = mole fraction of component i

The LOC of the mixture is as follows:

[B.8.2d]

$$LOC_{mix} = \frac{\sum_i x_i \times S_i}{\sum_i x_i \times \frac{S_i}{LOC_i}}$$

Example 2

Consider a fuel mixture consisting of methane, ethylene, carbon monoxide, and methanol, with the mole fractions and component LOCs in nitrogen [4, 5] as summarized in Table B.8.2(a).

Table B.8.2(a) Fuel Mixture for Example 2

Component	Formula	Mole Fraction x_i	LOC _{<i>i</i>} (N ₂) (mol%)
Methane	CH ₄	0.30	11.1
Ethylene	C ₂ H ₄	0.30	8.5
Carbon monoxide	CO	0.20	5.1
Methanol	CH ₃ OH	0.20	8.5

The stoichiometric ratios for each component and the intermediate values from Equation B.8.2d are summarized in Table B.8.2(b).

The LOC of the mixture is calculated using Equation B.8.2d as follows:

[B.8.2e]

$$LOC_{mix} = \frac{\sum_i x_i \times S_i}{\sum_i x_i \times \frac{S_i}{LOC_i}} = \frac{1.9}{0.215} = 8.8 \text{ mol\% O}_2$$

Table B.8.1(b) Calculation of Fuel Mixture Stoichiometric Ratio S_{mix}

Component	Formula	Mole Fraction					
		(x_i)	$c \times x_i$	$h \times x_i$	$o \times x_i$	$n \times x_i$	$x \times x_i$
Methane	CH ₄	0.20	0.20	0.80	—	—	—
Methanol	CH ₃ OH	0.40	0.40	1.60	0.40	—	—
Methylamine	CH ₅ N	0.30	0.30	1.50	—	0.30	—
Methyl chloride	CH ₃ Cl	0.10	0.10	0.30	—	—	0.10
Total	Mixture	$\sum x_i = 1.0$	$\sum c = 1$	$\sum h = 4.2$	$\sum o = 0.4$	$\sum n = 0.3$	$\sum x = 0.1$

Table B.8.2(b) Intermediate Values for Zlochow and Green Method

Component	Formula	S_i	Mole Fraction x_i	$x_i \times S_i$	$x_i \times \frac{S_i}{LOC_i}$
Methane	CH ₄	2	0.30	0.60	0.0541
Ethylene	C ₂ H ₄	3	0.30	0.90	0.106
Carbon Monoxide	CO	0.5	0.20	0.10	0.0196
Methanol	CH ₃ OH	1.5	0.20	0.30	0.0353
Total	Mixture	—	$\sum x_i = 1.0$	$\sum x_i \times S_i = 1.9$	$\sum x_i \times \frac{S_i}{LOC_i} = 0.215$

B.8.3 References.

[1] Britton, L. G., M. P. Clouthier, B. K. Harrison, and S. A. Rodgers, "Limiting Oxygen Concentrations of Gases," *Process Safety Progress* 35, no. 1 (2016): 107–114.

[2] US Bureau of Mines Bulletin 680, "Investigation of Fire and Explosion Accidents in the Chemical, Mining, and Fuel-Related Industries — A Manual," 1985.

[3] Britton, L. G., and D. J. Frurip, "Further Uses of the Heat of Oxidation in Chemical Hazard Assessment," *Process Safety Progress* 22, no. 1 (2003): 1–19.

[4] Zlochow, I. A., and G. M. Green, "The Limiting Oxygen Concentration and Flammability Limits of Gases and Gas Mixtures," *Journal of Loss Prevention in the Process Industries* 22, no. 4 (July 2009): 499–505.

[5] US Bureau of Mines Bulletin 503, "Limits of Flammability of Gases and Vapors," 1952.

Annex C Limiting Oxidant Concentrations

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

C.1 Limiting Oxidant Concentration for Gases and Dusts.

Table C.1(a) and Table C.1(b) provide values for limiting oxidant concentration (LOC) using nitrogen, carbon dioxide, and inert dust as the diluent. Table C.1(a) provides LOC values for flammable gases, and Table C.1(b) provides data for combustible dust suspensions.

C.2 Inerting of Dust Clouds by Mixing the Combustible Dust with Inert Dust. Table C.2 provides data on the concentration of inert dust required to inert selected combustible dusts.

Table C.1(a) Limiting Oxidant Concentrations for Flammable Gases When Nitrogen or Carbon Dioxide Are Used as Diluents

Gas/Vapor	Updated or (Adjusted) Data		Original Data	
	N ₂ -Air Mixture	CO ₂ -Air Mixture	N ₂ -Air Mixture	CO ₂ -Air Mixture
	LOC	LOC	LOC	LOC
Paraffins (alkanes)				
Methane	11.1 ^a	(13.1) ^b	12.1 ^b	14.6 ^b
Ethane	(9.5) ^b	(11.9) ^b	11.0 ^b	13.4 ^b
Propane	10.7 ^a	(12.8) ^b	11.4 ^b	14.3 ^b
<i>n</i> -Butane	(10.6) ^b	(13.0) ^b	12.1 ^b	14.5 ^b
Isobutane (methylpropane)	(10.5) ^b	(13.3) ^b	12.0 ^b	14.8 ^b
<i>n</i> -Pentane	(10.6) ^b	(12.9) ^b	12.1 ^b	14.4 ^b
Isopentane (2-methylbutane)	(10.5) ^c	(13.0) ^c	12.0 ^c	14.5 ^c
<i>n</i> -Hexane	(10.4) ^b	(13.0) ^b	11.9 ^b	14.5 ^b
<i>n</i> -Heptane	(10.0) ^c	(13.0) ^c	11.5 ^c	14.5 ^c
Cycloparaffins (cycloalkanes, naphthenes)				
Cyclopropane	(10.2) ^b	(12.4) ^b	11.7 ^b	13.9 ^b
Olefins (alkenes)				
Ethylene (ethene)	8.5 ^a	(10.2) ^b	10.0 ^b	11.7 ^b
Propylene (propene)	(10.0) ^b	(12.6) ^b	11.5 ^b	14.1 ^b
α-butylene (1-butene)	(10.1) ^b	(12.5) ^b	11.6 ^b	14.0 ^b
Isobutylene (2-methylpropene)	(10.5) ^c	(13.5) ^c	12.0 ^c	15.0 ^c
Isopentene (3-methyl-1-butene)	(10.0) ^c	(12.5) ^c	11.5 ^c	14.0 ^c
Diolefins (dienes)				
1,3-Butadiene	(8.9) ^b	(11.6) ^b	10.4 ^b	13.1 ^b
Aromatics				
Benzene	11.4 ^d	(12.4) ^b	11.4 ^d	13.9 ^b
Ethylbenzene	9.0 ^{d,e}	—	9.0 ^{d,e}	—
Diethylbenzene	8.5 ^{d,f}	—	8.5 ^{d,f}	—
Divinylbenzene	8.5 ^{d,f}	—	8.5 ^{d,f}	—
Toluene	9.5 ^{g,h}	—	9.5 ^{g,h}	—
Vinyltoluene	9.0 ^{d,i}	—	9.0 ^{d,i}	—
Styrene (phenylethene)	9.0 ^{d,j}	—	9.0 ^{d,j}	—
Alcohols				
Methyl alcohol (methanol)	(8.5) ^c	(10.5) ^c	10.0 ^c	12.0 ^c
Ethyl alcohol (ethanol)	(9.0) ^c	(11.5) ^c	10.5 ^c	13.0 ^c
Ethyl alcohol (ethanol)	8.7 ^{g,h}	—	8.7 ^{g,h}	—
<i>n</i> -Propyl alcohol (<i>n</i> -propanol)	8.6 ^{g,h}	—	8.6 ^{g,h}	—
Isopropyl alcohol (2-propanol)	9.5 ^{k,h}	—	9.5 ^{k,h}	—
<i>t</i> -Butyl alcohol (<i>t</i> -butanol)	—	(15.0) ^{c,l}	—	16.5 ^{c,l}
Isobutyl alcohol (2-methyl-1-propanol)	9.1 ^{g,h}	—	9.1 ^{g,h}	—
Isohexyl alcohol (2-ethyl-1-butanol)	(7.9) ^{c,l}	—	9.3 ^{c,l}	—
Esters				
Methyl formate	(8.5) ^c	(11.0) ^c	10.0 ^c	12.5 ^c
Methyl acetate	(9.5) ^c	(12.0) ^c	11.0 ^c	13.5 ^c
<i>n</i> -Propyl acetate	10.1 ^{k,h}	—	10.1 ^{k,h}	—
Isopropyl acetate	8.8 ^{g,h}	—	8.8 ^{g,h}	—
<i>n</i> -Butyl acetate	9.0 ^{g,h}	—	9.0 ^{g,h}	—
Isobutyl acetate	9.1 ^{g,h}	—	9.1 ^{g,h}	—
Isobutyl formate	(11.0) ^c	(13.5) ^c	12.5 ^c	15.0 ^c
Ethers				
Methyl ether	(9.0) ^c	(11.5) ^c	10.5 ^c	13.0 ^c
Ethyl ether	(9.0) ^c	(11.5) ^c	10.5 ^c	13.0 ^c
Propylene oxide	(6.6) ^m	—	7.8 ^m	—
Ketones				
Acetone	(10.0) ^c	(12.5) ^c	11.5 ^c	14.0 ^c
Methyl ethyl ketone	(9.5) ^c	(12.0) ^c	11.0 ^c	13.5 ^c

(continues)